

NOTES:


1. IF PIPE MATERIAL 8 (25" PIPE) IS USED, THE 24" FLANGE SHALL BE REAMED TO PROVIDE CLEARANCE FOR 25" PIPE. FLANGE SHALL BE WELDED TO THE 25" PIPE PER AWWA D 207.

VALVE VAULT SECTION DETAIL

SCALE: 3/4" = 1'-0"




3
C200

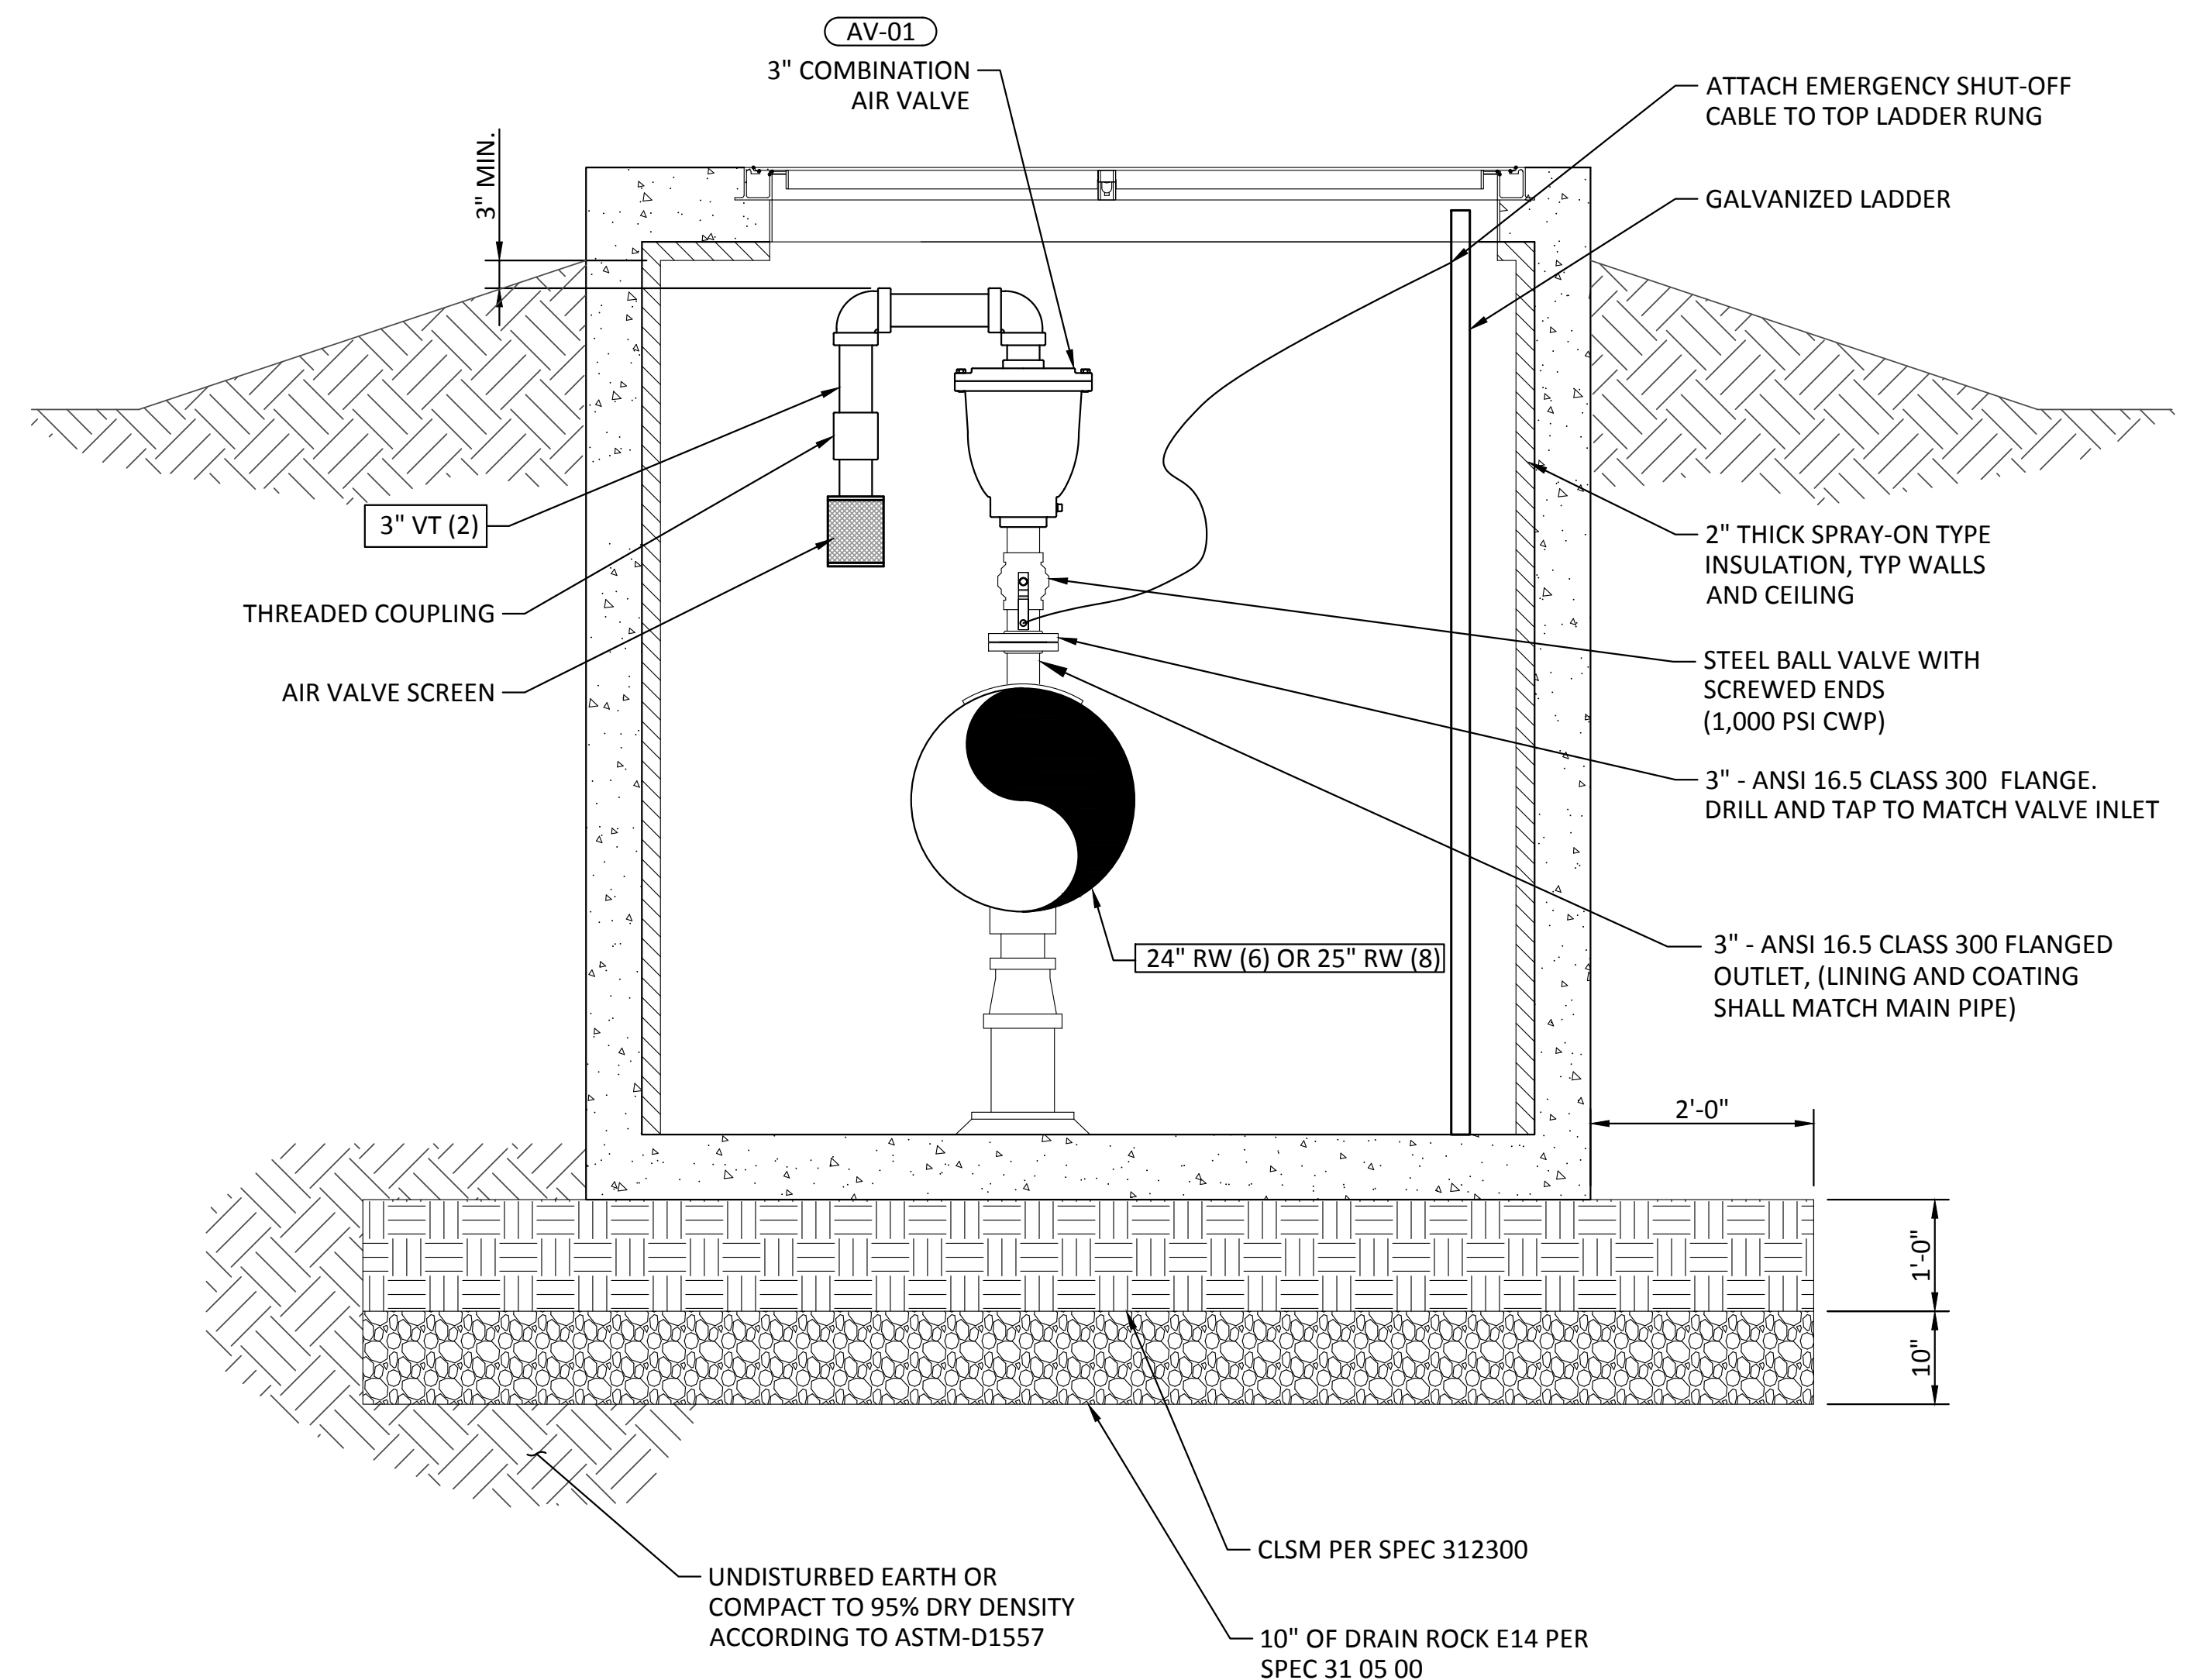

VALVE VAULT SECTION DETAIL

SCALE: 1/2" = 1'-0"



4
C200

REV	DATE	BY	DESCRIPTION
1	6/10/22	JAL	REVISED - ISSUED FOR CONSTRUCTION
0	5/25/22	JAL	ISSUED FOR CONSTRUCTION

WARNING
IF THIS BAR DOES NOT MEASURE 1" THEN DRAWING IS NOT TO SCALE.



KLAMATH RIVER RENEWAL CORPORATION
CITY OF YREKA WATER LINE
CIVIL SECTIONS AND DETAILS

DESIGNED J. BURNS
DRAWN R. WOOD
CHECKED J. LOWY
PROJECT DATE 5/25/22

DRAWING
C202

Path: C:\Vault20\Klamath River Renewal Corp\City of Yreka Water Line\C202.dwg Plot date: Jun 10, 2022 12:29pm. CAD User: JoeNieves