



67935

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-14-2020

Lab: Asbestech

Job Number: 20-5562

Collected by: Andy Roed

Client Name: NV5

Turnaround Time: Day: Tuesday
Date: 10 / 13 /20 Time: 5 pm

Site Address: Iron Gate Dam

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: *Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.*

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDFHS-01A	Black Felt Paper under Metal Roofing
ECG-20-5562-IGDFHS-01B	Black Felt Paper under Metal Roofing

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDFHS\Bulk Request 9-15-2020.wpd

Delivered by: 

Date: 10 / 7 / 20 **Time:** 10:00 AM/PM

Received by: 

Date: 10 / 7 / 20 **Time:** 10:40 AM/PM



67927

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-14-2020

Job Number: 20-5562

Client Name: NV5

Site Address: Iron Gate Dam

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 13 /20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDFPS-01A	Concrete on Supports for Fish Hatchery Water Supply
ECG-20-5562-IGDFPS-02A	Brown Fibrous Material at Saddles for Fish Hatchery Water Supply
ECG-20-5562-IGDFPS-03A	Silver Paint over Black Asphaltic Material on Fish Hatchery Water Supply

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDFPS\Bulk Request 9-15-2020.wpd

Delivered by: 

Date: 10 / 7 / 20 **Time:** 1040 **AM/PM**

Received by: 

Date: 10 / 7 / 20 **Time:** 1640 **AM/PM**



67929

BULK ASBESTOS MATERIAL Analysis Request

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-14-2020

Job Number: 20-5562

Client Name: NV5

Site Address: Iron Gate Dam

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 13 /20 Time: 5 pm


ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDPH-01A	CMU and Grout / Power House, Interior Wall
ECG-20-5562-IGDPH-02A	Concrete / Powerhouse Floor

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDPH\Bulk Request 9-15-2020.wpd

Delivered by: 

Date: 10 / 7 / 20 **Time:** 1040 **AM/PM**

Received by: 

Date: 10 / 7 / 20 **Time:** 1040 **AM/PM**



67932

BULK ASBESTOS MATERIAL Analysis Request

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-14-2020

Job Number: 20-5562

Client Name: NV5

Site Address: Iron Gate Dam

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 13 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDPIS-01A	Concrete / Intake House Foundation


C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDPIS\Bulk Request 9-15-2020.wpd

Delivered by: 

Date: 10 / 17 / 20 Time: 1040 AM/PM

Received by: 

Date: 10 / 17 / 20 Time: 1040 AM/PM



67926

BULK ASBESTOS MATERIAL Analysis Request

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-14-2020

Job Number: 20-5562

Client Name: NV5

Site Address: Iron Gate Dam

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 13 /20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDRR-01A	Concrete / Foundation of Building
ECG-20-5562-IGDRR-02A	CMU and Grout / Storage Area Interior Wall

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDRR\Bulk Request
9-15-2020.wpd

Delivered by: [Signature] **Date:** 10 / 7 /20 **Time:** 1040 AM/PM

Received by: [Signature] **Date:** 10 / 7 /20 **Time:** 1040 AM/PM

APPENDIX B

LEAD RELATED DOCUMENTS

- Lead in Paint Samples Analysis Report From EMLAB
- Bulk Lead Material Analysis Request Form for Entek




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562; NV5; Iron Gate Dam
EML ID: 2498697

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-13-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562; NV5; Iron Gate Dam

Date of Sampling: 09-14-2020
Date of Receipt: 10-08-2020
Date of Report: 10-15-2020

LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY

Location:	ECG-20-IGDCB-01Pb: White paint on interior walls and door frames	ECG-20-IGDCB-02Pb: Yellow paint on exterior bollards
Comments (see below)	A	A
Lab ID-Version‡:	11905547-1	11905548-1
Analysis Date:	10/13/2020	10/13/2020
Sample type	Paint Chip sample	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	130 ppm	55 ppm
Sample size	0.0780 grams	0.1818 grams
§ Total Lead Result	< 130 ppm	180 ppm

Comments: A) The relative percent difference of the matrix duplicate pair was above control limits. The laboratory control sample and matrix blank were both within control limits and validated the batch.

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".


Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562; NV5; Iron Gate Dam
EML ID: 2498724

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-12-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562; NV5; Iron Gate DamDate of Sampling: 09-14-2020
Date of Receipt: 10-08-2020
Date of Report: 10-14-2020**LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY**

Location:	ECG-20-5562-IGDDTI-01Pb: Orange paint on interior metal ladder
Comments (see below)	None
Lab ID-Version‡:	11905853-1
Analysis Date:	10/12/2020
Sample type	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	83 ppm
Sample size	0.1212 grams
§ Total Lead Result	210000 ppm

Comments:

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".


Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562; NV5; Iron Gate Dam
EML ID: 2498714

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-13-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562; NV5; Iron Gate Dam

Date of Sampling: 09-14-2020
Date of Receipt: 10-08-2020
Date of Report: 10-15-2020

LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY

Location:	ECG-20-5562-IGDES-01Pb: Gray Paint on Exterior Wood Siding
Comments (see below)	A
Lab ID-Version‡:	11905926-1
Analysis Date:	10/13/2020
Sample type	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	73 ppm
Sample size	0.1378 grams
§ Total Lead Result	< 73 ppm

Comments: A) The relative percent difference of the matrix duplicate pair was above control limits. The laboratory control sample and matrix blank were both within control limits and validated the batch.

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562; NV5; Iron Gate Dam
EML ID: 2498705

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-13-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Eurofins EMLab P&K

17461 Derian Ave, Suite 100, Irvine, CA 92614
(866) 888-6653 Fax (623) 780-7695 www.emlab.com

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562; NV5; Iron Gate Dam

Date of Sampling: 09-14-2020
Date of Receipt: 10-08-2020
Date of Report: 10-15-2020

LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY

Location:	ECG-20-5562-IGDFHF-01Pb: Red/Orange Paint on Handrails	ECG-20-5562-IGDFHF-02Pb: Silver Paint on Exterior Equipment Structures	ECG-20-5562-IGDFHF-03Pb: Green Paint on Gantry Gate
Comments (see below)	A	A	A
Lab ID-Version‡:	11905893-1	11905894-1	11905895-1
Analysis Date:	10/13/2020	10/13/2020	10/13/2020
Sample type	Paint Chip sample	Paint Chip sample	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified	NIOSH 7082 & EPA 7000B modified	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	380 ppm	220 ppm	360 ppm
Sample size	0.0265 grams	0.0460 grams	0.0276 grams
§Total Lead Result	< 380 ppm	92000 ppm	< 360 ppm

Comments: A) The relative percent difference of the matrix duplicate pair was above control limits. The laboratory control sample and matrix blank were both within control limits and validated the batch.

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562; NV5; Iron Gate Dam
EML ID: 2498702

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-13-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562; NV5; Iron Gate Dam

Date of Sampling: 09-14-2020
Date of Receipt: 10-08-2020
Date of Report: 10-15-2020

LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY

Location:	ECG-20-5562-IGDFHS-01Pb: Gray Paint On Wood Siding
Comments (see below)	None
Lab ID-Version‡:	11905609-1
Analysis Date:	10/13/2020
Sample type	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	39 ppm
Sample size	0.2576 grams
§ Total Lead Result	< 39 ppm

Comments:

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".


Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562; NV5; Iron Gate Dam
EML ID: 2498716

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-12-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562; NV5; Iron Gate DamDate of Sampling: 09-14-2020
Date of Receipt: 10-08-2020
Date of Report: 10-14-2020**LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY**

Location:	ECG-20-5562-IGDPIS-01Pb: Red paint on metal walkway
Comments (see below)	None
Lab ID-Version‡:	11905885-1
Analysis Date:	10/12/2020
Sample type	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	83 ppm
Sample size	0.1209 grams
§ Total Lead Result	170000 ppm

Comments:

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562; NV5; Iron Gate Dam
EML ID: 2498720

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-12-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562; NV5; Iron Gate DamDate of Sampling: 09-14-2020
Date of Receipt: 10-08-2020
Date of Report: 10-14-2020**LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY**

Location:	ECG-20-5562-IGDRR-01Pb: Silver paint on metal door	ECG-20-5562-IGDRR-02Pb: Gray paint on floor of restroom
Comments (see below)	None	None
Lab ID-Version‡:	11905856-1	11905857-1
Analysis Date:	10/12/2020	10/12/2020
Sample type	Paint Chip sample	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	75 ppm	40 ppm
Sample size	0.1329 grams	0.2500 grams
§ Total Lead Result	< 75 ppm	< 40 ppm

Comments:

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".



BULK LEAD MATERIAL *Analysis Request*



002498697

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com**Date of Sampling:** 9-14-2020**Lab:** Emlab P & K - Irvine**Job Number:** 20-5562**Collected by:** Roed**Client Name:** NV5**Turnaround Time:** Standard**Site Address:** Iron Gate Dam**ANALYSIS REQUESTED:** Lead by Flame Atomic
Absorption Spectroscopy**Special Instruction:** *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDCB-01Pb	White Paint on Interior walls and door frames
ECG-20-5562-IGDCB-02Pb	Yellow Paint on Exterior Bollards

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDCB\Bulk Request Pb
09-15-2020.wpd

Delivered by:
Mia Kadosh**Date:**

10/12/20

Time:

1:00 AM/PM

Received by:**Date:**

10/18/20

Time:

9:45 AM/PM



002498724

BULK LEAD MATERIAL *Analysis Request***ENTEK CONSULTING GROUP, INC.**

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com**Date of Sampling:** 9-14-2020**Lab:** Emlab P & K - Irvine**Job Number:** 20-5562**Collected by:** Roed**Client Name:** NV5**Turnaround Time:** Standard**Site Address:** Iron Gate Dam**ANALYSIS REQUESTED:** Lead by Flame Atomic
Absorption Spectroscopy**Special Instruction:** *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDDTI-01Pb	Orange Paint on Interior Metal Ladder

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDDTI\Bulk Request Pb
09-15-2020.wpd

Delivered by:via fed ex**Date:**10/17/20**Time:**9AM/PM**Received by:**[Signature]**Date:**10/18/20**Time:**945AM/PM



BULK LEAD MATERIAL *Analysis Request*



002498714

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677


(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com**Date of Sampling:** 9-14-2020**Lab:** Emlab P & K - Irvine**Job Number:** 20-5562**Collected by:** Roed**Client Name:** NV5**Turnaround Time:** Standard**Site Address:** Iron Gate Dam**ANALYSIS REQUESTED:** Lead by Flame Atomic
Absorption Spectroscopy**Special Instruction:** *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDES-01Pb	Gray Paint on Exterior Wood Siding

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDES\Bulk Request Pb
09-15-2020.wpd

Delivered by:
via FedEx**Date:**

10/17/20

Time:

9

AM/PM

Received by:**Date:**

10/18/20

Time:

9:45

AM/PM



BULK LEAD MATERIAL *Analysis Request*



002498705

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 9-14-2020

Lab: Emlab P & K - Irvine

Job Number: 20-5562

Collected by: Roed

Client Name: NV5

Turnaround Time: Standard

Site Address: Iron Gate Dam

ANALYSIS REQUESTED: Lead by Flame Atomic
Absorption Spectroscopy

Special Instruction: Please report result in PPM and % by weight. Please email results as soon as possible.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDFHF-01Pb	Red/Orange Paint on Handrails
ECG-20-5562-IGDFHF-02Pb	Silver Paint on Exterior Equipment Structures
ECG-20-5562-IGDFHF-03Pb	Green Paint on Gantry Gate

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dam\Field Documents\Iron Gate\COCs\IGDFHF\Bulk Request Pb 09-15-2020.wpd

Delivered by: *via fedex* Date: 10/17/20 Time: 9 AM/PM

Received by: *[Signature]* Date: 10/17/20 Time: 245 AM/PM



BULK LEAD MATERIAL *Analysis Request*



002498702

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com

Date of Sampling: 9-14-2020

Lab: Emlab P & K - Irvine

Job Number: 20-5562

Collected by: Roed

Client Name: NV5

Turnaround Time: Standard

Site Address: Iron Gate Dam

ANALYSIS REQUESTED: Lead by Flame Atomic
Absorption Spectroscopy

Special Instruction: *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDFHS-01Pb	Gray Paint on Wood Siding

C:\Users\salbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDFHS\Bulk Request Pb
09-15-2020.wpd

Delivered by:

via FedEx

Date:

10/7/20

Time:

9:00 AM/PM

Received by:

[Signature]

Date:

10/10/20

Time:

8:45 AM/PM



BULK LEAD MATERIAL *Analysis Request*



002498716

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com

Date of Sampling: 9-14-2020

Lab: Emlab P & K - Irvine

Job Number: 20-5562

Collected by: Roed

Client Name: NV5

Turnaround Time: Standard

Site Address: Iron Gate Dam

ANALYSIS REQUESTED: Lead by Flame Atomic Absorption Spectroscopy

Special Instruction: *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDPIS-01Pb	Red Paint on Metal Walkway

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDPIS\Bulk Request Pb 09-15-2020.wpd

Delivered by:


via Fedex

Date:

10/7/20

Time:

9 AM/PM

Received by:



Date:

10/8/20

Time:

9:45 AM/PM



BULK LEAD MATERIAL *Analysis Request*



002498720

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com

Date of Sampling: 9-14-2020

Lab: Emlab P & K - Irvine

Job Number: 20-5562

Collected by: Roed

Client Name: NV5

Turnaround Time: Standard

Site Address: Iron Gate Dam

ANALYSIS REQUESTED: Lead by Flame Atomic
Absorption Spectroscopy

Special Instruction: *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-IGDRR-01Pb	Silver Paint on Metal Door
ECG-20-5562-IGDRR-02Pb	Gray Paint on Floor of Restroom

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\Iron Gate\COCs\IGDRR\Bulk Request Pb
09-15-2020.wpd

Delivered by:

via Fedex

Date:

10/17/20

Time:

9 AM/PM

Received by:

[Signature]

Date:

10/18/20

Time:

945 AM/PM

Lead Testing Data Sheet (OSHA)

Iron Gate Development

Entek Project # 20-5562

Niton: XLp-300A Lead Analyzer

Date: 9-14 and 9-15, 2020

Address: Iron Gate Development

XRF Serial No.: 24015

Source No.: TR3580

Room Equivalent:

Inspector(s): Andy Roed

Component	Substrate	Color	Test Locations	XRF Reading (mg/cm ²)
Ladder	Metal	Yellow	Aerator Structure	2.7
Pipe	Metal	Red	Aerator Piping	4.4
Siding	Wood	Gray	Wood Siding on emergency spill shed	0.0
Structural Component	Metal	Tan	Penstock Intake Structure	2.2
Handrail	Metal	Silver	Penstock Intake Structure	2.6
Handrails	Metal	Orange	Handrails of Fish holding Facility	0.2
Gantry Gate	Metal	Green	Paint on fish ladder gantry gate	0.1
Crane Rails	Metal	Silver	Rails for Crane on top of Powerhouse	14.2
Ladder	Metal	Yellow	Ladder on interior of powerhouse	2.8
Equipment	Metal	Gray	Turbine enclosure on top of powerhouse	1.9
Walls	Metal	White	Communications Building	0.1
Bollard	Metal	Yellow	Bollards outside communication building	0.0
Siding	Wood	Gray	Fish holding shed siding	0.0

C:\Users\andy\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Reports\Iron Gate\Working Documents\Lead Test Data Sheet\OSHA.wpd

All XRF Readings ≥ 1.0 mg/cm² = Lead Based Paint (LBP)All XRF Readings < 1.0 mg/cm² = Lead Containing Coating (LCC)

Calibration Check Test Results

Klamath River Dams

Site Name: Copco 1 Development Date: 9-17-2020
City: Hornbrook, CA
Device: Niton Xlp 300 Source Assay Date: 12-1-19
XRF Serial No. 24015 Source Number: TR3580
Contractor: Entek Consulting Group, Inc.
Inspector Name: Andy Roed
Inspector Signature: _____

Calibration Check Tolerance Used <u>1.04 ±0.06</u>			
First Calibration Check <u>0900</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
1.0	1.0	0.9	

Second Calibration Check <u>1600</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
1.0	1.1	1.0	

Third Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

Fourth Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

* If the Calibration Check from the red SRM film value is greater or less than the specified Calibration Check Tolerance for this device, consult the manufacturer's recommendations to bring the instrument back into control. Retest all testing combinations tested since the last successful Calibration Check test.

Calibration Check Test Results

Klamath River Dams

Site Name: Iron Gate / Copco 2 Development Date: 9-16-2020
City: Hornbrook, CA
Device: Niton Xlp 300 Source Assay Date: 12-1-19
XRF Serial No. 24015 Source Number: TR3580
Contractor: Entek Consulting Group, Inc.
Inspector Name: Andy Roed
Inspector Signature: _____

Calibration Check Tolerance Used <u>1.04 ±0.06</u>			
First Calibration Check <u>0700</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
0.9	1.0	0.9	

Second Calibration Check <u>1500</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
1.0	0.9	1.0	

Third Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

Fourth Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

* If the Calibration Check from the red SRM film value is greater or less than the specified Calibration Check Tolerance for this device, consult the manufacturer's recommendations to bring the instrument back into control. Retest all testing combinations tested since the last successful Calibration Check test.

Calibration Check Test Results

Klamath River Dams

Site Name: Iron Gate / Copco 2 Development Date: 9-15-2020
City: Hornbrook, CA
Device: Niton Xlp 300 Source Assay Date: 12-1-19
XRF Serial No. 24015 Source Number: TR3580
Contractor: Entek Consulting Group, Inc.
Inspector Name: Andy Roed
Inspector Signature: _____

Calibration Check Tolerance Used <u>1.04 ±0.06</u>			
First Calibration Check <u>0800</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
0.9	1.0	1.0	

Second Calibration Check <u>1700</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
1.0	1.0	1.0	

Third Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

Fourth Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

* If the Calibration Check from the red SRM film value is greater or less than the specified Calibration Check Tolerance for this device, consult the manufacturer's recommendations to bring the instrument back into control. Retest all testing combinations tested since the last successful Calibration Check test.

Calibration Check Test Results

Klamath River Dams

Site Name: Iron Gate / Copco 2 Development Date: 9-14-2020
City: Hornbrook, CA
Device: Niton Xlp 300 Source Assay Date: 12-1-19
XRF Serial No. 24015 Source Number: TR3580
Contractor: Entek Consulting Group, Inc.
Inspector Name: Andy Roed
Inspector Signature: _____

Calibration Check Tolerance Used <u>1.04 ±0.06</u>			
First Calibration Check <u>0700</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
0.9	0.9	1.0	

Second Calibration Check <u>1730</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
1.0	1.0	1.1	

Third Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

Fourth Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

* If the Calibration Check from the red SRM film value is greater or less than the specified Calibration Check Tolerance for this device, consult the manufacturer's recommendations to bring the instrument back into control. Retest all testing combinations tested since the last successful Calibration Check test.

Performance Characteristic Sheet

EFFECTIVE DATE: September 24, 2004

EDITION NO.: 1

MANUFACTURER AND MODEL:

Make: Niton LLC

Tested Model: XLp 300

Source: ^{109}Cd

Note: This PCS is also applicable to the equivalent model variations indicated below, for the Lead-in-Paint K+L variable reading time mode, in the XLi and XLp series:

XLi 300A, XLi 301A, XLi 302A and XLi 303A.

XLp 300A, XLp 301A, XLp 302A and XLp 303A.

XLi 700A, XLi 701A, XLi 702A and XLi 703A.

XLp 700A, XLp 701A, XLp 702A, and XLp 703A.

Note: The XLi and XLp versions refer to the shape of the handle part of the instrument. The differences in the model numbers reflect other modes available, in addition to Lead-in-Paint modes. The manufacturer states that specifications for these instruments are identical for the source, detector, and detector electronics relative to the Lead-in-Paint mode.

FIELD OPERATION GUIDANCE

OPERATING PARAMETERS:

Lead-in-Paint K+L variable reading time mode.

XRF CALIBRATION CHECK LIMITS:

0.8 to 1.2 mg/cm² (inclusive)

The calibration of the XRF instrument should be checked using the paint film nearest 1.0 mg/cm² in the NIST Standard Reference Material (SRM) used (e.g., for NIST SRM 2579, use the 1.02 mg/cm² film).

If readings are outside the acceptable calibration check range, follow the manufacturer's instructions to bring the instruments into control before XRF testing proceeds.

SUBSTRATE CORRECTION:

For XRF results using Lead-in-Paint K+L variable reading time mode, substrate correction is not needed for:

Brick, Concrete, Drywall, Metal, Plaster, and Wood

INCONCLUSIVE RANGE OR THRESHOLD:

K+L MODE READING DESCRIPTION	SUBSTRATE	THRESHOLD (mg/cm ²)
Results not corrected for substrate bias on any substrate	Brick	1.0
	Concrete	1.0
	Drywall	1.0
	Metal	1.0
	Plaster	1.0
	Wood	1.0

BACKGROUND INFORMATION

EVALUATION DATA SOURCE AND DATE:

This sheet is supplemental information to be used in conjunction with Chapter 7 of the HUD *Guidelines for the Evaluation and Control of Lead-Based Paint Hazards in Housing* ("HUD Guidelines"). Performance parameters shown on this sheet are calculated from the EPA/HUD evaluation using archived building components. Testing was conducted in August 2004 on 133 testing combinations. The instruments that were used to perform the testing had new sources; one instrument's was installed in November 2003 with 40 mCi initial strength, and the other's was installed June 2004 with 40 mCi initial strength.

OPERATING PARAMETERS:

Performance parameters shown in this sheet are applicable only when properly operating the instrument using the manufacturer's instructions and procedures described in Chapter 7 of the HUD Guidelines.

SUBSTRATE CORRECTION VALUE COMPUTATION:

Substrate correction is not needed for brick, concrete, drywall, metal, plaster or wood when using Lead-in-Paint K+L variable reading time mode, the normal operating mode for these instruments. If substrate correction is desired, refer to Chapter 7 of the HUD Guidelines for guidance on correcting XRF results for substrate bias.

EVALUATING THE QUALITY OF XRF TESTING:

Randomly select ten testing combinations for retesting from each house or from two randomly selected units in multifamily housing. Use the K+L variable time mode readings.

Conduct XRF retesting at the ten testing combinations selected for retesting.

Determine if the XRF testing in the units or house passed or failed the test by applying the steps below.

Compute the Retest Tolerance Limit by the following steps:

Determine XRF results for the original and retest XRF readings. Do not correct the original or retest results for substrate bias. In single-family housing a result is defined as the average of three readings. In multifamily housing, a result is a single reading. Therefore, there will be ten original and ten retest XRF results for each house or for the two selected units.

Calculate the average of the original XRF result and retest XRF result for each testing combination.

Square the average for each testing combination.

Add the ten squared averages together. Call this quantity C.

Multiply the number C by 0.0072. Call this quantity D.

Add the number 0.032 to D. Call this quantity E.

Take the square root of E. Call this quantity F.

Multiply F by 1.645. The result is the Retest Tolerance Limit.

Compute the average of all ten original XRF results.

Compute the average of all ten re-test XRF results.

Find the absolute difference of the two averages.

If the difference is less than the Retest Tolerance Limit, the inspection has passed the retest. If the difference of the overall averages equals or exceeds the Retest Tolerance Limit, this procedure should be repeated with ten new testing combinations. If the difference of the overall averages is equal to or greater than the Retest Tolerance Limit a second time, then the inspection should be considered deficient.

Use of this procedure is estimated to produce a spurious result approximately 1% of the time. That is, results of this procedure will call for further examination when no examination is warranted in approximately 1 out of 100 dwelling units tested.

TESTING TIMES:

For the Lead-in-Paint K+L variable reading time mode, the instrument continues to read until it is moved away from the testing surface, terminated by the user, or the instrument software indicates the reading is complete. The following table provides testing time information for this testing mode. The times have been adjusted for source decay, normalized to the initial source strengths as noted above. Source strength and type of substrate will affect actual testing times. At the time of testing, the instruments had source strengths of 26.6 and 36.6 mCi.

Testing Times Using K+L Reading Mode (Seconds)						
	All Data			Median for laboratory-measured lead levels (mg/cm ²)		
Substrate	25 th Percentile	Median	75 th Percentile	Pb < 0.25	0.25 ≤ Pb < 1.0	1.0 ≤ Pb
Wood Drywall	4	11	19	11	15	11
Metal	4	12	18	9	12	14
Brick Concrete Plaster	8	16	22	15	18	16

CLASSIFICATION RESULTS:

XRF results are classified as positive if they are greater than or equal to the threshold, and negative if they are less than the threshold.

DOCUMENTATION:


A document titled *Methodology for XRF Performance Characteristic Sheets* provides an explanation of the statistical methodology used to construct the data in the sheets, and provides empirical results from using the recommended inconclusive ranges or thresholds for specific XRF instruments. For a copy of this document call the National Lead Information Center Clearinghouse at 1-800-424-LEAD.

This XRF Performance Characteristic Sheet was developed by the Midwest Research Institute (MRI) and QuanTech, Inc., under a contract between MRI and the XRF manufacturer. HUD has determined that the information provided here is acceptable when used as guidance in conjunction with Chapter 7, Lead-Based Paint Inspection, of HUD's *Guidelines for the Evaluation and Control of Lead-Based Paint Hazards in Housing*.

APPENDIX C

Sample Location Maps

- Asbestos and Lead Sample Location Diagrams

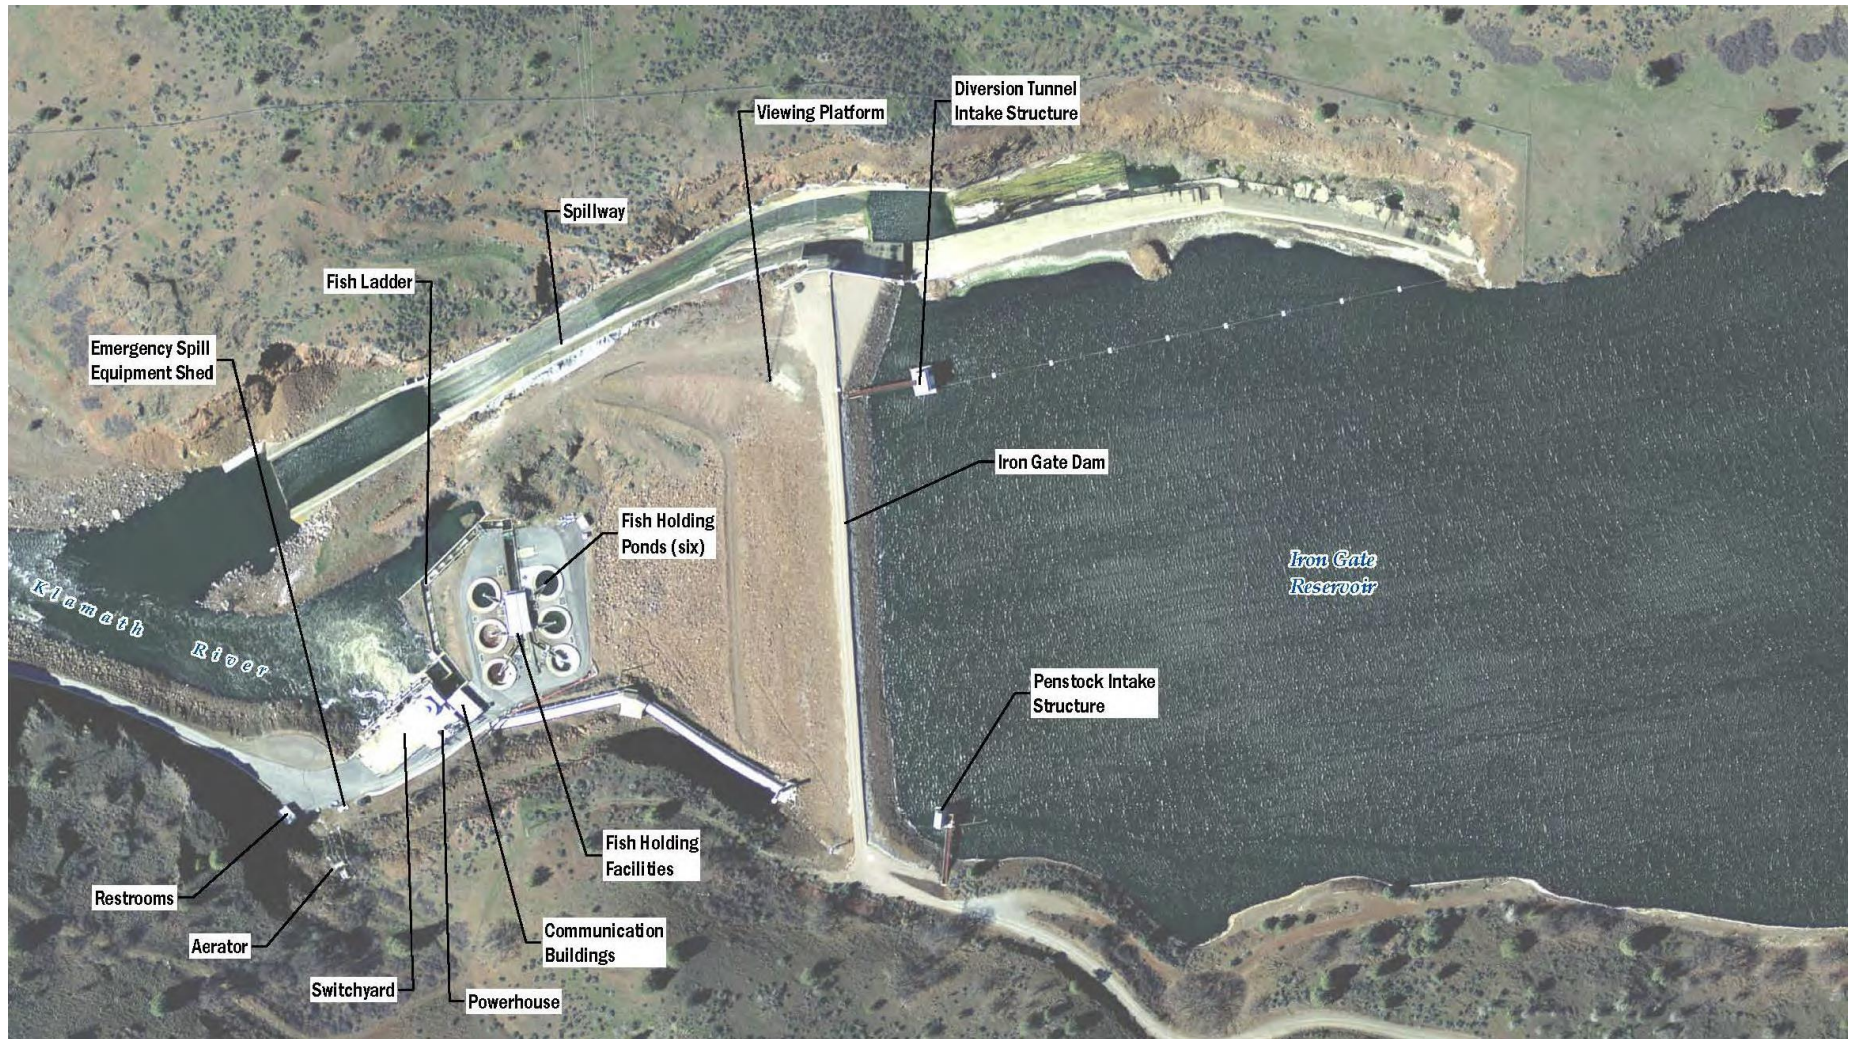

NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Site Diagram
On September 14, 2020
Project Number 20-5562



IGDSW-1-01*
IGDVP-1-01*

IGDSW-Pb1-01

NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\Iron Gate

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 14, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

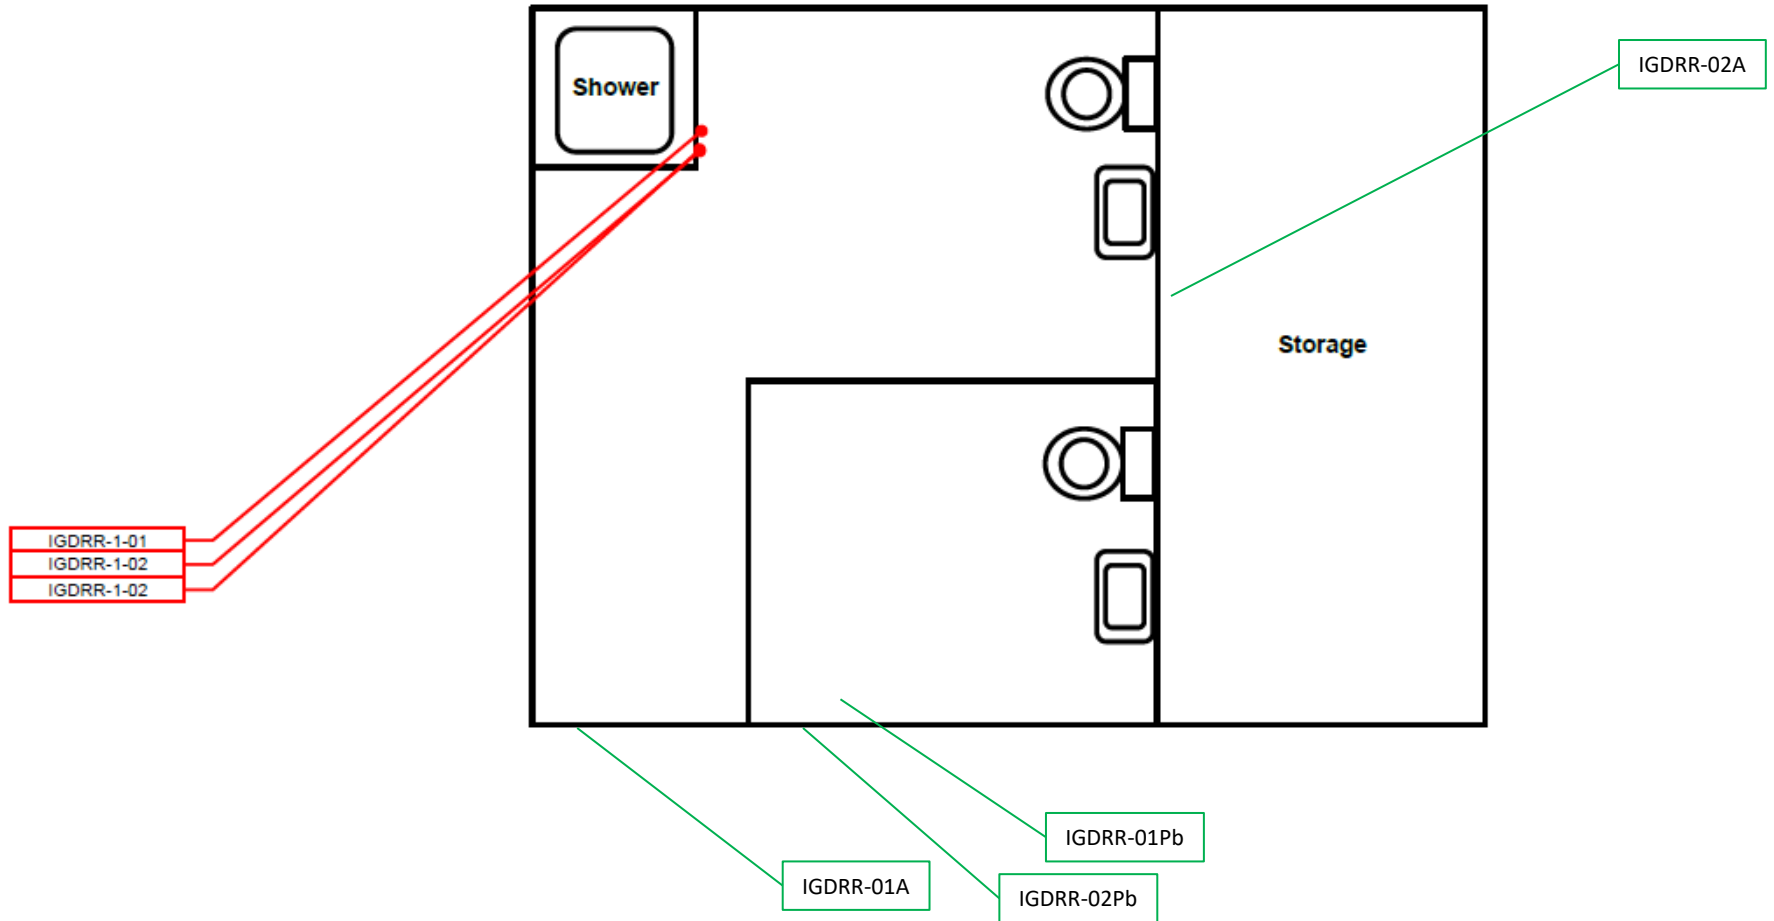

NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale


Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\Iron Gate

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 14, 2020
Project Number 20-5562

AECOM Sample Locations


Entek Sample Locations

IGDPH-4-03
IGDPH-4-02
IGDPH-4-01
IGDPH-2-02*
IGDPH-3-01
IGDPHPCB-1-01

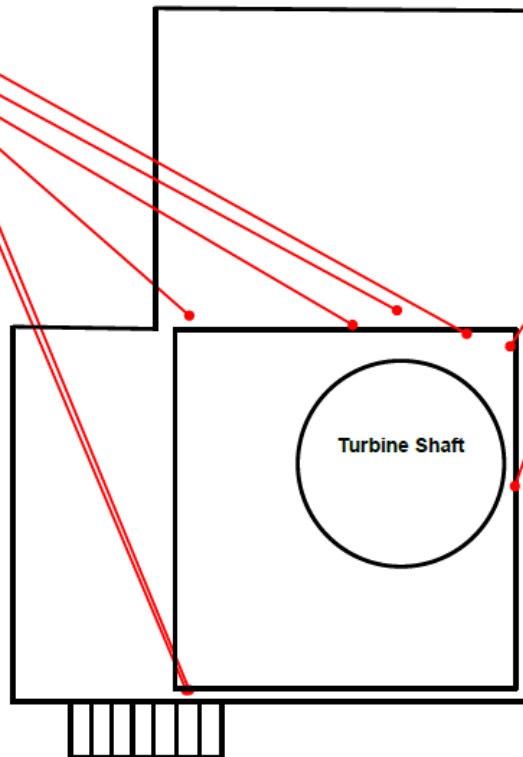

IGDPH-3-02
IGDPH-3-03

IGDPH-Pb5-01
IGDPH-Pb4-01
IGDPH-Pb3-01
IGDPH-Pb2-01
IGDPH-Pb1-01

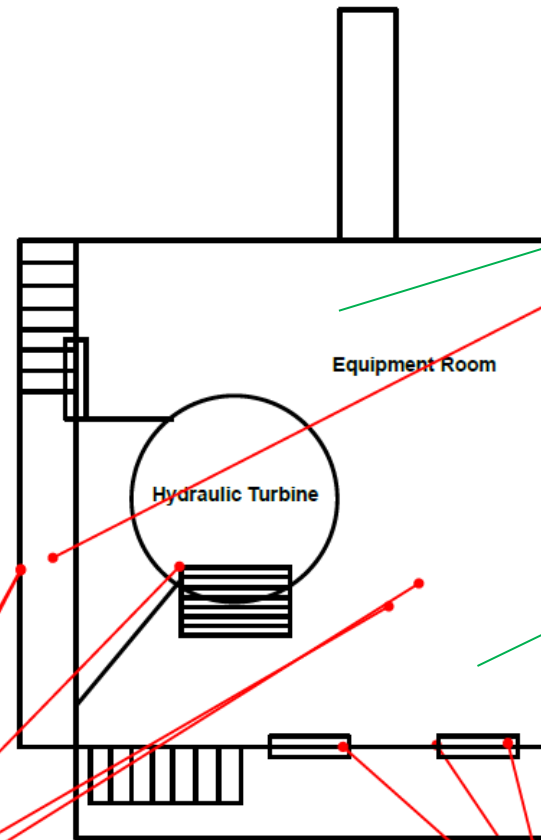

IGDPH-01A

IGDPH-2-01*

IGDPH-02A

IGDPH-1-01
IGDPH-1-02
IGDPH-1-03

NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\Iron Gate

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 14, 2020
Project Number 20-5562


AECOM Sample Locations

Entek Sample Locations

IGDFHF-1-01

IGDFHF-1-02

IGDFHF-1-03

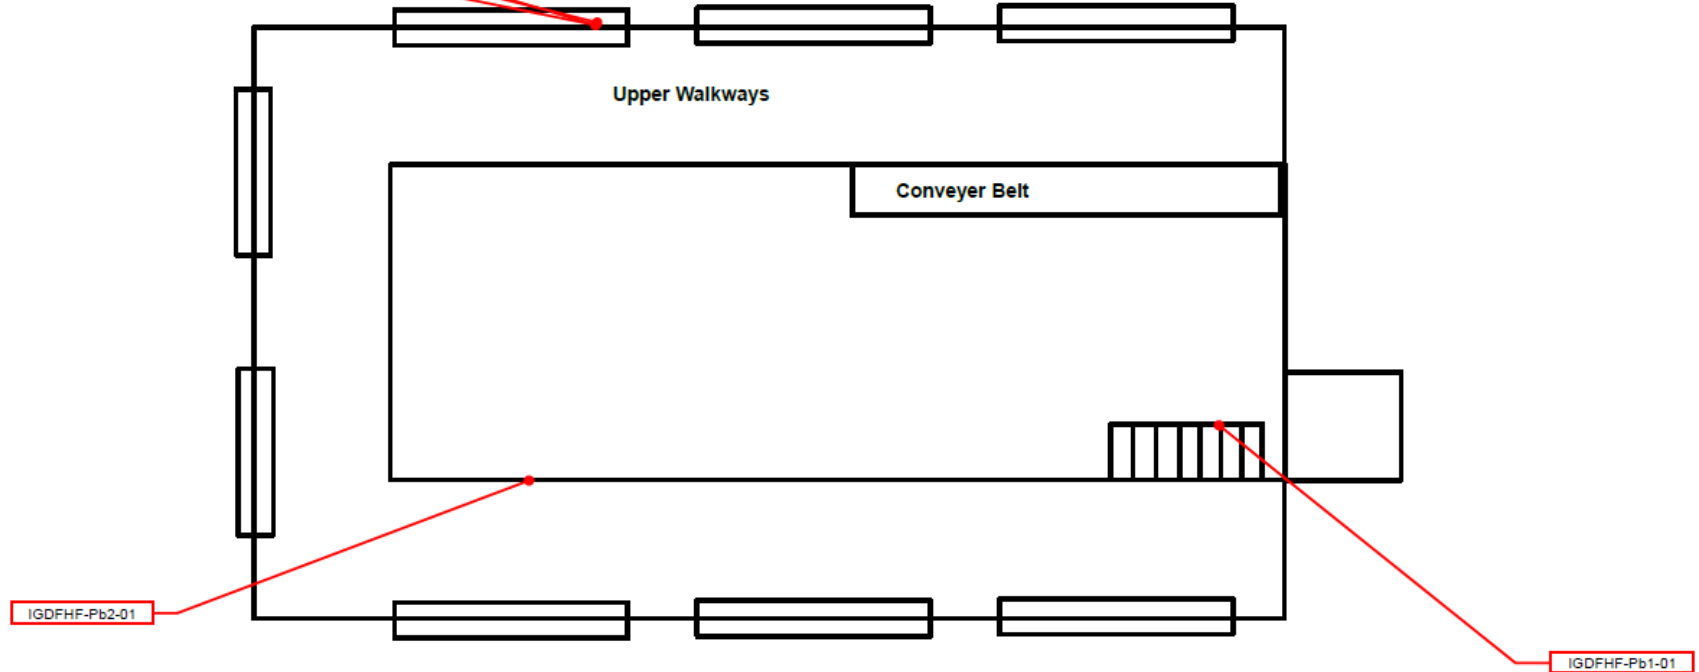


NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\Iron Gate

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 14, 2020
Project Number 20-5562

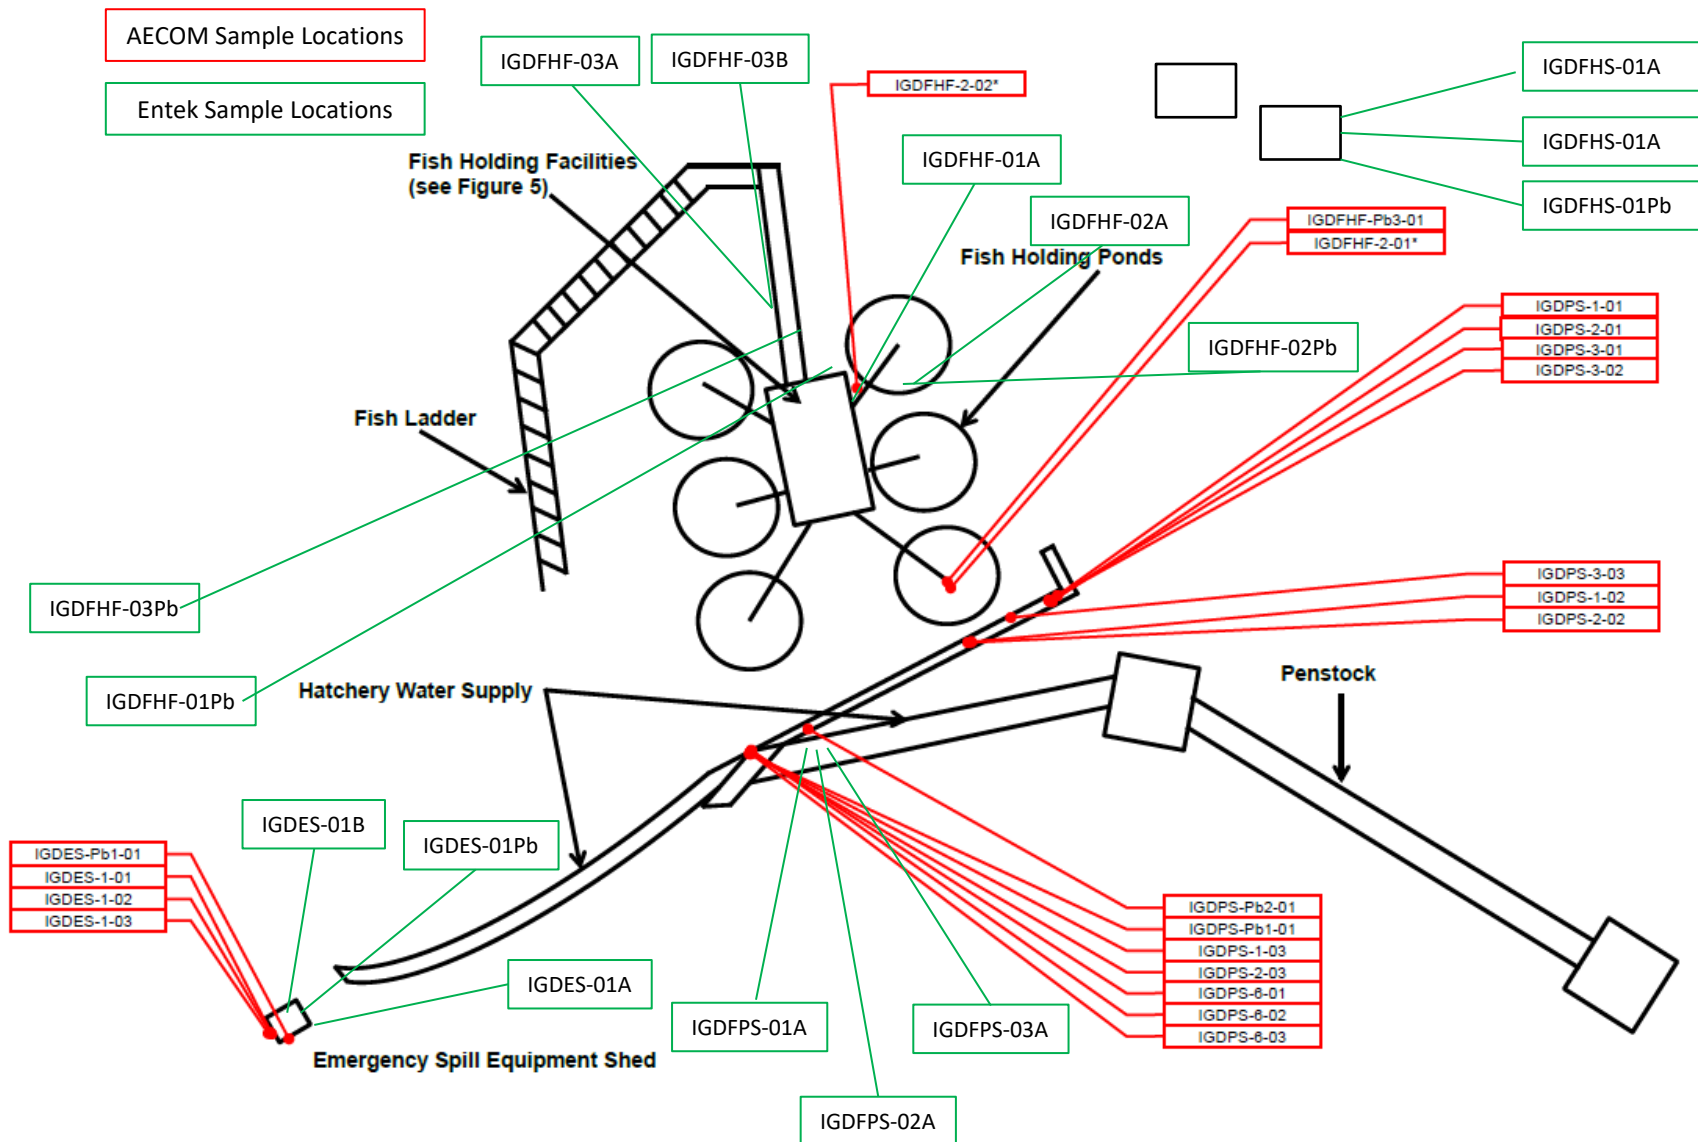


NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 14, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

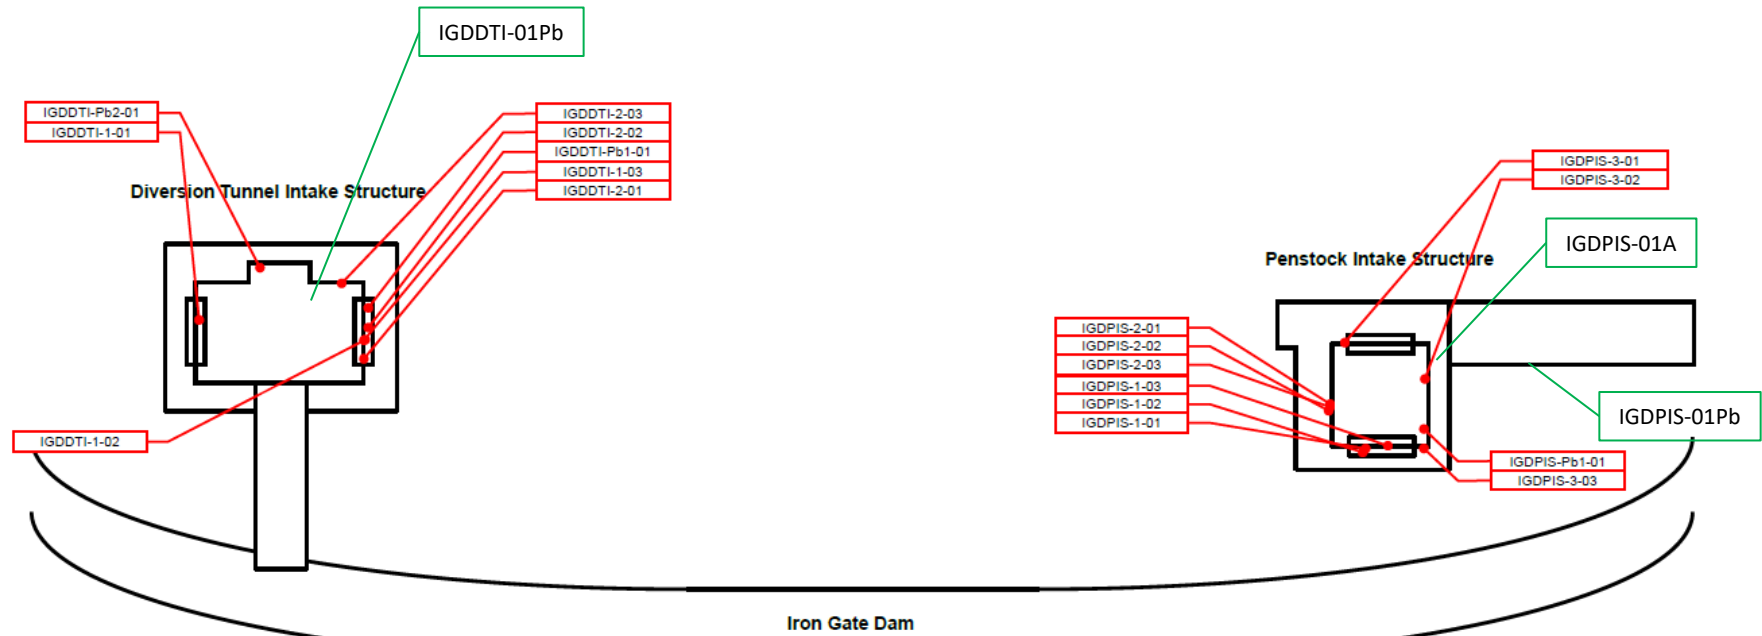

NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\Iron Gate

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 14, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations


IGDCB-01B

IGDCB-02B

IGDCB-01A

IGDCB-02A

IGDCB-2-04
IGDCB-2-03
IGDCB-1-03
IGDCB-3-03
IGDCB-3-02
IGDCB-3-01

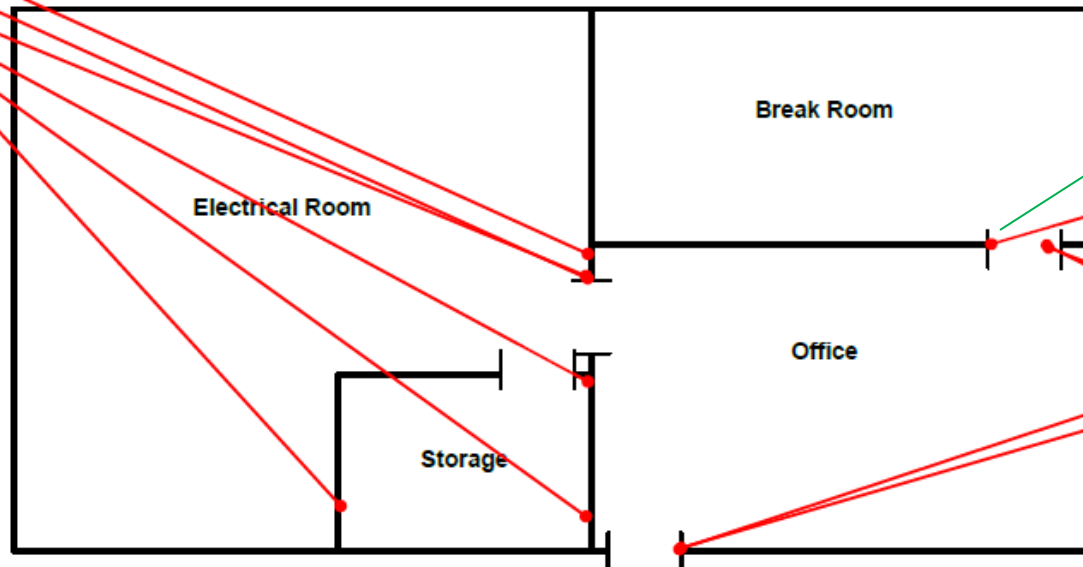

IGDCB-02Pb

NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\Iron Gate

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 14, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

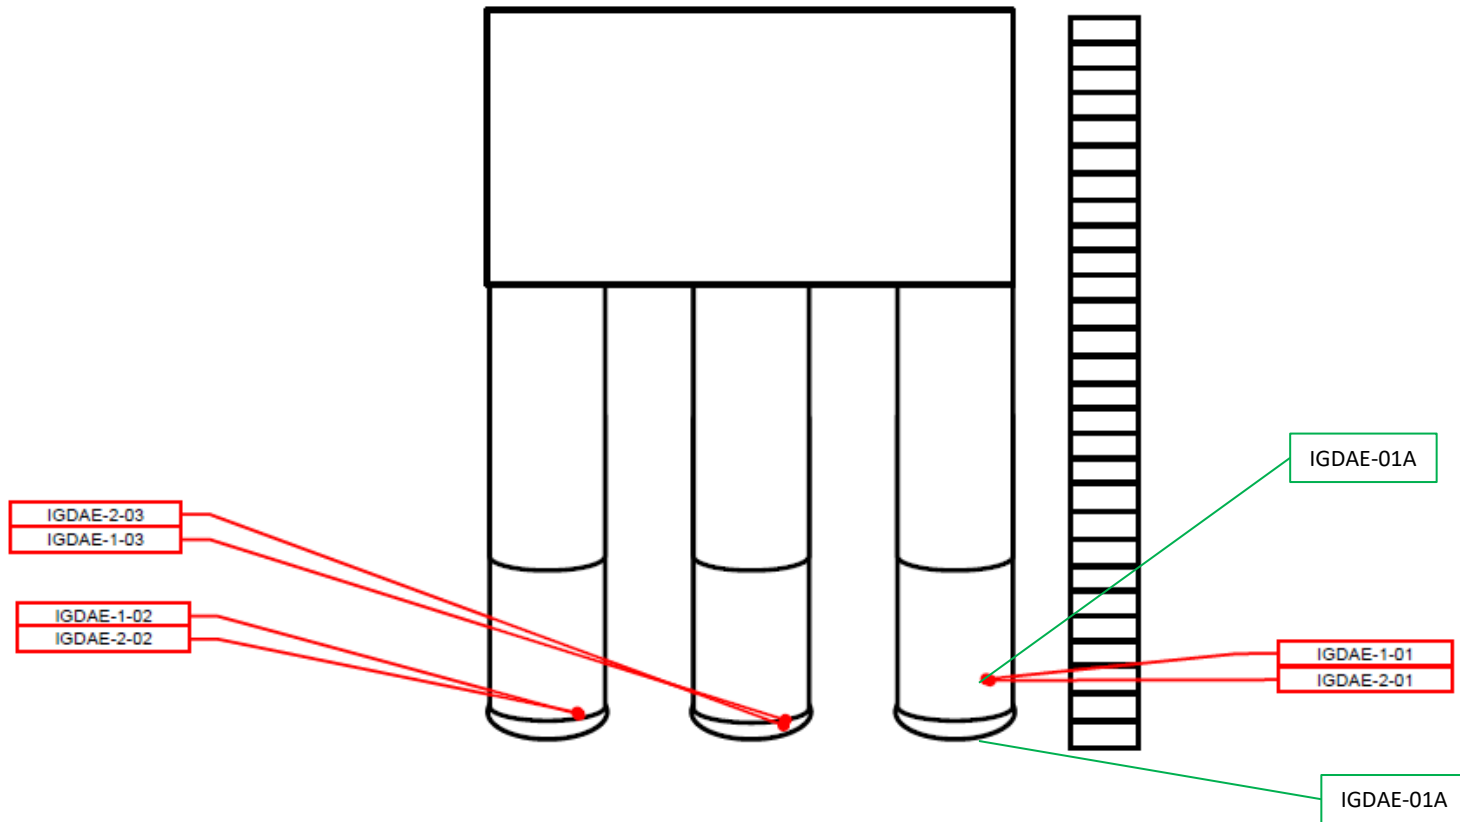

NV5
Klamath Dams
Iron Gate Dam
Hornsbrook, CA

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\Iron Gate

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 14, 2020
Project Number 20-5562



APPENDIX D

BACK UP DOCUMENTATION

- Inspector Accreditations and Certifications
- Laboratory Accreditations for Asbestos and Lead Analysis

State of California
Division of Occupational Safety and Health
Certified Asbestos Consultant

Andrew R Roed

Name



Certification No. **16-5695**

Expires on **08/17/21**

This certification was issued by the Division of Occupational Safety and Health as authorized by Sections 7180 et seq. of the Business and Professions Code.



STATE OF CALIFORNIA
DEPARTMENT OF PUBLIC HEALTH



LEAD-RELATED CONSTRUCTION CERTIFICATE

INDIVIDUAL:



Andrew Roed

CERTIFICATE TYPE:

Lead Inspector/Assessor

NUMBER:

LRC-00002989

EXPIRATION DATE:

9/11/2021

Disclaimer: This document alone should not be relied upon to confirm certification status. Compare the individual's photo and name to another valid form of government issued photo identification. Verify the individual's certification status by searching for Lead-Related Construction Professionals at www.cdph.ca.gov/programs/clppb or calling (800) 597-LEAD.

United States Department of Commerce
National Institute of Standards and Technology



Certificate of Accreditation to ISO/IEC 17025:2017

NVLAP LAB CODE: 101442-0

ASBESTECH

Carmichael, CA

*is accredited by the National Voluntary Laboratory Accreditation Program for specific services,
listed on the Scope of Accreditation, for:*

Asbestos Fiber Analysis

*This laboratory is accredited in accordance with the recognized International Standard ISO/IEC 17025:2017.
This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality
management system (refer to joint ISO-ILAC-IAF Communique dated January 2009).*

2020-07-01 through 2021-06-30

Effective Dates



A handwritten signature in dark ink, appearing to read "Dana S. Gorman".

For the National Voluntary Laboratory Accreditation Program

SCOPE OF ACCREDITATION TO ISO/IEC 17025:2017

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, CA 95608
Mr. Tommy Conlon
Phone: 916-481-8902 Fax: 916-481-3975
Email: asbestech@sbcglobal.net
<http://www.asbestechlab.com>

ASBESTOS FIBER ANALYSIS


NVLAP LAB CODE 101442-0

Bulk Asbestos Analysis

<u>Code</u>	<u>Description</u>
18/A01	EPA -- 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples
18/A03	EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials

Airborne Asbestos Analysis

<u>Code</u>	<u>Description</u>
18/A02	U.S. EPA's "Interim Transmission Electron Microscopy Analytical Methods-Mandatory and Nonmandatory-and Mandatory Section to Determine Completion of Response Actions" as found in 40 CFR, Part 763, Subpart E, Appendix A.



For the National Voluntary Laboratory Accreditation Program



STATE WATER RESOURCES CONTROL BOARD
REGIONAL WATER QUALITY CONTROL BOARDS

CALIFORNIA STATE



ENVIRONMENTAL LABORATORY ACCREDITATION PROGRAM

CERTIFICATE OF ENVIRONMENTAL ACCREDITATION

Is hereby granted to

Asbestech

6825 Fair Oaks Boulevard

Carmichael, CA 95608

Scope of the certificate is limited to the
"Fields of Testing"
which accompany this Certificate.

Continued accredited status depends on successful completion of on-site inspection,
proficiency testing studies, and payment of applicable fees.

This Certificate is granted in accordance with provisions of
Section 100825, et seq. of the Health and Safety Code.

Certificate No.: **1153**

Expiration Date: **3/31/2022**

Effective Date: **4/1/2020**

Sacramento, California
subject to forfeiture or revocation

Christine Sotelo, Chief
Environmental Laboratory Accreditation Program



**CALIFORNIA STATE
ENVIRONMENTAL LABORATORY ACCREDITATION PROGRAM
Accredited Fields of Testing**



Asbestech

6825 Fair Oaks Boulevard
Carmichael, CA 95608
Phone: 9164818902

Certificate No. 1153
Expiration Date 3/31/2022

Field of Testing: 121 - Bulk Asbestos Analysis of Hazardous Waste

121.010 001	Bulk Asbestos	EPA 600/M4-82-020
-------------	---------------	-------------------



AIHA Laboratory Accreditation Programs, LLC

acknowledges that

Eurofins EMLab P&K

17461 Derian Ave. Suite 100, Irvine, CA 92614

Laboratory ID: 178697

along with all premises from which key activities are performed, as listed above, has fulfilled the requirements of the AIHA Laboratory Accreditation Programs (AIHA-LAP), LLC accreditation to the ISO/IEC 17025:2017 international standard, *General Requirements for the Competence of Testing and Calibration Laboratories* in the following:

LABORATORY ACCREDITATION PROGRAMS

- ✓ **INDUSTRIAL HYGIENE**
- ✓ **ENVIRONMENTAL LEAD**
- ✓ **ENVIRONMENTAL MICROBIOLOGY**
- ☐ **FOOD**
- ☐ **UNIQUE SCOPES**

Accreditation Expires: September 01, 2021

Accreditation Expires: September 01, 2021

Accreditation Expires: September 01, 2021

Accreditation Expires:

Accreditation Expires:

Specific Field(s) of Testing (FoT)/Method(s) within each Accreditation Program for which the above named laboratory maintains accreditation is outlined on the attached **Scope of Accreditation**. Continued accreditation is contingent upon successful on-going compliance with ISO/IEC 17025:2017 and AIHA-LAP, LLC requirements. This certificate is not valid without the attached **Scope of Accreditation**. Please review the AIHA-LAP, LLC website (www.aihaaccreditedlabs.org) for the most current Scope.

Elizabeth Bair

Elizabeth Bair
Chairperson, Analytical Accreditation Board

Cheryl O. Morton

Cheryl O. Morton
Managing Director, AIHA Laboratory Accreditation Programs, LLC



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

Eurofins EMLab P&K

17461 Derian Ave. Suite 100, Irvine, CA 92614

Laboratory ID: **178697**

Issue Date: 08/21/2019

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

Industrial Hygiene Laboratory Accreditation Program (IHLAP)

Initial Accreditation Date: 06/01/2011

IHLAP Scope Category	Field of Testing (FoT) (FoTs cover all relevant IH matrices)	Technology sub-type/ Detector	Published Reference Method/Title of In-house Method	Method Description or Analyte <i>(for internal methods only)</i>
Asbestos/Fiber Microscopy Core	Phase Contrast Microscopy (PCM)		NIOSH 7400	

A complete listing of currently accredited Industrial Hygiene laboratories is available on the AIHA-LAP, LLC website at:
<http://www.aihaaccreditedlabs.org>



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

Eurofins EMLab P&K

17461 Derian Ave. Suite 100, Irvine, CA 92614

Laboratory ID: **178697**

Issue Date: 08/21/2019

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

Environmental Microbiology Laboratory Accreditation Program (EMLAP)

Initial Accreditation Date: 07/01/2005

EMLAP Category	Field of Testing (FoT)	Method	Method Description <i>(for internal methods only)</i>
Fungal	Air - Direct Examination	EM-MY-S-1038	Preparation and Analysis of Spore Trap (Air) Samples for Fungal Spores, Other Biological and Non-Biological Particles
	Bulk - Direct Examination	EM-MY-S-1039	Preparation and Analysis of Tape, Swab, Wipe, Bulk and Dust - Soil Samples for Qualitative Direct Microscopic Examination
	Surface - Direct Examination	EM-MY-S-1041	Preparation and Analysis of Tape, Swab, Wipe, Bulk, and Dust - Soil Samples for Quantitative Direct Microscopic Examination
Bacterial	Legionella	EM-BT-S-1045	Enumeration of Legionella. International Standard ISO 11731:2017
		EM-BT-S-1687	CDC Laboratory protocol 2016

A complete listing of currently accredited Environmental Microbiology laboratories is available on the AIHA-LAP, LLC website at: <http://www.aihaaccreditedlabs.org>



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

Eurofins EMLab P&K

17461 Derian Ave. Suite 100, Irvine, CA 92614

Laboratory ID: **178697**

Issue Date: 08/21/2019

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

The EPA recognizes the AIHA-LAP, LLC ELLAP program as meeting the requirements of the National Lead Laboratory Accreditation Program (NLLAP) established under Title X of the Residential Lead-Based Paint Hazard Reduction Act of 1992 and includes paint, soil and dust wipe analysis. Air and composited wipes analyses are not included as part of the NLLAP.

Environmental Lead Laboratory Accreditation Program (ELLAP)

Initial Accreditation Date: 03/01/2017

Field of Testing (FoT)	Technology sub-type/ Detector	Method	Method Description (for internal methods only)
Paint		EPA SW-846 7000B Modified	
		NIOSH 7082	
Settled Dust by Wipe		EPA SW-846 7000B Modified	
		NIOSH 7082	

A complete listing of currently accredited Environmental Lead laboratories is available on the AIHA-LAP, LLC website at:
<http://www.aihaaccreditedlabs.org>



APPENDIX E

HISTORICAL SURVEY DOCUMENTATION

- AECOM Technical Services, Inc. Report Dated April 2019



Klamath River Renewal Project

Iron Gate Development
Hazardous Building Materials Survey

April 2019



Prepared for:

Klamath River Renewal Corporation

Assessment Conducted by:

AECOM Technical Services, Inc.

300 Lakeside Drive, Suite 400
Oakland, California 94612

Assessment Personnel

Mr. David Simon

State of California Certified Asbestos Consultant (CAC)

Number: 92-005 (exp. 6/24/2019)

Ms. Shannon MacKay (assisted with documentation)

AHERA-Certified Building Inspector

Number: CA-015-16 (exp. 1/15/2020)

Assessment Dates

September 14, 2018 and December 19, 2018

Report Prepared by:



Shannon MacKay
Environmental Consultant

Report Reviewed by:



David Simon
State of California Certified Asbestos Consultant
(CAC)



Nicole Gladu
EHS Compliance Manager

Table of Contents

Executive Summary.....	7
Project Background:.....	7
Hazardous Building Materials Survey:	8
Objective:	8
Summarized HBMS Results:	8
1. Introduction	11
1.1 Project Description	11
1.2 Survey Limitations	11
2. Scope of Services.....	14
2.1 Asbestos Assessment.....	14
2.1.1 Methodology.....	14
2.1.2 Naturally Occurring Asbestos	15
2.2 Sampling Procedures.....	15
2.3 Sampling and Analysis.....	16
2.4 Lead Assessment.....	18
2.4.1 Sampling Methodology.....	18
2.5 Other Regulated Building Materials.....	18
2.5.1 Universal Waste Inventory Methodology.....	18
2.5.2 PCB-Containing Caulking.....	18
3. Site Description.....	20
3.1 Iron Gate Development.....	20
3.1.1 Description of Iron Gate Development Structures.....	20
4. Conclusions and Recommendations.....	25
4.1 Asbestos	25
4.1.1 Asbestos Regulations.....	26
4.2 Lead.....	28
4.3 Other Regulated Building Materials.....	28

4.4	Treated Wood	29
4.5	Tables	29

List of Figures (Appendix A)

Figure 1 Aerial Site Photo

Asbestos and Lead Sample Locations:

Figure 2 Aerator

Figure 3 Communications Building

Figure 4 Diversion Tunnel Intake Structure and Penstock Intake Structure

Figure 5 Penstock, Hatchery Water Supply, Emergency Spill Equipment Shed, and Fish Holding Ponds

Figure 6 Fish Holding Facilities

Figure 7 Powerhouse

Figure 8 Restrooms

Approximate ACM Locations:

Figure 9 Aerator, Penstock Intake Structure, Fish Holding Facilities, Maintenance Shed, Diversion Tunnel Intake Structure, and Powerhouse

List of Appendices

Appendix A Figures

Appendix B HSA Photologs

Appendix C Laboratory Analytical Results

Appendix D Personnel and Laboratory Certifications

Acronyms and Abbreviations

ACM Asbestos-Containing Material

ACCM Asbestos-Containing Construction Material; Material which contains more than 0.1% asbestos

AECOM AECOM Technical Services, Inc.

AHERA Asbestos Hazard Emergency Response Act

AST Aboveground Storage Tank

CAC California Certified Asbestos Consultant

CAB Cement Asbestos Board

CAL/OSHA California Occupational Safety and Health Administration

CC1	Copco 1 Development
CC2	Copco 2 Development
CCR	California Code of Regulations
CDPH	State of California Department of Public Health
CSST	California Certified Site Surveillance Technician
CFR	Code of Federal Regulations
DTSC	Department of Toxic Substances Control
ELAP	Environmental Laboratory Accreditation Program
HEPA	High Efficiency Particulate Air
HSA	Homogenous Sampling Area
IGD	Iron Gate Development
IGH	Iron Gate Hatchery
JCB/JC	J.C. Boyle Development
KHSA	Klamath Hydroelectric Settlement Agreement
KRRC	Klamath River Renewal Corporation
LCP	Lead-Containing Paint
mg/kg	milligrams per kilogram
NESHAP	National Emission Standards for Hazardous Air Pollutants
NOA	Naturally Occurring Asbestos
NVLAP	National Voluntary Laboratory Accreditation Program
O&M	Operations & Maintenance
PACM	Presumed Asbestos-Containing Material
PCB	Polychlorinated Biphenyl
RCRA	Resource Conservation and Recovery Act
RM	river miles
SCAPCD	Siskiyou County Air Pollution Control District
SCDPH	Siskiyou County Department of Public Health
T8	Title 8
USEPA	United States Environmental Protection Agency

A decorative banner with a wavy, undulating shape, filled with a solid blue color. It spans across the middle of the page.

Executive Summary

EXECUTIVE SUMMARY

Project Background:

AECOM Technical Services (AECOM) was retained by Klamath River Renewal Corporation (KRRC) to conduct a Hazardous Building Materials Survey (HBMS) of the Iron Gate Development. This report includes the findings of the HBMS conducted at the Iron Gate Development and associated support buildings and structures on September 14, 2018 and December 19, 2018. The Iron Gate Development is located near Hornbrook, California, and is a remote secured industrial facility owned and operated by PacifiCorp.

Iron Gate Development and original supporting structures were completed in 1962 and are located between RM 199.7 and RM 192.9, in Siskiyou County, California. The Iron Gate Development address is 8630 Copco Road, Hornbrook, California, 96044. The Iron Gate Development impounds a reservoir of 942 acres (aka Iron Gate Reservoir). Main features at the Iron Gate Development include a reservoir, embankment dam, ungated side-channel spillway, diversion tunnel, intake structures, fish holding facilities, communication building, and a powerhouse.

Four dams and associated structures including the J. C. Boyle Development, Copco No. 1 Development, Copco No. 2 Development, Iron Gate Development and the Iron Gate Fish and Fall Creek Hatcheries (the Sites) have been identified for decommissioning and removal under the 2016 Amended Klamath Hydroelectric Settlement Agreement (KHSA, 2016) following the U.S. Department of the Interior Bureau of Reclamation's Detailed Plan for Dam Removal – Klamath River Dams, Klamath Hydroelectric Project FERC License No. 2082 Oregon – California (Detailed Plan) (USBR 2012). The Iron Gate Fish Hatchery, Fall Creek Fish Hatchery, and the City of Yreka Diversion Dam have been identified for improvements under the KHSA. All four developments will be transferred to their respective states after dam decommissioning and removal.

The Sites are located on land currently owned by PacifiCorp. An HBMS was conducted at each of the seven Sites, and an HBMS report issued for the Sites as follows:

1. J.C. Boyle Development
2. Copco No. 1 Development
3. Copco No. 2 Development
4. Iron Gate Development
5. Iron Gate and Fall Creek Hatcheries
6. City of Yreka Diversion

Hazardous Building Materials Survey:

AECOM assessed Iron Gate Development and support facilities for the following hazardous building materials:

- Asbestos-containing materials (ACMs);
- Asbestos-containing construction materials (ACCMs);
- Assumed asbestos-containing materials;
- Lead-containing coatings (paints);
- Mercury-containing light tubes, switches, and thermostats;
- Polychlorinated Biphenyl (PCB)-containing caulking, putties, gaskets, and membranes;
- Suspected high-intensity discharge (HID) lamps; and
- Suspected PCB-containing fluorescent light ballasts and transformers.

Objective:

The objective of the HBMS was to provide information regarding the presence of lead-containing coatings, PCB-containing light ballasts, PCB-containing caulking, and mercury-containing sources, and the presence, location, and quantity of ACMs, ACCMs, and assumed ACMs, and for the purposes of decommissioning planning.

Summarized HBMS Results:

Sixty-two bulk samples of suspect asbestos-containing materials were collected and analyzed using Polarized Light Microscopy (PLM) during this assessment. Four materials (HSAs) were found to contain detectable asbestos above 0.1%, nine materials were assumed to contain asbestos, and no materials were visually assessed and determined to be non-suspect. Per the EPA National Emission Standard for Hazardous Air Pollutants (NESHAP) requirements and the analytical results, no sample layers were further analyzed using PLM Point Count Method.

In addition, five concrete bulk samples were collected and analyzed using PLM California Air Resources Board (CARB) 435 method to determine the content of Naturally Occurring Asbestos (NOA). No concrete samples were found to contain detectable NOA above the PLM point count threshold of 0.25%.

Fifteen paint chip samples were collected and analyzed for total lead content using Atomic Absorption Spectrophotometry; twelve of the samples were found to contain reportable levels of lead.

Mercury-containing fluorescent light tubes, HID lamps, and magnetic light ballasts labeled “No-PCBs” were observed during the assessment. In the switchyard, the yellow glass portion of the high voltage transformer bushings may contain PCBs in the oil. No suspect PCB-containing caulking was observed during the inspection.

See Section 4.5: Tables for tabulated HBMS Results.

A decorative banner with a wavy, undulating shape, filled with a solid blue color. It spans across the middle of the page.

Chapter 1: Introduction

1. INTRODUCTION

1.1 Project Description

AECOM Technical Services (AECOM) was retained by KRRC to conduct an HBMS of the Iron Gate Development and support facilities. This report includes the findings of the HBMS conducted at the Iron Gate Development and associated support buildings and structures on September 14, 2018 and December 19, 2018. The Iron Gate Development is located near Hornbrook, California, and is a remote secured industrial facility owned and operated by PacifiCorp.

1.2 Survey Limitations

The conclusions of this report are AECOM's professional opinions, based solely upon visual site observations and interpretations of laboratory analyses, as described in this report. The opinions presented herein apply to the site conditions existing at the time of AECOM's assessment and interpretation of current regulations pertaining to asbestos, lead-containing paint, PCB-containing ballasts and building materials, and mercury-containing components. Therefore, AECOM's opinions and recommendations may not apply to future conditions that may exist at the site which we have not had the opportunity to evaluate. All applicable state, federal, and local regulations should always be verified prior to any work that will disturb materials containing asbestos and other hazardous building materials.

AECOM has performed the services set forth in the Scope of Work in accordance with generally accepted industrial hygiene practices in the same or similar localities, related to the nature of the work accomplished, at the time the services were performed.

Additional sampling needs to be conducted of structures not assessed and inaccessible areas prior to demolition. Suspect regulated building materials throughout the Iron Gate Development and support facilities that are not included in this regulated building materials assessment are assumed to be asbestos-containing unless they are sampled by a Certified Asbestos Consultant (CAC) or a Certified Site Surveillance Technician (CSST) and analyzed by a State of California Environmental Laboratory Accreditation (ELAP)-licensed laboratory that is also a National Voluntary Laboratory Accreditation Program (NVLAP)-accredited laboratory to confirm the presence of asbestos prior to the disturbing such materials.

The regulated building materials and conditions presented in this report represent those observed on the dates we conducted the sampling. This sampling is intended for the exclusive use of KRRC for specific application to the proposed decommissioning. This assessment is not intended to replace construction or demolition plans, specifications, or bidding documents. This report is not meant to represent a legal opinion.

This report was prepared pursuant to an agreement between KRRC and AECOM and is for the exclusive use of KRRC. No other party is entitled to rely on the conclusions, observations, specifications, or data contained

herein without first obtaining AECOM's written consent and provided any such party signs an AECOM-generated Reliance Letter. A third party's signing of the AECOM Reliance Letter and AECOM's written consent are conditions precedent to any additional use or reliance on this report.

The passage of time may result in changes in technology, economic conditions, site variations, or regulatory provisions, which would render the report inaccurate. Reliance on this report after the date of issuance as an accurate representation of current site conditions shall be at the user's sole risk.

A decorative banner with a wavy, undulating shape, filled with a solid blue color. It spans horizontally across the middle of the page.

Chapter 2: Scope of Services

2. SCOPE OF SERVICES

2.1 Asbestos Assessment

Mr. David Simon, a California Certified Asbestos Consultant (CAC), (Certification 92-005, expiration date: 6/24/2019) performed the sampling at the Iron Gate Development and support buildings on September 14, 2018 and on December 19, 2018. Ms. Shannon MacKay, an Asbestos Hazard Emergency Response Act (AHERA)-accredited building inspector (Certification CA-015-16, expiration date: 1/15/2020), assisted in documenting the inspection, but did not perform sampling. Copies of their certifications are included in Appendix D.

The following materials/areas were inaccessible during the site work and should be assumed to contain asbestos until such time as the area becomes accessible and is sampled by a CAC or CSST and analyzed by a State of California ELAP-licensed NVLAP-accredited laboratory:

- Residence 1
- Residence 2

2.1.1 Methodology

This assessment was conducted using a modified protocol adapted from AHERA. The protocol is as follows:

- Identify suspect asbestos-containing materials.
- Group materials into homogeneous sampling areas/materials.
- Quantify each homogeneous material and collect representative samples. The number of samples collected of miscellaneous materials was determined by the inspector.
- Samples of each material were taken to the substrate, ensuring that all components and layers of the material were included.
- Sample locations are referenced on the field data forms according to sample number.
- Sampling was performed by a CAC or CSST, and the use of proper protective equipment and procedures was followed.

2.1.2 Naturally Occurring Asbestos

For informational purposes, AECOM collected samples of concrete and submitted them to EMSL Laboratories to analyze for NOA. The sampling was conducted as a preliminary screen for NOA. Sampling was conducted discretely in areas where damage to concrete was already present. Future sampling for NOA may be necessary to fulfill California State regulatory requirements for NOA, and should be conducted when more destructive sampling of the concrete is possible.

2.2 Sampling Procedures

This sampling was conducted using the following procedures:

1. Spread the plastic drop cloth (if needed) and set up other equipment, e.g., ladder.
2. Don protective equipment (respirator and protective clothing if needed).
3. Label sample container with its identification number and record number. Record sample location and type of material sampled on a sampling data form.
4. Moisten area where sample is to be extracted (spray the immediate area with water).
5. Extract sample using a clean knife, drill capsule, or cork boring tool to cut out or scrape off approximately one tablespoon of the material. Penetrate all layers of material.
6. Place sample in a container and tightly seal it.
7. Wipe the exterior of the container with a wet wipe to remove any material that may have adhered to it during sampling.
8. Clean tools with wet wipes and wet mop; or vacuum area with HEPA vacuum to clean all debris.
9. Discard protective clothing, wet wipes and rags, cartridge filters, and drop cloth in a labeled plastic waste bag.

AECOM inspected the buildings and structures for suspect ACM including thermal systems insulation, surfacing materials, and miscellaneous materials (e.g., floor tiles, ceiling tiles). When materials suspected of containing asbestos were identified, AECOM's inspectors collected representative bulk samples from each Homogeneous Sampling Area using the protocol presented in the Table 2-1:

Table 2-1 Suspect ACM Sampling Protocol

Suspect ACM Sampling Protocol		
Homogeneous Sampling Area (HSA) Category	HSA Size	Minimum Number of Samples
Surfacing Materials	1,000 SF or Less	3
	1,001-5,000 SF	5
	>5,000 SF	7 or more
Thermal System Insulation (TSI)	No Stipulation	3 of each type of TSI. (Must also sample all repair patches)
Miscellaneous Materials	No Stipulation	3 samples of each miscellaneous material

A Homogeneous Sampling Area is defined to include surfacing materials, thermal systems insulations, and miscellaneous materials, which are uniform in color, texture, construction and application date, and general appearance.

Additional suspect ACMs may be present in inaccessible or concealed spaces. These spaces include, but are not limited to, areas not assessed, areas not accessible at the time of the assessment, fire doors, electrical systems, pipe chases, spaces between wall/ceiling/door/floor cavities, interior of mechanical components, beneath foundation pads, etc. If future maintenance, renovation, and/or demolition activities make these areas accessible, AECOM recommends that a thorough assessment of these spaces be conducted at that time to identify and confirm the presence or absence of additional suspect ACMs. Until then, all such unidentified materials must be treated as assumed ACMs in accordance with applicable federal, state, and local regulations.

AECOM did not sample suspect ACM in the following circumstances:

- The AECOM inspector could not safely access the material for sampling;
- The residence was still occupied;
- The AECOM inspector concluded that the materials were inaccessible for sampling; or
- The AECOM inspector determined that destructive sampling would compromise the integrity of the material and/or the structure.

2.3 Sampling and Analysis

EPA NESHAP (40 CFR 61, Subparts A and M) also has requirements related to the assessment of suspect ACM in buildings. NESHAP defines a “friable” material to be a material that when dry, can be crumbled, pulverized, or reduced to powder with hand pressure or by the forces expected to act on the material in the course of demolition or renovation activities. AECOM applied this NESHAP definition of friable for the

purposes of determining which analytical method to use to quantify the asbestos content of a specific material.

The collected samples of suspect ACM were analyzed by NVL Laboratories, Inc. for asbestos content using the PLM visual estimation method and the PLM Point Counting Method. NVL Laboratories, Inc. is accredited for these asbestos analytical methods by the State of California ELAP and the NVLAP. Appendix D contains NVL Laboratories, Inc.'s certificate of laboratory accreditation and licensure. The collected samples of suspect NOA in concrete were analyzed by EMSL Analytical, Inc. for asbestos content using PLM CARB Method 435. EMSL Analytical, Inc. is accredited for these asbestos analytical methods by the State of California ELAP. Appendix D contains EMSL Analytical, Inc.'s certificate of laboratory accreditation and licensure.

Polarized Light Microscopy (PLM)

The PLM method is a visual estimation of the asbestos content of a sample. The PLM analysis was performed by NVL Laboratories, Inc. following the United States Environmental Protection Agency's (USEPA) PLM method EPA-600R/M4-82-020 for determining asbestos content in bulk building materials.

Polarized Light Microscopy Point Count (PLM Point Count)

According to the NESHAP, when the asbestos content of a friable material is visually estimated by the PLM visual technique to be detectable but less than 10%, the inspector may either (1) assume that the amount is greater than 0.1% and treat the material as ACCM or (2) conduct a second analysis, the PLM Point Count Method EPA/600-R93/116, to verify the percentage of asbestos in the material.

Per NESHAP, AECOM used the results of the PLM visual method analyses for friable materials to determine whether additional laboratory analysis was warranted (i.e., PLM Point Count), or whether the material would be treated as ACCM. Based on PLM analytical results, no samples were further analyzed by PLM Point Count analysis (See Appendix C).

If the results obtained by PLM Point Count Method and the PLM visual estimation method are different, the PLM Point Count result is used. When no asbestos is detected by the first PLM visual method, the additional technique using PLM Point Count Method is not required. The analytical results are reported in percent asbestos as derived from a 1000 point counting technique, which yields a detection limit of 0.1%.

Naturally Occurring Asbestos (NOA)

Asbestos fibers may be released from serpentine rock formations. The CARB 435 method is used to determine the asbestos content of serpentine aggregate, or NOA, in concrete, storage piles, on conveyor belts, and on surfaces such as road beds, road shoulders, and parking lots. Samples are crushed using a mill to produce a material of which the majority is less than 200 Tyler mesh (0.75 microns). CARB defines NOA as having >0.25% asbestos by PLM point counting. The analytical results are reported in percent asbestos as derived from a 400 PLM point counting technique, which yields a detection limit of 0.25%.

2.4 Lead Assessment

2.4.1 Sampling Methodology

Homogeneous painted surfaces were defined by substrate, application, and color. The paint chip samples were collected to the substrate to ensure that all layers present on the substrate were included in the laboratory analysis. The samples were collected and stored in a heavy-duty, self-sealing plastic bag and delivered to NVL Laboratories in Seattle, Washington. The samples were analyzed via Atomic Absorption Spectrophotometry in accordance with Method EPA 7000B. NVL Laboratories in Seattle, Washington is accredited by American Industrial Hygiene Association (AIHA) for lead analysis and by the California Environmental Laboratory Accreditation Program (ELAP).

Lead paint chip samples were collected from industrial and operational buildings or from former residences that will no longer be occupied; all structures assessed are planned for decommissioning.

2.5 Other Regulated Building Materials

2.5.1 Universal Waste Inventory Methodology

An inventory of fluorescent light tubes, HID lamps, mercury-containing sources, and potential PCB-containing ballasts was conducted in accessible Project Areas.

Where fluorescent light fixtures were accessible, the ballast covers were removed, and the ballast labels were visually examined. Where fluorescent light fixtures could not be visually examined, the number of potential PCB-containing ballasts in each fixture was estimated based on the following assumptions:

- Each single light tube fluorescent fixture contains one ballast;
- Each HID lamp contains one ballast and one mercury bulb;
- Each multiple light tube fluorescent fixture contains one ballast for every pair of light tubes; and
- All light ballasts are assumed to contain PCBs unless the ballasts are labeled as not containing PCBs or are determined to be electronic.

Fluorescent light tubes, HID lamps, fluorescent light fixtures and PCB-containing transformers were identified in the buildings in the quantities listed in Table 4-4.

2.5.2 PCB-Containing Caulking

No suspect PCB-caulking was observed during the inspection.

A decorative banner with a wavy, ribbon-like shape. It features a dark blue base color and a lighter blue upper section separated by a white wavy line. The banner curves upwards from left to right.

Chapter 3: Site Description

3. SITE DESCRIPTION

3.1 Iron Gate Development

AECOM Technical Services (AECOM) was retained by Klamath River Renewal Corporation (KRRC) to conduct a Hazardous Building Materials Survey (HBMS) of the Iron Gate Development. This report includes the findings of the HBMS conducted at the Iron Gate Development and associated support buildings and structures on September 14, 2018 and December 19, 2018. The Iron Gate Development is located near Hornbrook, California, and is a remote secured industrial facility owned and operated by PacifiCorp.

Iron Gate Development and original supporting structures were completed in 1962 and are located between RM 199.7 and RM 192.9, in Siskiyou County, California. The Iron Gate Development address is 8630 Copco Road, Hornbrook, California 96044. The Iron Gate Development impounds a reservoir of 942 acres (aka Iron Gate Reservoir). Main features at the Iron Gate Development include a reservoir, embankment dam, ungated side-channel spillway, diversion tunnel, intake structures, fish holding facilities, communication building, and a powerhouse.

3.1.1 Description of Iron Gate Development Structures

The following Iron Gate Development support structures were assessed during the HBMS:

Aerator (IGDAE)

The Aerator piping is approximately 4' to 6' in diameter and provides aeration for the Iron Gate Development Fish Hatchery water supply. The Aerator structure is located south of the Iron Gate Development Powerhouse. The piping extends approximately 50 feet up a hillside. A metal caged ladder follows the piping up the hill. The piping is wrapped with deteriorating asphaltic pipe wrapping.

Communications Building (IGDCB)

The Communications Building is adjacent and to the north of the Powerhouse, is approximately 800 square feet, and is a single story slab on grade pre-fabricated building. The exterior siding and roof consists of pre-fabricated steel. The interior of the building consists of a front office, an electrical room, and a break room. Walls and ceilings consist of gypsum wallboard or are unfinished steel. Flooring consists of vinyl floor sheeting or unfinished concrete.

Diversion Tunnel Intake Structure (IGDDTI)

The Diversion Tunnel Intake Structure is located on pilings that extend into the Iron Gate Reservoir. The building is located on the northeast end of the reservoir and is approximately 390 square feet. The exterior

siding and roofing consist of steel with a rubber membrane cover throughout. The interior consists of unfinished steel walls and ceiling and the floor consists of metal grating.

Emergency Spill Equipment Shed (IGDES)

The Emergency Spill Equipment Shed is approximately 100 square feet, and is a single story slab on grade shed, with engineered wood siding and asphaltic shingle roofing. The interior of the shed is unfinished wood. The structure is currently being used as storage for emergency spill purposes.

Fish Holding Facilities and Ponds (IGDFHF)

The Fish Holding Facilities and Ponds main building is approximately 1,250 square feet and is a pre-fabricated concrete floor building located between the Powerhouse and the dam. The main building is in the center of six concrete lined fish holding ponds. The exterior siding and roofing of the building consists of pre-fabricated steel. The interior consists of a ground floor, and a second floor that wraps around the perimeter of the interior. Interior finishes are painted or unfinished steel and concrete.

Fish Ladder (IGDFL)

The Fish Ladder is located east of the Powerhouse. It consists of concrete steps that extend to the Fish Holding Facilities and Ponds from the river.

Iron Gate Dam (IGD)

The Iron Gate Dam is a zoned earth fill embankment with a height of 189 feet from the rock foundation to the dam crest. The dam crest is 20 feet wide and approximately 740 feet long. The embankment includes a central impervious clay core, with filter zones and a downstream drain.

Maintenance Shed (IGDMS)

The Maintenance Shed is approximately 2,000 square feet, wooden framed, and is constructed on a slab-on-grade concrete foundation. It is located on the north side of the Klamath River approximately 1,000 feet south the dam. It is an open sided structure and is used for the storage of boats, recreational trailer and other items from the nearby residences.

Penstock Intake Structure (IGDPIS)

The Penstock Intake Structure is located on pilings that extend into the Iron Gate Reservoir. The building is located on the southeast end of the reservoir and is approximately 120 square feet. The exterior siding and roofing consist of pre-fabricated steel throughout. The interior consists of unfinished steel walls and ceiling and the floor consists of metal grating.

Penstocks and Hatchery Water Supply (IGDPS)

The Penstocks and Hatchery Water Supply are connected with the Aerator piping. The Penstocks are north of the Powerhouse and extend up the Iron Gate Development. The hatchery water supply extends past the Powerhouse and turns towards the Fish Holding Facilities.

Powerhouse (IGDPH)

The Powerhouse is approximately 3,000 square feet. The facility is located at the downstream toe of the dam on the east bank of the river. The powerhouse has three levels; above ground, first lower level, and second lower level.

The above ground level contains the upper portions of a single vertical-shaft, Francis-type turbine contained in its own concrete vault.

The first lower level contains the middle portion of the turbine housed in concrete vault, electrical panels, a 500 gallon oil governor accumulation tank, air compressors, oil, water and air piping, labeled hazardous materials and other miscellaneous storage cabinets.

The second lower level contains the lowest portion of the turbine housed in steel vault, piping, and sump pumps.

Residence 1 (IGDR1)

Residence 1 is approximately 2,000 square feet. The exterior of the building consists of engineered wood siding and corrugated metal roofing. No suspect asbestos-containing materials were observed on the exterior of the building. The building was occupied during the HBMS and the interior was not accessed.

Residence 2 (IGDR2)

Residence 2 is approximately 2,000 square feet. The exterior of the building consists of engineered wood siding and corrugated metal roofing. No suspect asbestos-containing materials were observed on the exterior of the building. The building was occupied during the HBMS and the interior was not accessed.

Restrooms (IGDRR)

The Restrooms building is approximately 400 square feet. The exterior siding and roof of the building consist of pre-fabricated steel. The interior of the building has two restrooms, a storage room, and consists of unfinished steel and concrete.

Switchyard (IGDSW)

The Switchyard is approximately 5,000 square feet and is located adjacent to the powerhouse. The switchyard contains an electrical transformer, substations, transmission poles and lines within a fenced

gravel area. The majority of the transmission pole footings, substations and the transformer were on top of cement pads or gravel filled cement catch basins. The “yellow glass portion” of the high voltage transformer bushings may contain PCBs in the oil. The small pole mounted transformers were noted to contain no-PCB labels. No observable impacts, odors or distressed vegetation were noted.

Viewing Platform (IGDVP)

The Viewing Platform is located on the top of the Iron Gate Dam, and overlooks the powerhouse and fish holding facilities.

A decorative banner with a wavy, undulating shape, filled with a solid blue color. It spans across the middle of the page.

Chapter 4: Conclusion and Recommendations

4. CONCLUSIONS AND RECOMMENDATIONS

On September 14, 2018 and December 19, 2018, AECOM conducted a Hazardous Building Materials Survey of the Iron Gate Development located in Hornbrook, California. AECOM assessed the site buildings for a variety of regulated building materials that would require removal or special handling during decommissioning and demolition. Section 4.5: Tables includes the tabulated results of the survey. The following are AECOM's general recommendations related to the HBMS findings:

- Plans and specifications should be developed by an appropriately qualified professional (e.g., CAC) to outline the planned scope of work, phasing, training and certification requirements, policies and procedures for the proper handling, removal packaging, disposal/recycling, and transportation of the materials.
- The findings of this report should be communicated to contractors planning to work on or bid on work at the site,
- Additional material-specific recommendations as listed below.

4.1 Asbestos

Sixty-two bulk samples of suspect asbestos-containing materials were collected and analyzed using PLM during this assessment. Four materials (HSAs) were found to contain detectable asbestos above 0.1%, nine materials were assumed to contain asbestos, and no materials were visually assessed and determined to be non-suspect. Per the EPA NESHAP requirements and the analytical results, no sample layers were further analyzed using PLM Point Count Method.

In addition, five concrete bulk samples were collected and analyzed using PLM CARB 435 method to determine the content of NOA. No concrete samples were found to contain detectable NOA above the PLM point count threshold of 0.25%.

The results of the analyses are presented in Section 4.5, Tables 4-1 and 4-2. Appendix C contains the laboratory reports of analytical results for each discrete sample.

Additional suspect ACMs may be present in inaccessible or concealed spaces. These spaces include, but are not limited to; below grade exterior materials, electrical systems, pipe chases, spaces between wall/ceiling/door/floor cavities, interior of mechanical components, beneath foundation pads, etc. If future demolition activities make these areas accessible, AECOM recommends that a thorough assessment of these spaces be conducted at that time to identify and confirm the presence or absence of additional ACMs

and ACCMs. Until then, all such unidentified materials must be treated as assumed ACMs in accordance with applicable federal, state, and local regulations.

If the analytical results indicate that all the samples collected per HSA do not contain asbestos, then the HSA (material) is considered a non-ACM. If the analytical results of one or more of the samples collected per HSA indicate that asbestos is present in quantities of greater than 0.1% asbestos as defined by Cal/OSHA, all of the HSA (material) is considered to be an ACM or ACCM regardless of any other analytical results.

Any material that contains greater than 0.1% asbestos is considered an ACCM and must be handled according to Cal/OSHA regulations. Any material greater than one percent asbestos is considered an ACM and must be handled according to EPA regulations, and applicable state and local regulations. The EPA NESHAP regulations (40 CFR 61, Subparts A and M) have a requirement related to assessment of suspect ACM in buildings. When the asbestos content of a friable material is visually estimated by PLM to be detectable but less than ten percent, your firm may elect to (1) assume the amount is greater than one percent and treat the material as asbestos-containing or (2) require verification of the amount by the PLM point counting technique. If the results obtained by point counting and visual estimation are different, the point count result must be used. When no asbestos is detected by PLM, point counting is not required.

4.1.1 Asbestos Regulations

Asbestos-related work must be performed in compliance with local, federal, and state regulations including Cal/OSHA, the Siskiyou County Air Pollution Control District, EPA NESHAP, and relevant federal, state and local regulations pertaining to handling of asbestos.

The EPA NESHAP regulations (Renovation and Demolition NESHAP 40 CFR 61, Subparts A and M) for asbestos apply to certain demolition and renovation projects in facilities containing ACM and/or assumed ACM. The NESHAP rule usually requires that all friable ACM and some categories of non-friable ACM be removed before a building is demolished, and may require localized removal prior to demolition. The following NESHAP definitions of ACM are very important in interpreting which NESHAP requirements may apply to your building:

- Friable asbestos-containing material: any material containing more than 1 percent asbestos that when dry, can be crumbled, pulverized, or reduced to powder by hand pressure.
- Category I non-friable asbestos-containing material: asbestos-containing packings, gaskets, resilient floor covering, and asphalt roofing products containing more than 1 percent asbestos that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.
- Category II non-friable asbestos-containing material: any material excluding Category I non-friable ACM, containing more than 1 percent asbestos that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.
- Regulated asbestos-containing material (RACM): (1) friable ACM, (2) Category I non-friable ACM that has become friable (3) Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading, or (4) Category II non-friable ACM that has a high probability of

becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the materials in the course of demolition or renovation operations regulated by NESHAP.

NESHAP also requires that the local air district be notified before certain renovations or demolition impacting RACM begin. When ACCM is removed or disturbed during demolition or renovation, the Cal/OSHA regulations also apply. The NESHAP regulations should be studied in detail for a thorough delineation of these and other requirements.

Cal/OSHA regulates employee exposure to asbestos (T8, CCR 1529). The Cal/OSHA asbestos standards mandate a permissible exposure limit (PEL) of 0.1 fibers (equal to or longer than 5 micrometers) per cubic centimeter of air (fibers/cc) determined as an 8-hour, time-weighted average (TWA) and an excursion limit of 1 fiber/cc as a 30-minute TWA.

Also, for asbestos removal or renovation involving ACM, the Cal/OSHA Asbestos Construction Standard (T8, CCR 1529) requires that specific procedures be followed, including enclosure of the work area to control asbestos exposure of building occupants, as well as, employees involved in abatement or renovation activities.

The following are selected Cal/OSHA definitions regarding asbestos work:

- **Class I asbestos work** means activities involving the removal of TSI and surfacing ACM and PACM.
- **Class II asbestos work** means activities involving the removal of ACM which is not thermal system insulation or surfacing material. This includes, but is not limited to, the removal of asbestos-containing wallboard, floor tile and sheeting, roofing and siding shingles, and construction mastics.
- **Class III asbestos work** means repair and maintenance operations, where "ACM", including TSI and surfacing ACM and PACM, is likely to be disturbed.
- **Class IV asbestos work** means maintenance and custodial activities during which employees contact but do not disturb ACM or PACM and activities to clean up dust, waste and debris resulting from Class I, II, and III activities.
- **Intact** means that the ACM has not crumbled, been pulverized, or otherwise deteriorated so that asbestos is no longer likely to be bound with its matrix.

AECOM identified materials that were assumed to contain asbestos, but were not assessed because the inspector determined them to be ACM, for the safety of the inspector and to preserve building system integrity.

During demolition activities, inaccessible materials may be uncovered which were not identified or sampled during this assessment. Personnel in charge of demolition should be alerted to note materials uncovered during these activities which were not identified in this report. The following are AECOM's recommendations:

- If the buildings are scheduled for abatement and demolition (AECOM's recommendation), an abatement project design manual should be prepared with technical specifications and abatement plans. The design must be prepared by a CAC.

- The results of this sampling should be communicated to any Contractors working in the Project Areas and a copy of the assessment report must be on-site during demolition activities.
- Abatement work must be performed by CA-licensed asbestos abatement contractor with trained asbestos workers and supervisors.
- Any concealed building materials discovered during demolition activities, which are suspected to contain asbestos, should be sampled by a CSST or CAC and analyzed by a NVLAP- and CA ELAP-accredited laboratory to confirm the presence of asbestos prior to disturbing such materials or be assumed to be ACM.
- If the facilities assessed during the HBMS are not scheduled for demolition, AECOM recommends the development of an O&M Plan by a CAC.

4.2 Lead

Fifteen paint chip samples were collected and analyzed for total lead content; twelve of the paint chip samples were found to contain detectable levels of lead. The results of the analyses are presented in Section 4.5 Table 4-3. Appendix C contains the laboratory reports of analytical results for each discrete sample.

Cal/OSHA requires worker training, worker protection, and exposure assessments be conducted during operations that may disturb the lead-containing paint in such a way that the airborne exposure may reach or exceed the Action Level of 30 micrograms per cubic meter ($\mu\text{g}/\text{m}^3$) or the Permissible Exposure Limit of 50 $\mu\text{g}/\text{cm}^3$. The worker protection requirements of Cal/OSHA 1532.1 "Lead" apply.

4.3 Other Regulated Building Materials

Mercury-containing fluorescent light tubes and HID lamps were observed during the assessment. In the switchyard, the yellow glass portion of the high voltage transformer bushings may contain PCBs in the oil. No suspect PCB-containing caulking was observed during the inspection.

Fluorescent light tubes, switches, and thermostats may contain mercury. Fluorescent light ballasts, transformer oil, and HID lamp ballasts may contain PCBs. PCB wastes are regulated by Department of Toxic Substance Control Act (DTSC) Title 22 CCR 66261.24, Resource Conservation Recovery Act (RCRA) Title 40 CFR 761, and Toxic Substance Control Act (TSCA) 15 USC 2695. DTSC has classified PCBs as a hazardous waste when the concentrations are equal to or greater than 5 mg/l in liquids or when the total concentrations are equal to or greater than 50 mg/kg in non-liquids (Title 22, CCR, 66261.24). If the PCB waste is greater than 50 mg/l, then it is also to be managed under the RCRA and TSCA requirements. Employers must inform their employees of mercury and PCB hazards in accordance with Cal/OSHA.

Light ballasts in representative locations were visually assessed where possible. All light ballasts observed during the course of the HBMS were electronic ballasts or magnetic ballasts labeled "No PCBs". In the switchyard, the yellow glass portion of the high voltage transformer bushings may contain PCBs in the oil.

During the course of decommissioning or demolition activities, magnetic light ballasts may be discovered that are not labeled “No PCBs” and should be disposed of per DTSC requirements.

Fluorescent light tubes must be removed and recycled or disposed of as hazardous waste or universal waste prior to demolition as per 22 CFR 66261.50 and 66273.8.

The results of the Universal Waste Inventory are presented in Section 4.5 Table 4-5.

4.4 Treated Wood

Wood treated with creosote was observed in the following locations:

- Power poles throughout Iron Gate Development

4.5 Tables

Table 4-1: Confirmed ACMs, ACCMs, and Assumed ACMs lists the HSAs (materials) that were tested and confirmed to contain greater than 0.1 percent asbestos as well as the HSAs that could not be tested and are assumed to contain asbestos. NESHAP categories and approximate quantities of each material are identified, when possible.

Table 4-2: Asbestos Sample Results by Layer lists the tabulated analytical results for each discrete asbestos sample, listed by building then by HSA. Confirmed ACMs, ACCMs and Non-ACMs are included.

Table 4-3: Lead Paint Sample Results lists the tabulated analytical results for each discrete lead paint sample.

Table 4-4: Universal Waste Inventory presents the tabulated approximate quantities of fluorescent light tubes, suspect PCB containing light ballasts, non-PCB containing magnetic light ballasts, HID Lamps, and PCB-containing transformers.

Table 4-5: PCB-Caulking Sample Results lists the tabulated analytical results for each PCB caulking sample.

Appendix A contains figures of structures, sampling locations, and asbestos-containing material locations.

Appendix B contains HSA Photologs, by building, then by HSA.

Appendix C contains the laboratory reports of analytical results for each discrete sample.

Appendix D contains personnel and laboratory certifications.

Table 4-1 Confirmed ACMs, ACCMs, and Assumed ACMs

Table 1: Confirmed ACMs, ACCMs, and Assumed ACMs								
Building	HSA#	HSA Description	Material Location	AHERA Class	Friability	NESHAP Category	Summarized Results	Quantity
Aerator	IGDAE-03	Assumed asbestos-containing red gaskets	Aerator piping, hatchery water supply	Misc.	–	–	Assumed	2 EA
Diversion Tunnel Intake Structure	IGDDTI-01	Gray window putty	Interior window panes	Misc.	NF	Cat II	Positive	2 EA (4'x5')
Fish Holding Facilities	IGDFHF-01	Gray brittle window putty	Patch sealant on one window only	Misc.	NF	Cat II	Positive	4 LF
Maintenance Shed	IGDMS-01	Assumed asbestos-containing silver woven electrical wire insulation	Throughout Maintenance Shed	Misc.	NF	Cat II	Assumed	Not quantified
Maintenance Shed	IGDMS-02	Assumed asbestos-containing electrical panel backing in older electrical panels	Interior of Maintenance Shed	Misc.	NF	Cat II	Assumed	~4 EA
Maintenance Shed	IGDMS-03	Assumed asbestos-containing roofing paper	Throughout Maintenance Shed roof, underneath corrugated metal roofing	Misc.	NF	Cat II	Assumed	~2,100 SF
Penstock	IGDPS-04	Assumed asbestos-containing red gaskets	Hatchery water supply piping	Misc.	NF	Cat II	Assumed	Not quantified**
Penstock	IGDPS-05	Assumed asbestos-containing black gaskets	Hatchery water supply piping	Misc.	NF	Cat II	Assumed	Not quantified**
Penstock Intake Structure	IGDPIS-01	White brittle window putty	Interior window panes	Misc.	NF	Cat II	Positive	2 EA (4'x5')
Powerhouse	IGDPH-01	Gray brittle window putty	Interior/exterior windows	Misc.	NF	Cat II	Positive	4 EA (4'x4')
Powerhouse	IGDPH-05	Assumed asbestos-containing wicket gate	Associated with turbines on main level of Powerhouse, inaccessible unless turbines are removed	Misc.	–	–	Assumed	3 EA
Powerhouse	IGDPH-06	Assumed asbestos-containing metal-clad fire door insulation	Powerhouse main level	Misc.	NF	Cat II	Assumed	2 EA

NF: Non-Friable; HSA: material that is uniform in color, texture, general appearance, and construction and application date, Misc.: Miscellaneous material per AHERA, SF: Square Feet, EA: Each; LF: Linear Feet; Cat II: Category II per NESHAPS; Materials that were unable to be sampled (typically because of inaccessibility or sampling would be too destructive while facilities were still operational) are assumed to be asbestos-containing. *Not quantified because of unknown extent of material not accessible at time of inspection; as-built drawings needed for approximate quantification.

Table 1: Confirmed ACMs, ACCMs, and Assumed ACMs								
Building	HSA#	HSA Description	Material Location	AHERA Class	Friability	NESHAP Category	Summarized Results	Quantity
Throughout Iron Gate Development	-	Assumed asbestos-containing buried Transite piping	A small portion of unburied Transite piping was observed at the Copco 2 development. Due to the proximity of Iron Gate to Copco 2, it is reasonable to assume that buried Transite piping also exists throughout the Iron Gate Development	Misc.	NF	Cat II	Assumed	Not quantified*

NF: Non-Friable; HSA: material that is uniform in color, texture, general appearance, and construction and application date, Misc.: Miscellaneous material per AHERA, SF: Square Feet, EA: Each; LF: Linear Feet; Cat II: Category II per NESHAPS; Materials that were unable to be sampled (typically because of inaccessibility or sampling would be too destructive while facilities were still operational) are assumed to be asbestos-containing. *Not quantified because of unknown extent of material not accessible at time of inspection; as-built drawings needed for approximate quantification.

Table 4-2 Asbestos Sample Results by Layer

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Aerator	IGDAE-1-01	1	Black asphaltic pipe wrap	Aerator piping, hatchery water supply	Misc.		None Detected
Aerator	IGDAE-1-02	1	Black asphaltic pipe wrap	Aerator piping, hatchery water supply	Misc.		None Detected
Aerator	IGDAE-1-03	1	Black asphaltic pipe wrap	Aerator piping, hatchery water supply	Misc.		None Detected
Aerator	IGDAE-2-01	1	Thick silver coating	Aerator piping, hatchery water supply	Misc.		None Detected
Aerator		2	Black asphaltic pipe wrap (HSA IGDAI-01)	Aerator piping, hatchery water supply	Misc.		None Detected
Aerator	IGDAE-2-02	1	Thick silver coating	Aerator piping, hatchery water supply	Misc.		None Detected
Aerator		2	Black asphaltic pipe wrap (HSA IGDAI-01)	Aerator piping, hatchery water supply	Misc.		None Detected
Aerator	IGDAE-2-03	1	Thick silver coating	Aerator piping, hatchery water supply	Misc.		None Detected
Aerator		2	Black asphaltic pipe wrap (HSA IGDAI-01)	Aerator piping, hatchery water supply	Misc.		None Detected
Communications Building	IGDCB-1-01	1	Gray vinyl floor sheeting with terrazzo pattern	Flooring in office area	Misc.		None Detected
Communications Building		2	Gray paper backing with mastic	Flooring in office area	Misc.		None Detected
Communications Building		3	Tan mastic	Flooring in office area	Misc.		None Detected
Communications Building	IGDCB-1-02	1	Gray vinyl floor sheeting with terrazzo pattern	Flooring in office area	Misc.		None Detected
Communications Building		2	Gray paper backing with mastic	Flooring in office area	Misc.		None Detected
Communications Building		3	Tan mastic	Flooring in office area	Misc.		None Detected
Communications Building	IGDCB-1-03	1	Gray vinyl floor sheeting with terrazzo pattern	Flooring in office area	Misc.		None Detected

HSA: Material that is uniform in color, texture, general appearance, and construction and application date, Surf.: Surfacing material per AHERA, TSI: Thermal system insulation per AHERA, Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Communications Building		2	Gray paper backing with mastic	Flooring in office area	Misc.		None Detected
Communications Building	IGDCB-1-04	1	Gray vinyl floor sheeting with terrazzo pattern	Flooring in office area	Misc.		None Detected
Communications Building		2	Gray paper backing with mastic	Flooring in office area	Misc.		None Detected
Communications Building	IGDCB-2-01	1	4" gray rubber cove base	Walls in office area	Misc.		None Detected
Communications Building	IGDCB-2-02	1	4" gray rubber cove base	Walls in office area	Misc.		None Detected
Communications Building		2	White mastic	Walls in office area	Misc.		None Detected
Communications Building	IGDCB-2-03	1	4" gray rubber cove base	Walls in office area	Misc.		None Detected
Communications Building		2	White mastic	Walls in office area	Misc.		None Detected
Communications Building	IGDCB-2-04	1	4" gray rubber cove base	Walls in office area	Misc.		None Detected
Communications Building		2	White mastic	Walls in office area	Misc.		None Detected
Communications Building	IGDCB-3-01	1	White joint compound	Walls in storage room only	Misc.		None Detected
Communications Building		2	White joint compound with paper	Walls in storage room only	Misc.		None Detected
Communications Building		3	Peach gypsum wallboard with paper	Walls in storage room only	Misc.		None Detected
Communications Building	IGDCB-3-02	1	White joint compound	Walls in storage room only	Misc.		None Detected
Communications Building		2	White joint compound with paper	Walls in storage room only	Misc.		None Detected
Communications Building		3	Peach gypsum wallboard with paper	Walls in storage room only	Misc.		None Detected

HSA: Material that is uniform in color, texture, general appearance, and construction and application date, Surf.: Surfacing material per AHERA, TSI: Thermal system insulation per AHERA, Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Communications Building	IGDCB-3-03	1	White joint compound with paper	Walls in storage room only	Misc.		None Detected
Communications Building		2	White gypsum wallboard with paper	Walls in storage room only	Misc.		None Detected
Communications Building		3	White joint compound with paper	Walls in storage room only	Misc.		None Detected
Communications Building		4	Peach gypsum wallboard with paper	Walls in storage room only	Misc.		None Detected
Diversion Tunnel Intake Structure	IGDDTI-1-01	1	Gray window putty	Interior window panes	Misc.	5%	Chrysotile
Diversion Tunnel Intake Structure	IGDDTI-1-02	1	Gray window putty	Interior window panes	Misc.	6%	Chrysotile
Diversion Tunnel Intake Structure	IGDDTI-1-03	1	Silver paint	Interior window panes	Misc.		None Detected
Diversion Tunnel Intake Structure		2	Gray window putty	Interior window panes	Misc.	6%	Chrysotile
Diversion Tunnel Intake Structure	IGDDTI-2-01	1	Beige exterior window caulking	Exterior window frames	Misc.		None Detected
Diversion Tunnel Intake Structure	IGDDTI-2-02	1	Beige exterior window caulking	Exterior window frames	Misc.		None Detected
Diversion Tunnel Intake Structure	IGDDTI-2-03	1	Beige exterior window caulking	Exterior window frames	Misc.		None Detected
Diversion Tunnel Intake Structure	IGDES-1-01	1	Asphaltic roofing shingles with granules	Roofing throughout shed	Misc.		None Detected
Diversion Tunnel Intake Structure	IGDES-1-02	1	Asphaltic roofing shingles with granules	Roofing throughout shed	Misc.		None Detected
Diversion Tunnel Intake Structure	IGDES-1-03	1	Asphaltic roofing shingles with granules	Roofing throughout shed	Misc.		None Detected
Fish Holding Facilities	IGDFHF-1-01	1	Gray brittle window putty	Patch sealant on one window only	Misc.	4%	Chrysotile
Fish Holding Facilities	IGDFHF-1-02	1	Gray brittle window putty	Patch sealant on one window only	Misc.	6%	Chrysotile

HSA: Material that is uniform in color, texture, general appearance, and construction and application date, Surf.: Surfacing material per AHERA, TSI: Thermal system insulation per AHERA, Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Fish Holding Facilities	IGDFHF-1-03	1	Gray brittle window putty	Patch sealant on one window only	Misc.	4%	Chrysotile
Penstock	IGDPS-1-01	1	Black asphaltic pipe wrap	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-1-02	1	Black asphaltic pipe wrap	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-1-03	1	Black asphaltic pipe wrap	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-2-01	1	Thick silver coating	Hatchery water supply piping	Misc.		None Detected
Penstock		2	Black asphaltic pipe wrap (HSA 01)	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-2-02	1	Thick silver coating	Hatchery water supply piping	Misc.		None Detected
Penstock		2	Black asphaltic pipe wrap (HSA 01)	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-2-03	1	Thick silver coating	Hatchery water supply piping	Misc.		None Detected
Penstock		2	Black asphaltic pipe wrap (HSA 01)	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-3-01	1	Brown fibrous gasket at pipe line saddles	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-3-02	1	Brown fibrous gasket at pipe line saddles	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-3-03	1	Brown fibrous gasket at pipe line saddles	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-6-01	1	Tar coating on fish hatchery water supply	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-6-02	1	Tar coating on fish hatchery water supply	Hatchery water supply piping	Misc.		None Detected
Penstock	IGDPS-6-03	1	Tar coating on fish hatchery water supply	Hatchery water supply piping	Misc.		None Detected
Penstock Intake Structure	IGDPIS-1-01	1	White brittle window putty	Interior window panes	Misc.	5%	Chrysotile

HSA: Material that is uniform in color, texture, general appearance, and construction and application date, Surf.: Surfacing material per AHERA, TSI: Thermal system insulation per AHERA, Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 2: Asbestos Sample Results by Layer							
Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Penstock Intake Structure	IGDPIS-1-02	1	White brittle window putty	Interior window panes	Misc.	4%	Chrysotile
Penstock Intake Structure	IGDPIS-1-03	1	White brittle window putty	Interior window panes	Misc.	4%	Chrysotile
Penstock Intake Structure	IGDPIS-2-01	1	White caulking at base of doorway	Doorway to interior	Misc.		None Detected
Penstock Intake Structure		2	Gray brittle material	Doorway to interior	Misc.		None Detected
Penstock Intake Structure	IGDPIS-2-02	1	White caulking at base of doorway	Doorway to interior	Misc.		None Detected
Penstock Intake Structure	IGDPIS-2-03	1	White caulking at base of doorway	Doorway to interior	Misc.		None Detected
Penstock Intake Structure	IGDPIS-3-01	1	White caulking	Exterior metal siding seams	Misc.		None Detected
Penstock Intake Structure	IGDPIS-3-02	1	Beige soft material with paint	Exterior metal siding seams	Misc.		None Detected
Penstock Intake Structure		2	White caulking	Exterior metal siding seams	Misc.		None Detected
Penstock Intake Structure	IGDPIS-3-03	1	Beige soft material with paint	Exterior metal siding seams	Misc.		None Detected
Powerhouse	IGDPH-1-01	1	Gray brittle window putty	Interior/exterior windows	Misc.	4%	Chrysotile
Powerhouse	IGDPH-1-02	1	Gray brittle window putty	Interior/exterior windows	Misc.	5%	Chrysotile
Powerhouse	IGDPH-1-03	1	Gray brittle window putty	Interior/exterior windows	Misc.	4%	Chrysotile
Powerhouse	IGDPH-3-01	1	Gray expansion joint caulking	Exterior seams, roof of Powerhouse (concrete pad)	Misc.		None Detected
Powerhouse	IGDPH-3-02	1	Gray expansion joint caulking	Exterior seams, roof of Powerhouse (concrete pad)	Misc.		None Detected
Powerhouse	IGDPH-3-03	1	Gray expansion joint caulking	Exterior seams, roof of Powerhouse (concrete pad)	Misc.		None Detected
Powerhouse	IGDPH-4-01	1	Brown epoxy coating	Roof of Powerhouse (concrete pad)	Misc.		None Detected

HSA: Material that is uniform in color, texture, general appearance, and construction and application date, Surf.: Surfacing material per AHERA, TSI: Thermal system insulation per AHERA, Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 2: Asbestos Sample Results by Layer							
Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Powerhouse	IGDPH-4-02	1	Brown epoxy coating	Roof of Powerhouse (concrete pad)	Misc.		None Detected
Powerhouse	IGDPH-4-03	1	Brown epoxy coating	Roof of Powerhouse (concrete pad)	Misc.		None Detected
Restroom	IGDRR-1-01	1	White brittle terrazzo	Shower base interior of restroom	Misc.		None Detected
Restroom	IGDRR-1-02	1	White brittle terrazzo	Shower base interior of restroom	Misc.		None Detected
Restroom	IGDRR-1-03	1	White brittle terrazzo	Shower base interior of restroom	Misc.		None Detected

HSA: Material that is uniform in color, texture, general appearance, and construction and application date, Surf.: Surfacing material per AHERA, TSI: Thermal system insulation per AHERA, Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 4-3 Lead Paint Sample Results

Table 4: Lead Paint Sample Results					
Building	Sample ID	Description	Substrate	Location	Results in (mg/kg)
Diversion Tunnel Intake	IGDDTI-Pb1-01	Tan paint	Metal	Exterior metal window frames	470
Diversion Tunnel Intake	IGDDTI-Pb2-01	Grayish/silver paint	Metal	Interior metal walls	1,500
Emergency Spill Equipment Shed	IGDES-Pb1-01	Light gray paint	Wood	Throughout exterior metal siding on walls	<140
Fish Hold Facilities	IDGFHF-Pb1-01	Grayish/silver paint	Metal	On metal handrails and equipment throughout interior	500
Fish Hold Facilities	IDGFHF-Pb2-01	White paint	Concrete	Throughout concrete walls on lower level of interior	<50
Fish Hold Facilities	IDGFHF-Pb3-01	Silver paint	Metal	Center mechanical unit in center of fish holding ponds	110,000
Penstock	IGDPS-Pb1-01	Pink paint	Metal	6' penstock piping	65,000
Penstock	IGDPS-Pb2-01	Red paint	Metal	6' penstock piping	60
Penstock Intake Structure	IGDPIS-Pb1-01	Tan paint	Metal	Exterior metal siding and equipment	140
Powerhouse	IGDPH-Pb1-01	Orange paint	Metal	Interior metal handrails and guardrails throughout	83,000
Powerhouse	IGDPH-Pb2-01	Gray paint	Concrete	Interior floor and equipment blocks	980
Powerhouse	IGDPH-Pb3-01	Tan paint	Concrete	Walls in turbine room	7,200
Powerhouse	IGDPH-Pb4-01	Off-white/silver paint	Steel	Exterior stop log gates	860
Powerhouse	IGDPH-Pb5-01	Orange paint	Steel	Exterior stop log supports	150,000
Spillway	IGDSW-Pb1-01	Tan paint	Metal	Spillway leaf gates and handrails	<110

<: Below the reporting limit

Table 4-4 Universal Waste Inventory


Table 5: Universal Waste Inventory	
Other Regulated Building Materials Description	Approximate Quantity
Mercury-containing fluorescent light tubes (4' length)	20
Mercury-containing fluorescent light tubes (8' length)	10
Magnetic light ballasts	10
HID lamps	6
Mercury-containing switches, controls, and recorders	None observed
PCB-Containing Transformer Oil	Associated with yellow glass portion of the transformer bushings in the switchyard

Table 4-5 PCB-Caulking Sample Results

Table 6: PCB Caulking Results		
Sample Number and Description	Material Location	Samples Results in Parts Per Million (ppm)
Flexible gray expansion joint sealant	Top of Powerhouse – at expansion joints	ND

ND: None Detected

APPENDIX A FIGURES

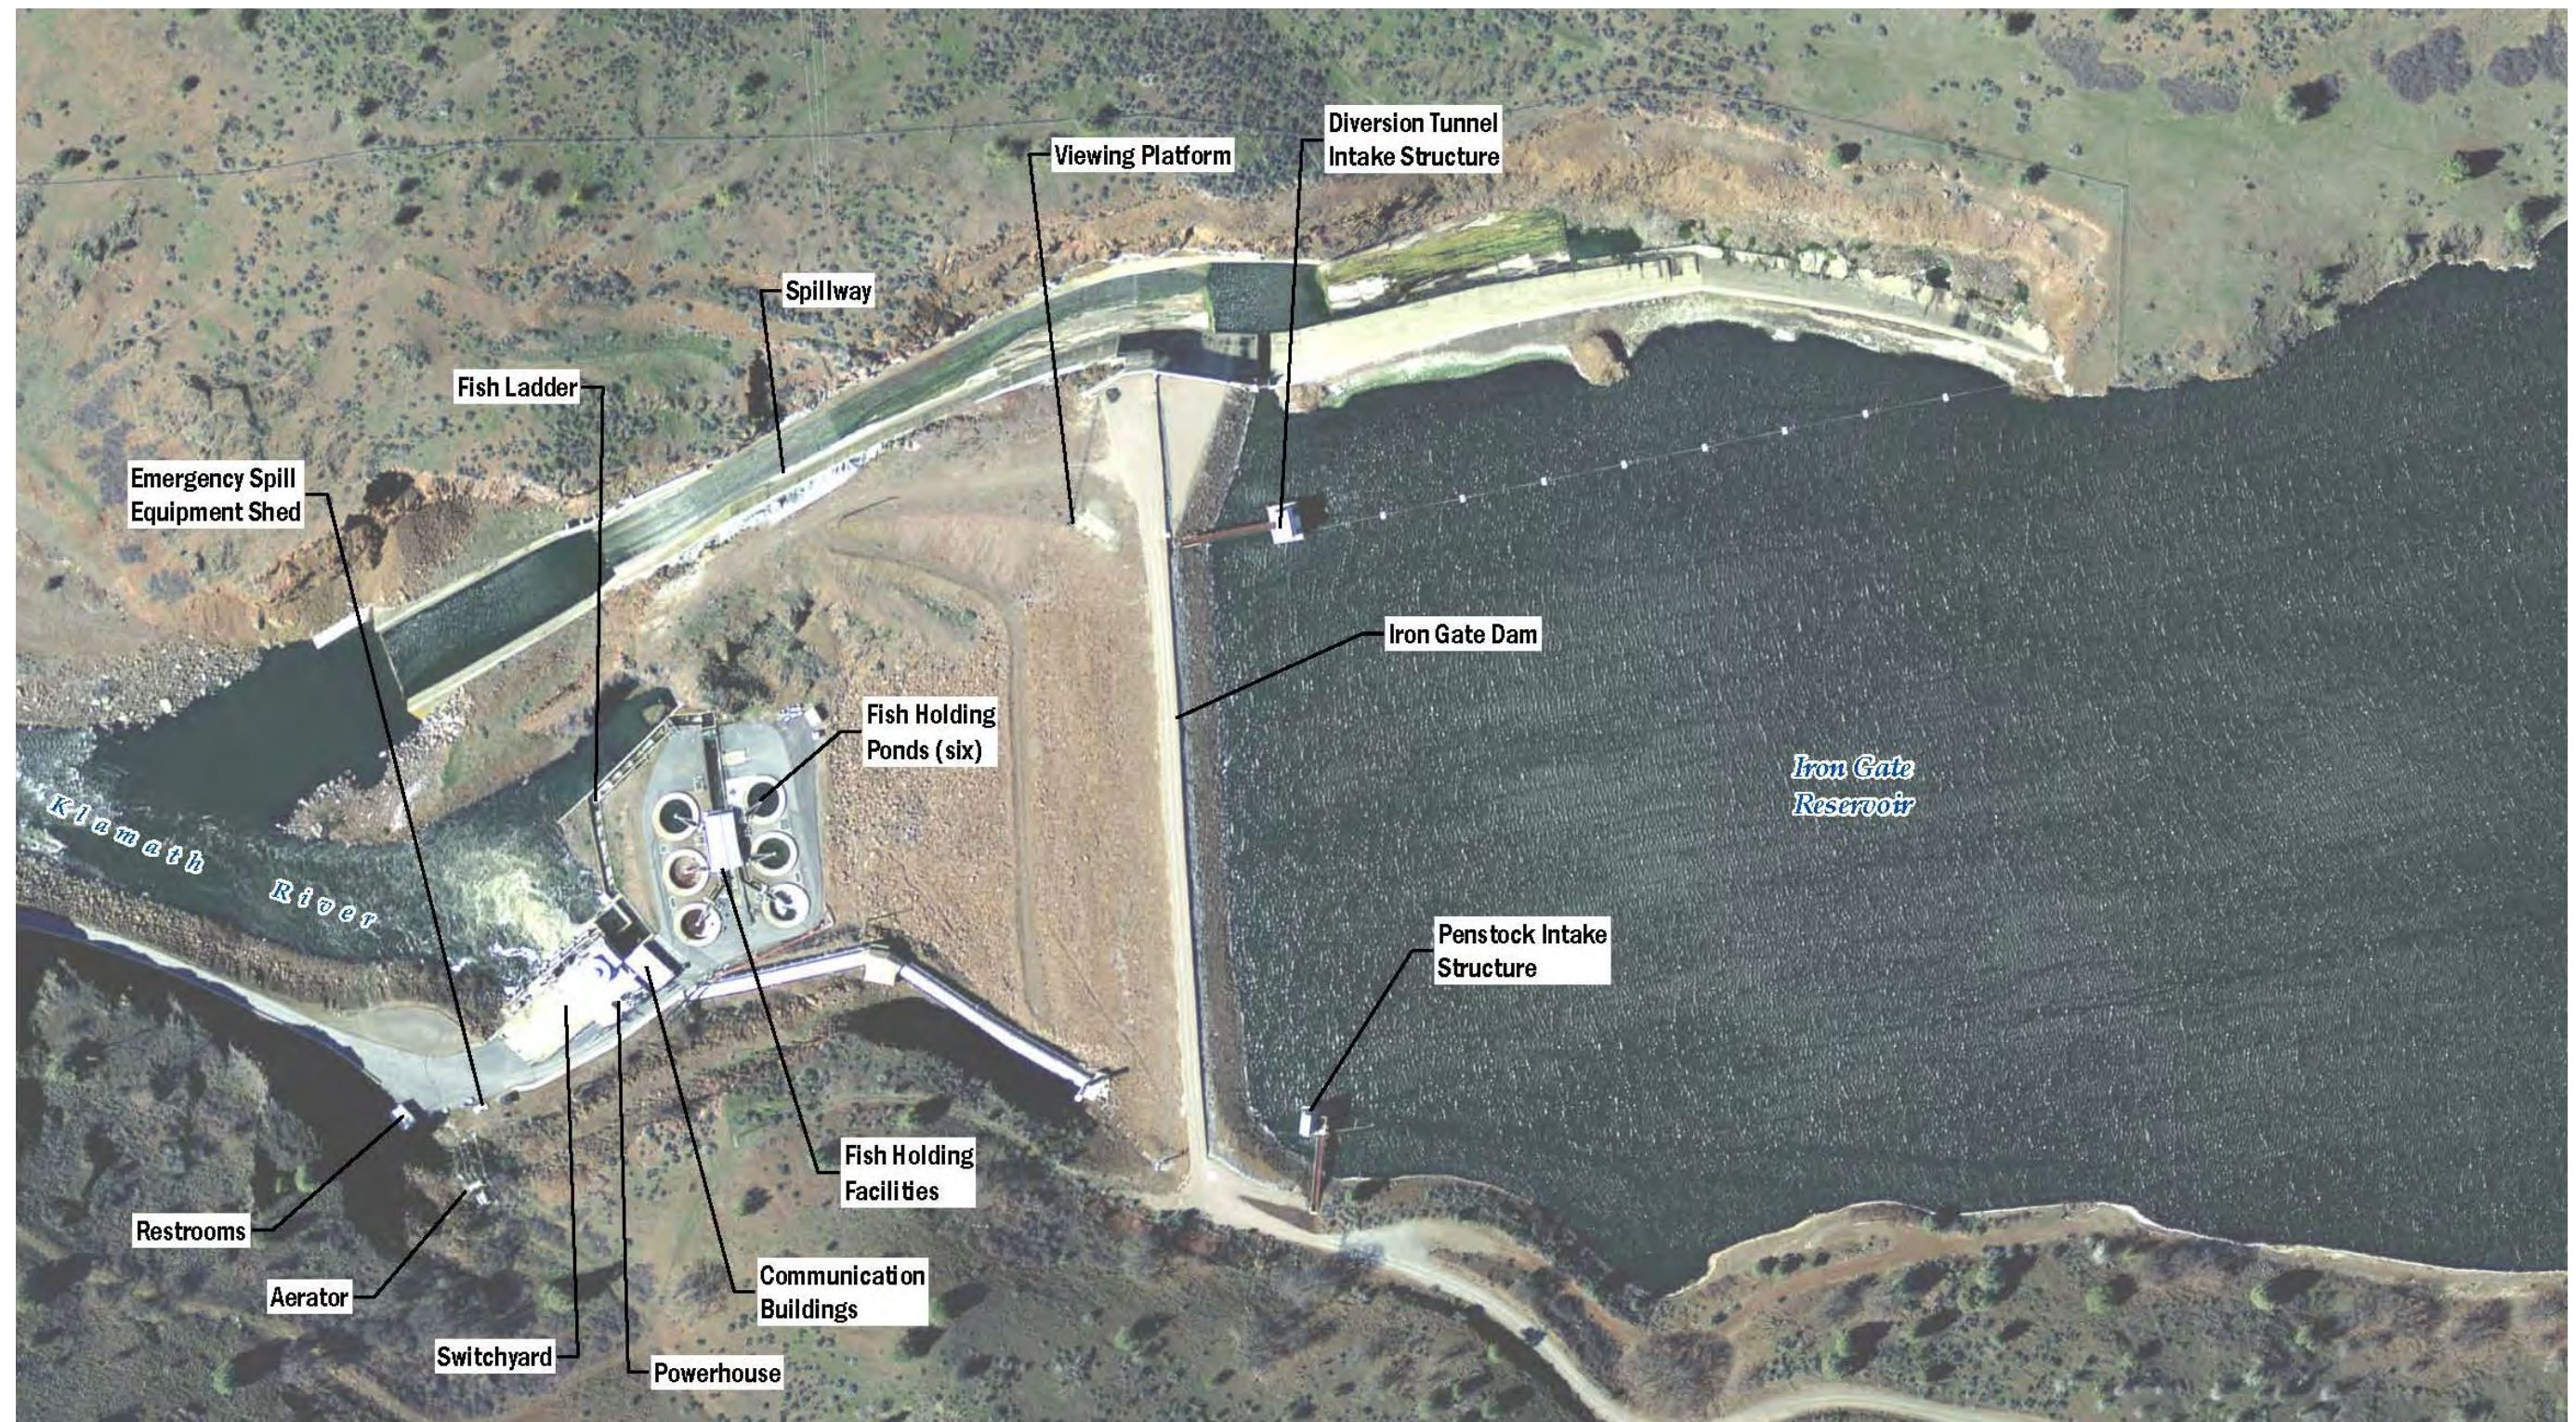


Job No. 60537920

AECOM


Figure 1
Aerial Site Photo
Iron Gate Dam

Copco No. 1 Dam
Hornsbrook, CA

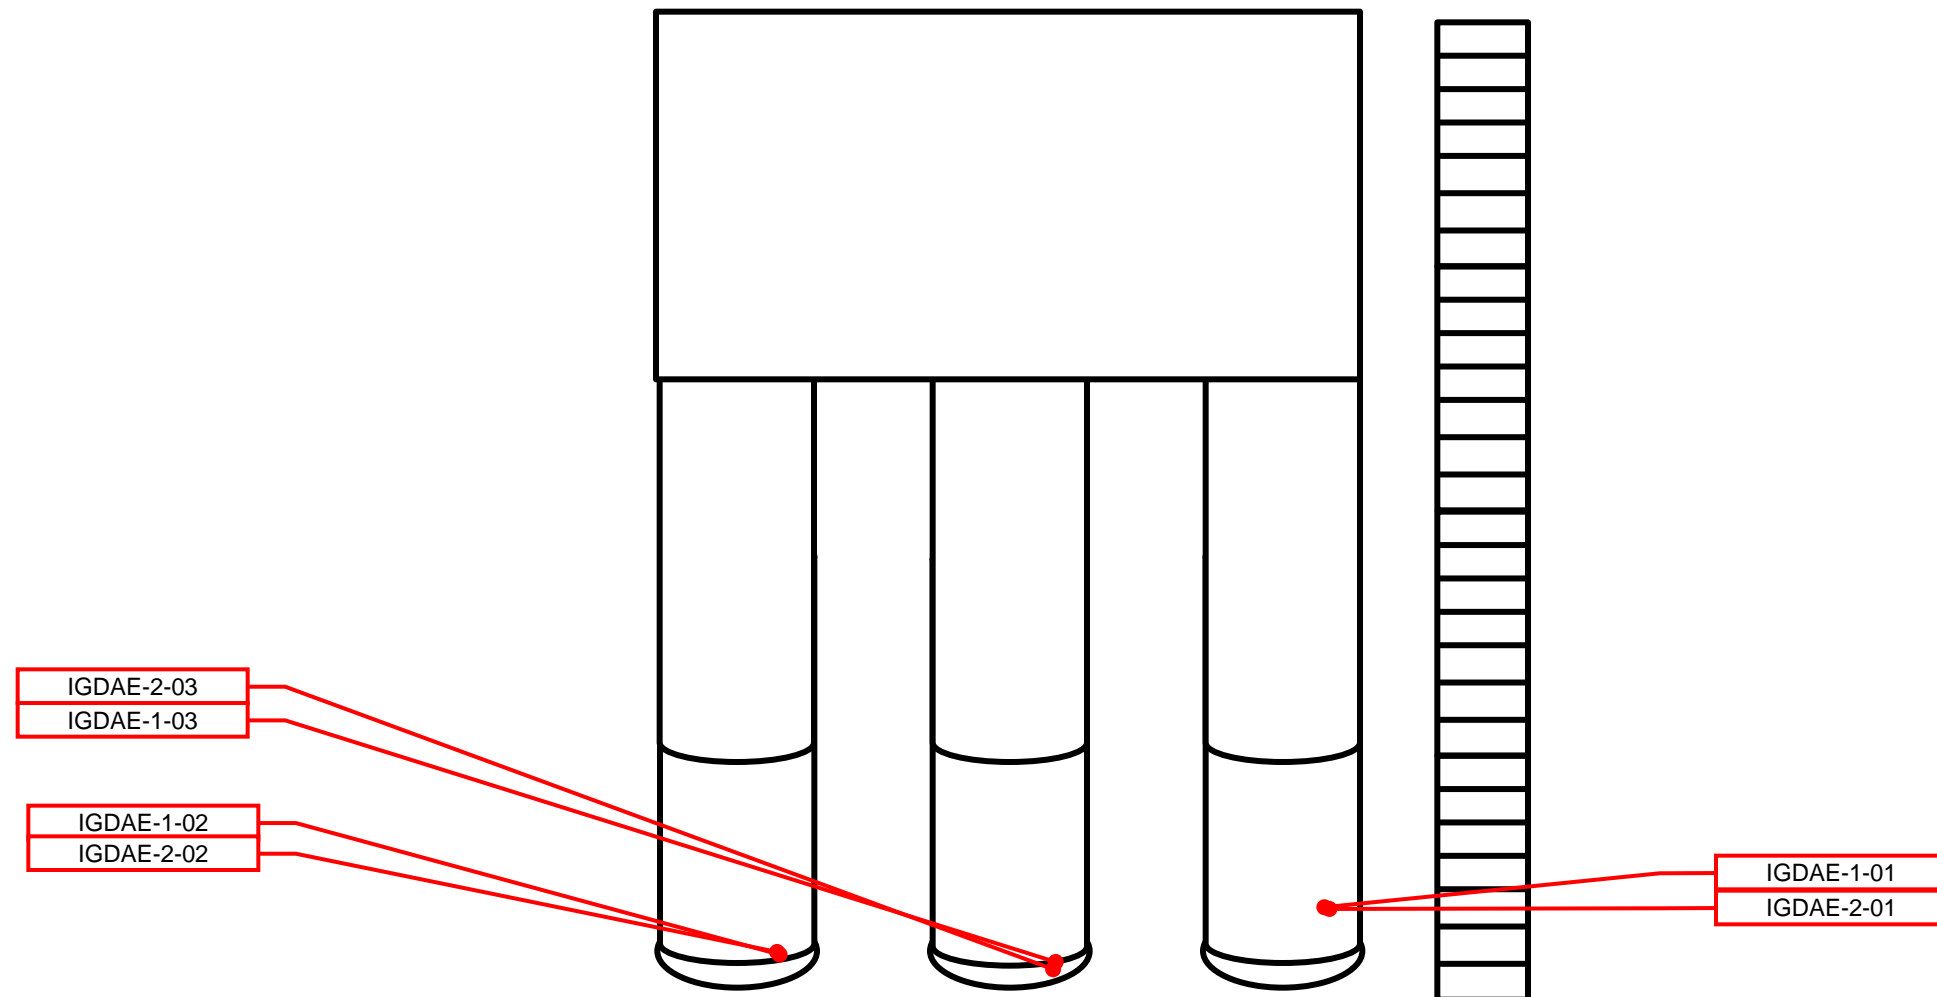


Legend
 IGDAE – HSA# – ## = Asbestos sample location
 IGDAE – Pb# – ## = Lead paint sample location

Figure 2
Asbestos and Lead Sample Locations
Aerator

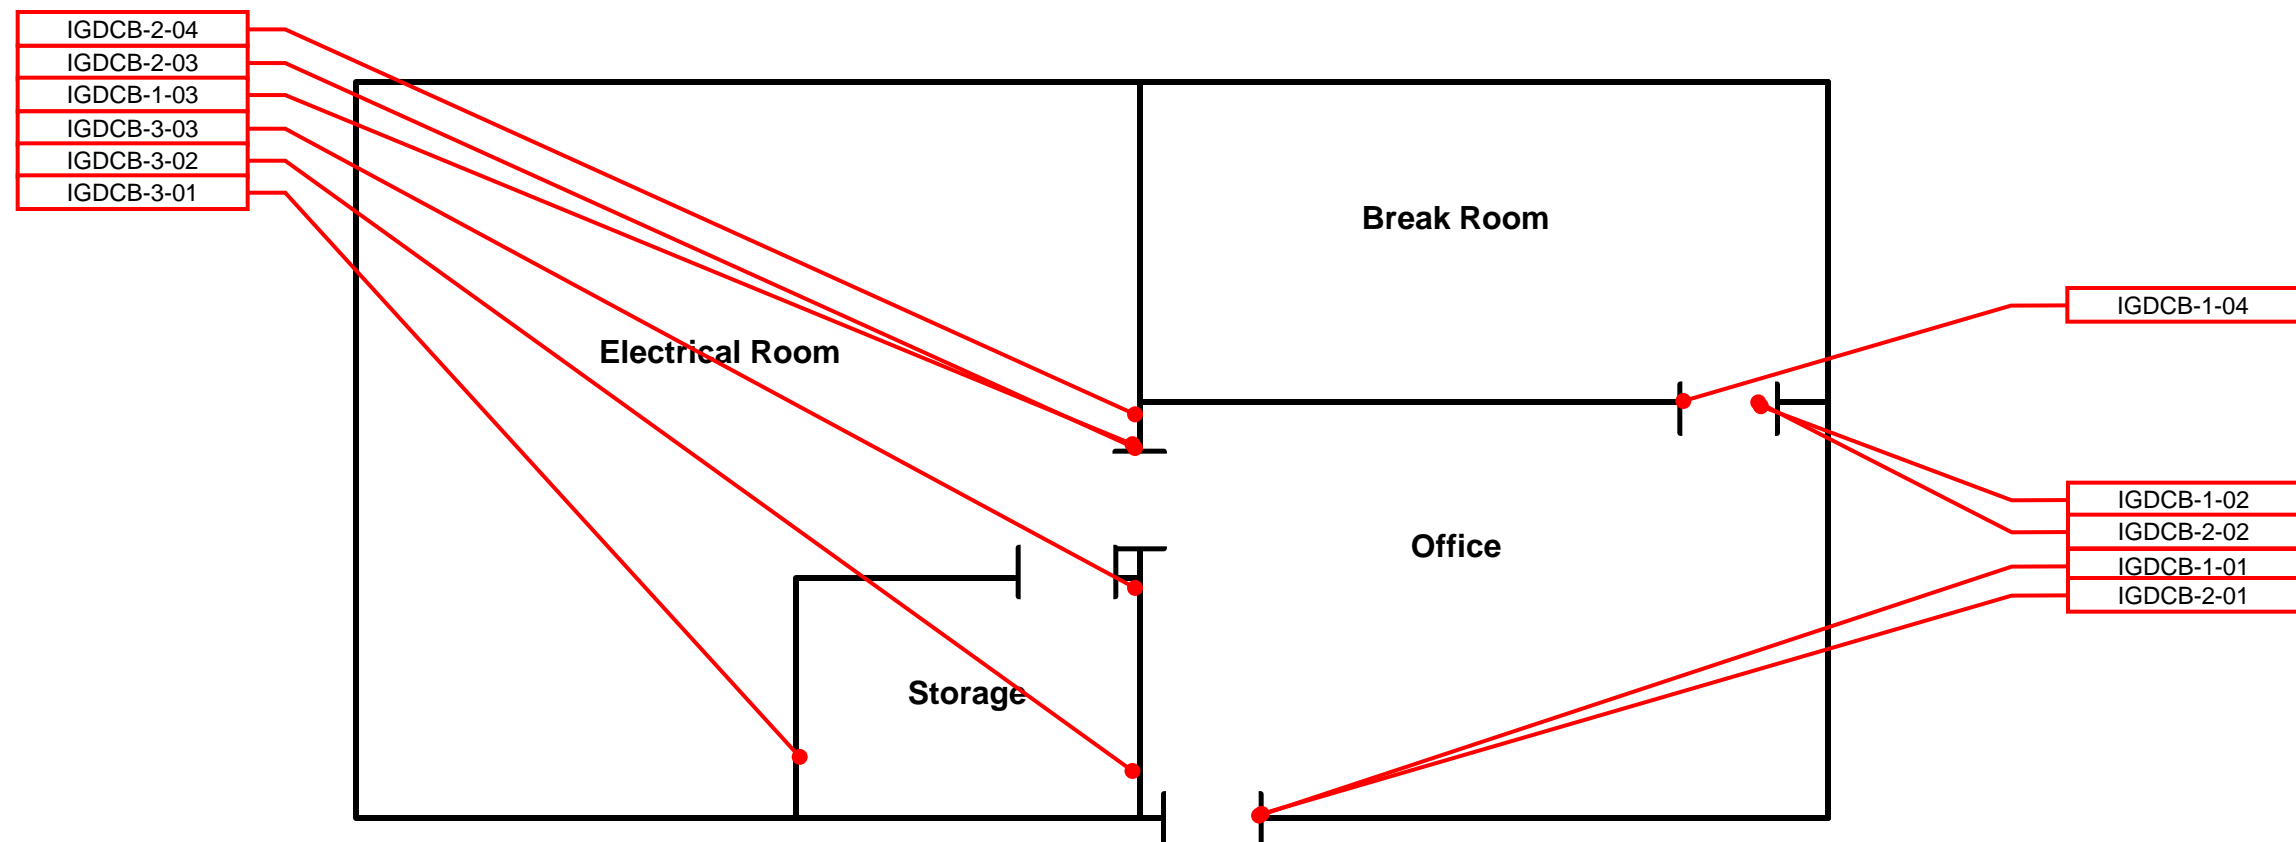


Legend
 IGDCB – HSA# – ## = Asbestos sample location
 IGDCB – Pb# – ## = Lead paint sample location

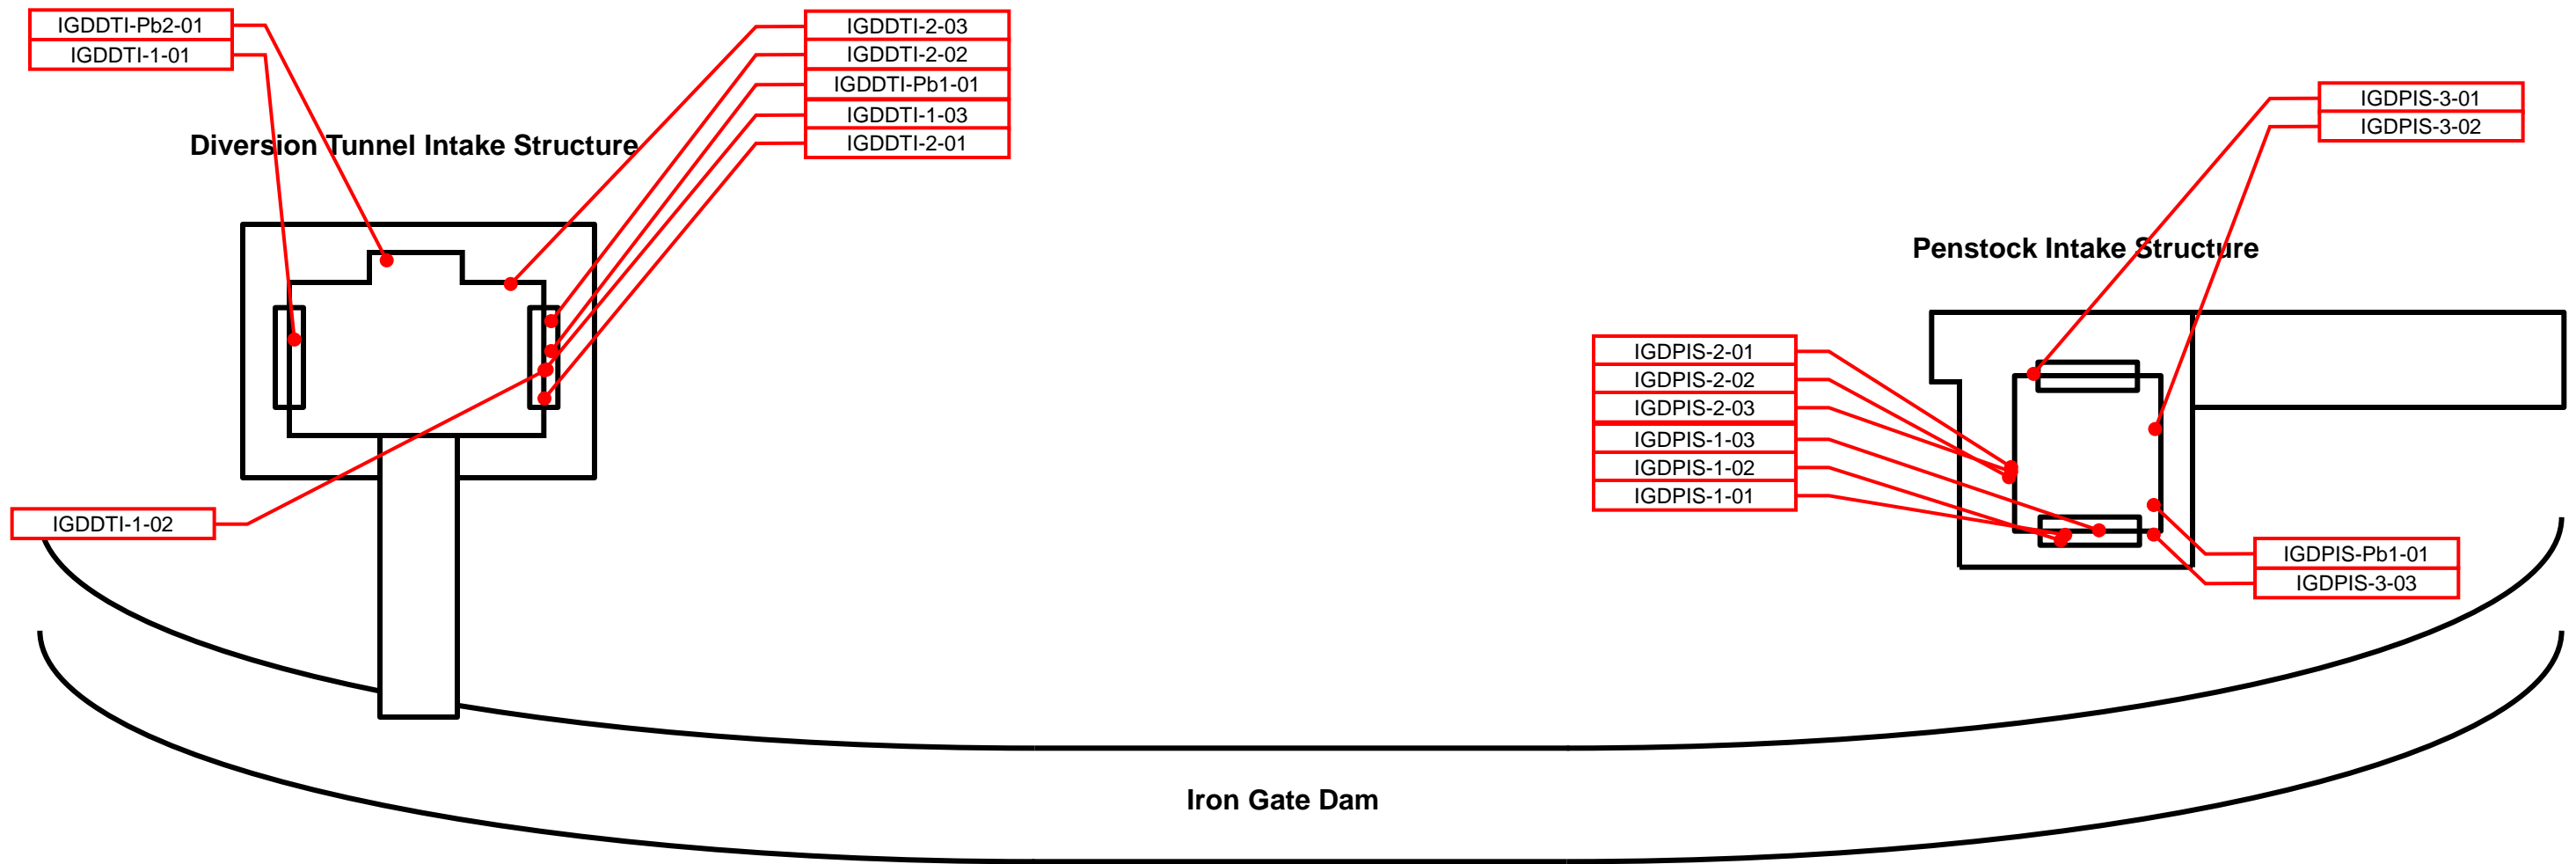

Legend
 IGDCB – HSA# – ## = Asbestos sample location
 IGDCB – Pb# – ## = Lead paint sample location


Figure 4
Asbestos and Lead Sample Locations
Diversion Tunnel Intake Structure and Penstock Intake Structure

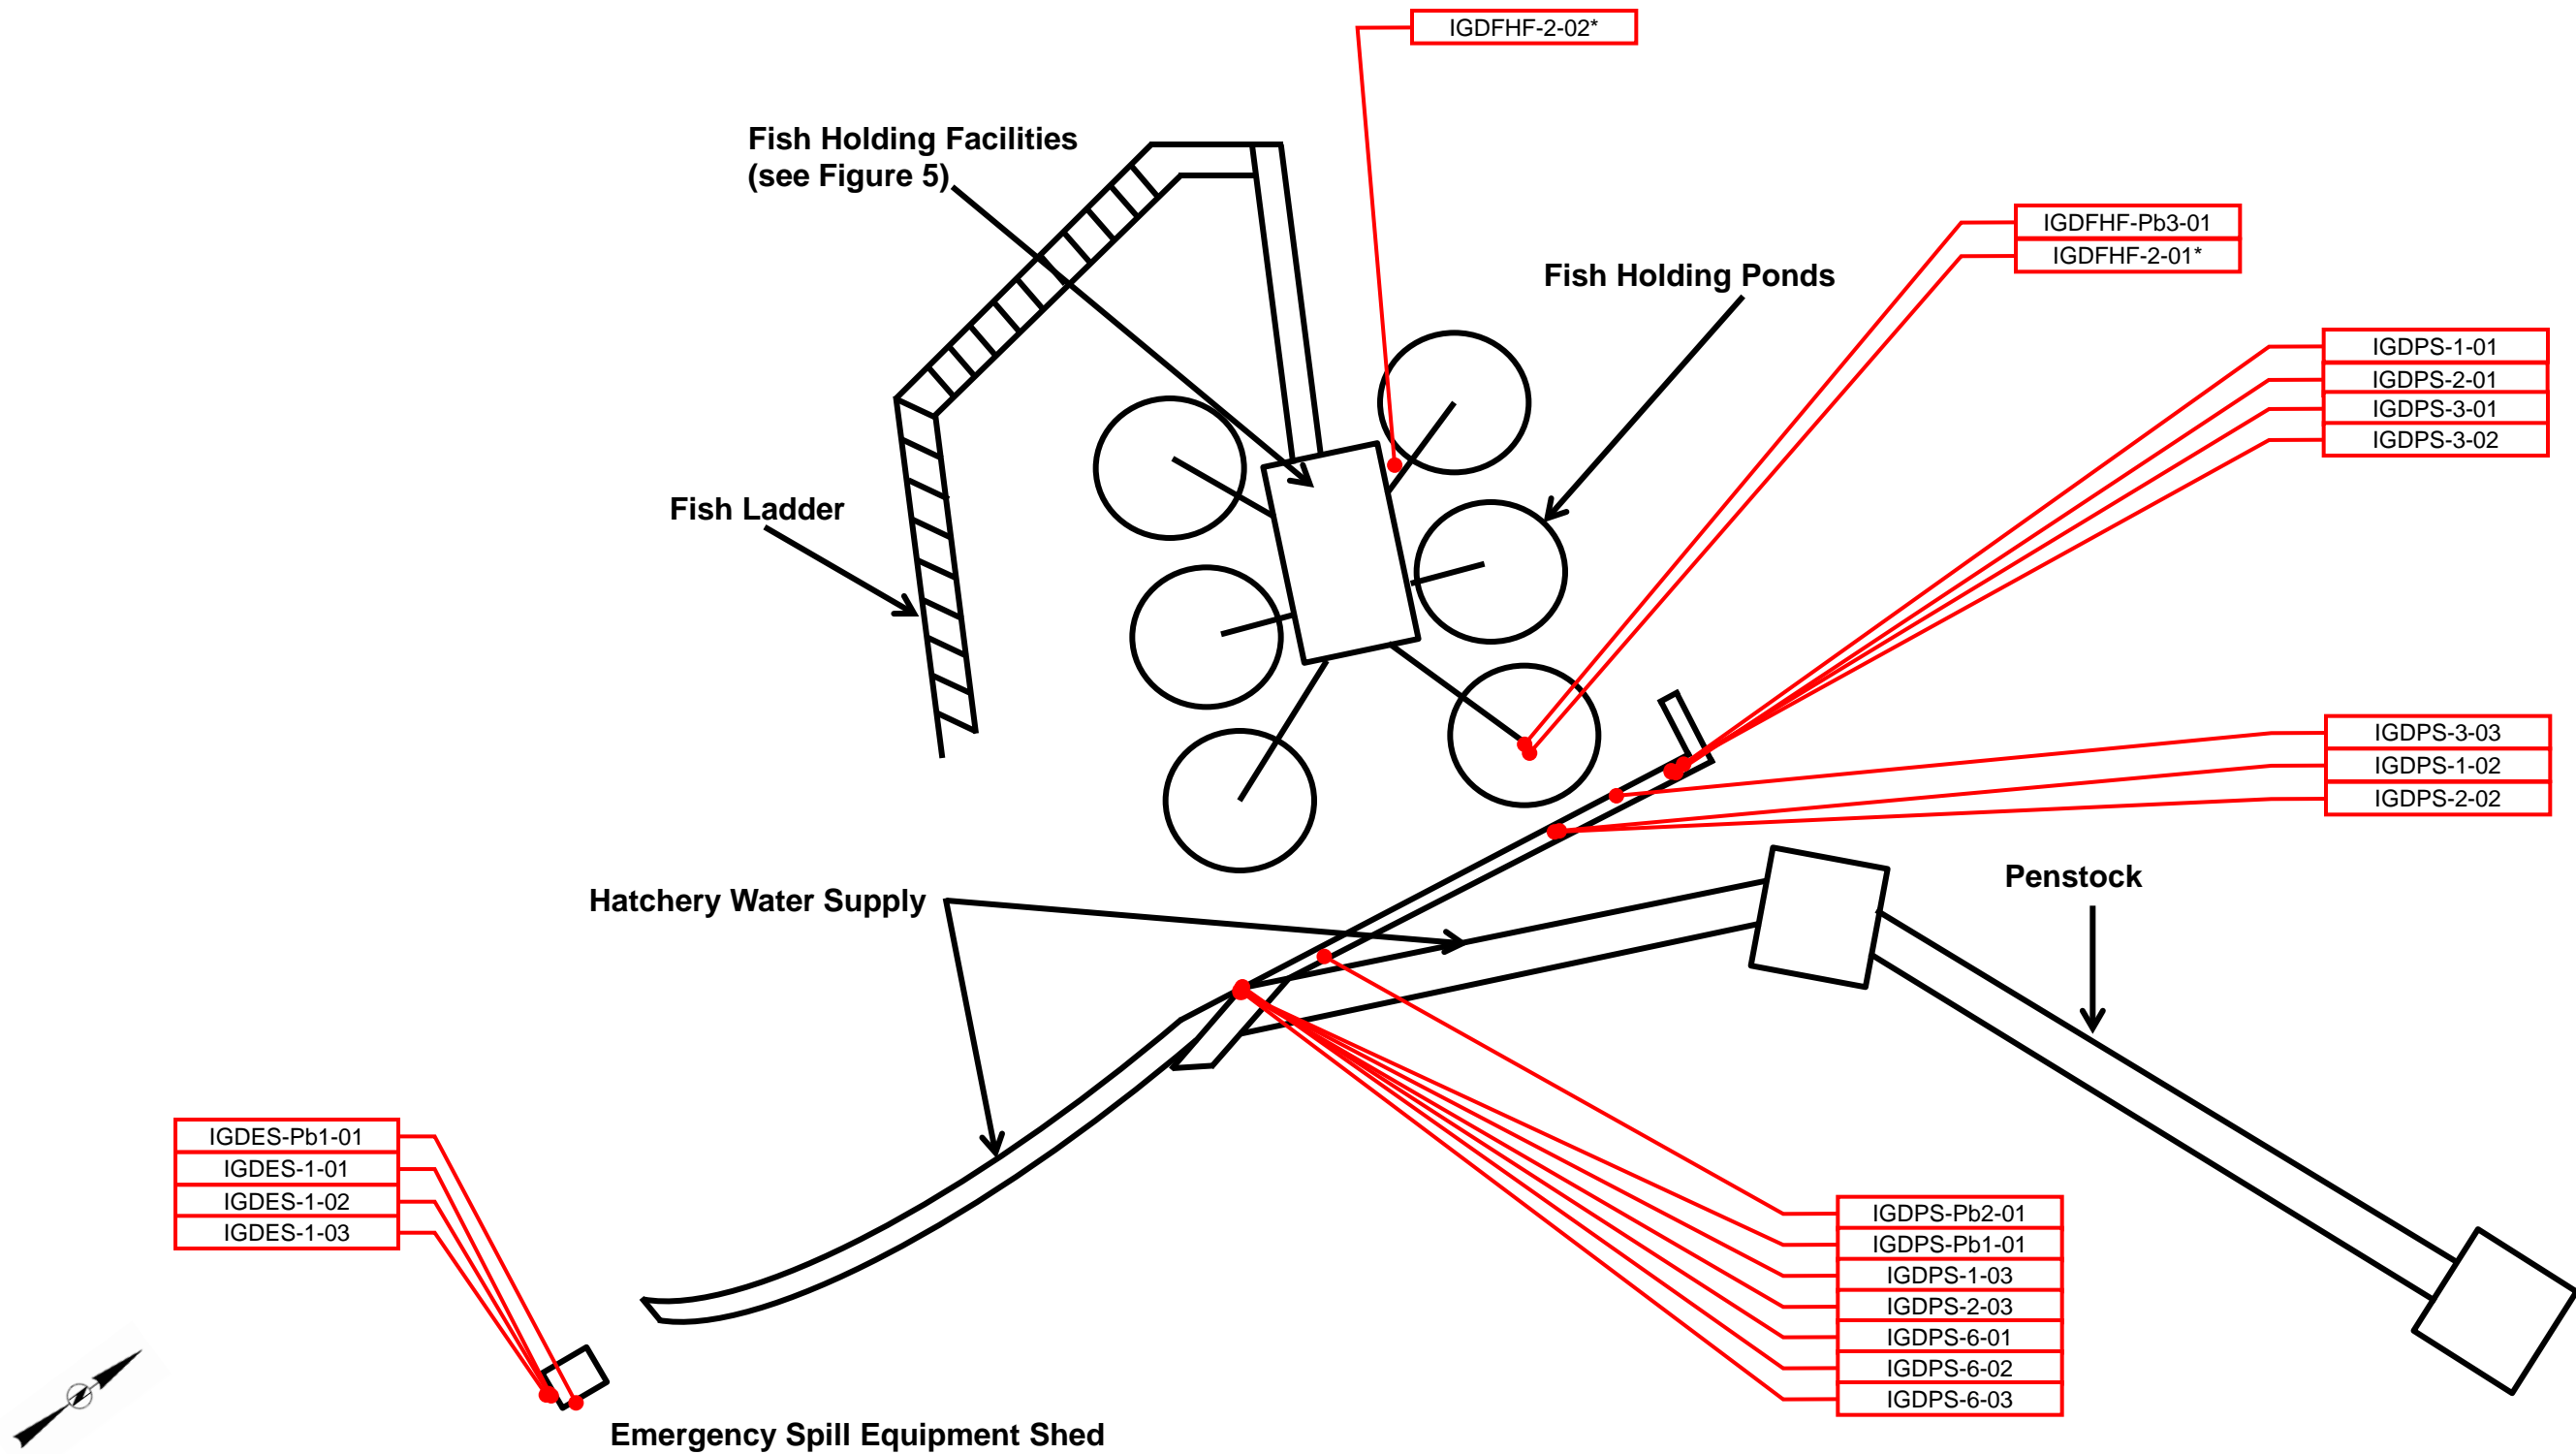

Legend
 IGDCB – HSA# – ## = Asbestos sample location
 IGDCB – Pb# – ## = Lead paint sample location
 *Concrete sample analyzed via PLM CARB (Detection limit of .25%)

Job No. 60537920 Drawing Not to Scale – Schematic Only


Figure 5
Asbestos and Lead Sample Locations
Penstock, Hatchery Water Supply, Emergency Spill Equipment Shed, and Fish Holding Ponds

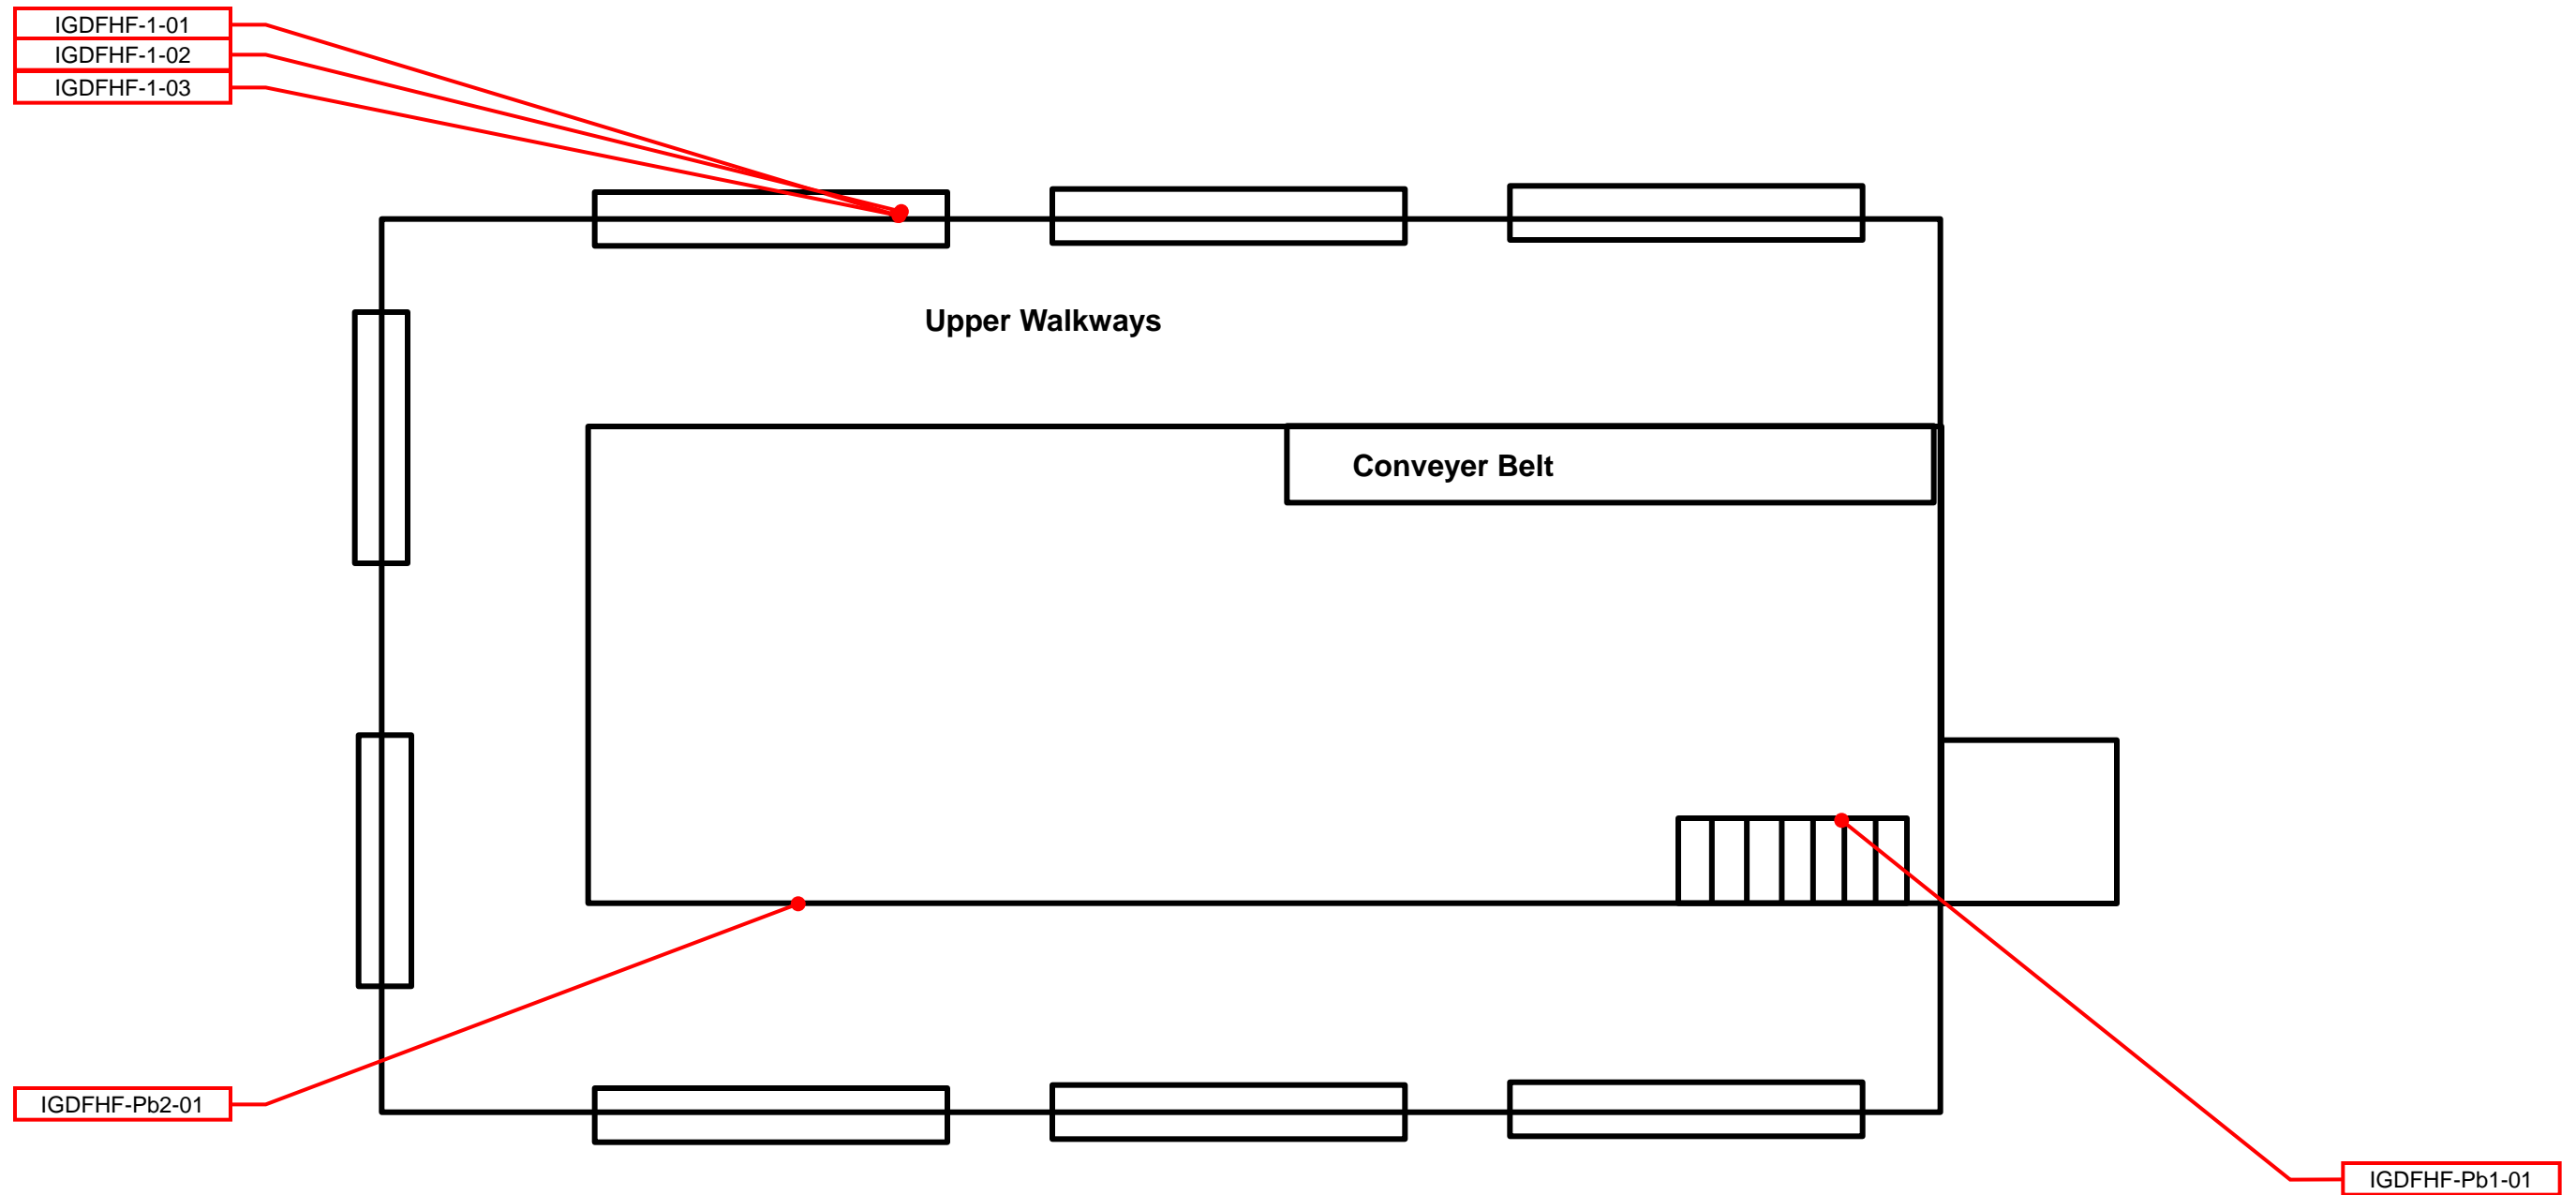

Emergency Spill Equipment Shed

Legend
 IGDFHF – HSA# – ## = Asbestos sample location
 IGDFHF – Pb# – ## = Lead paint sample location


Figure 6
Asbestos and Lead Sample Locations
Fish Holding Facilities

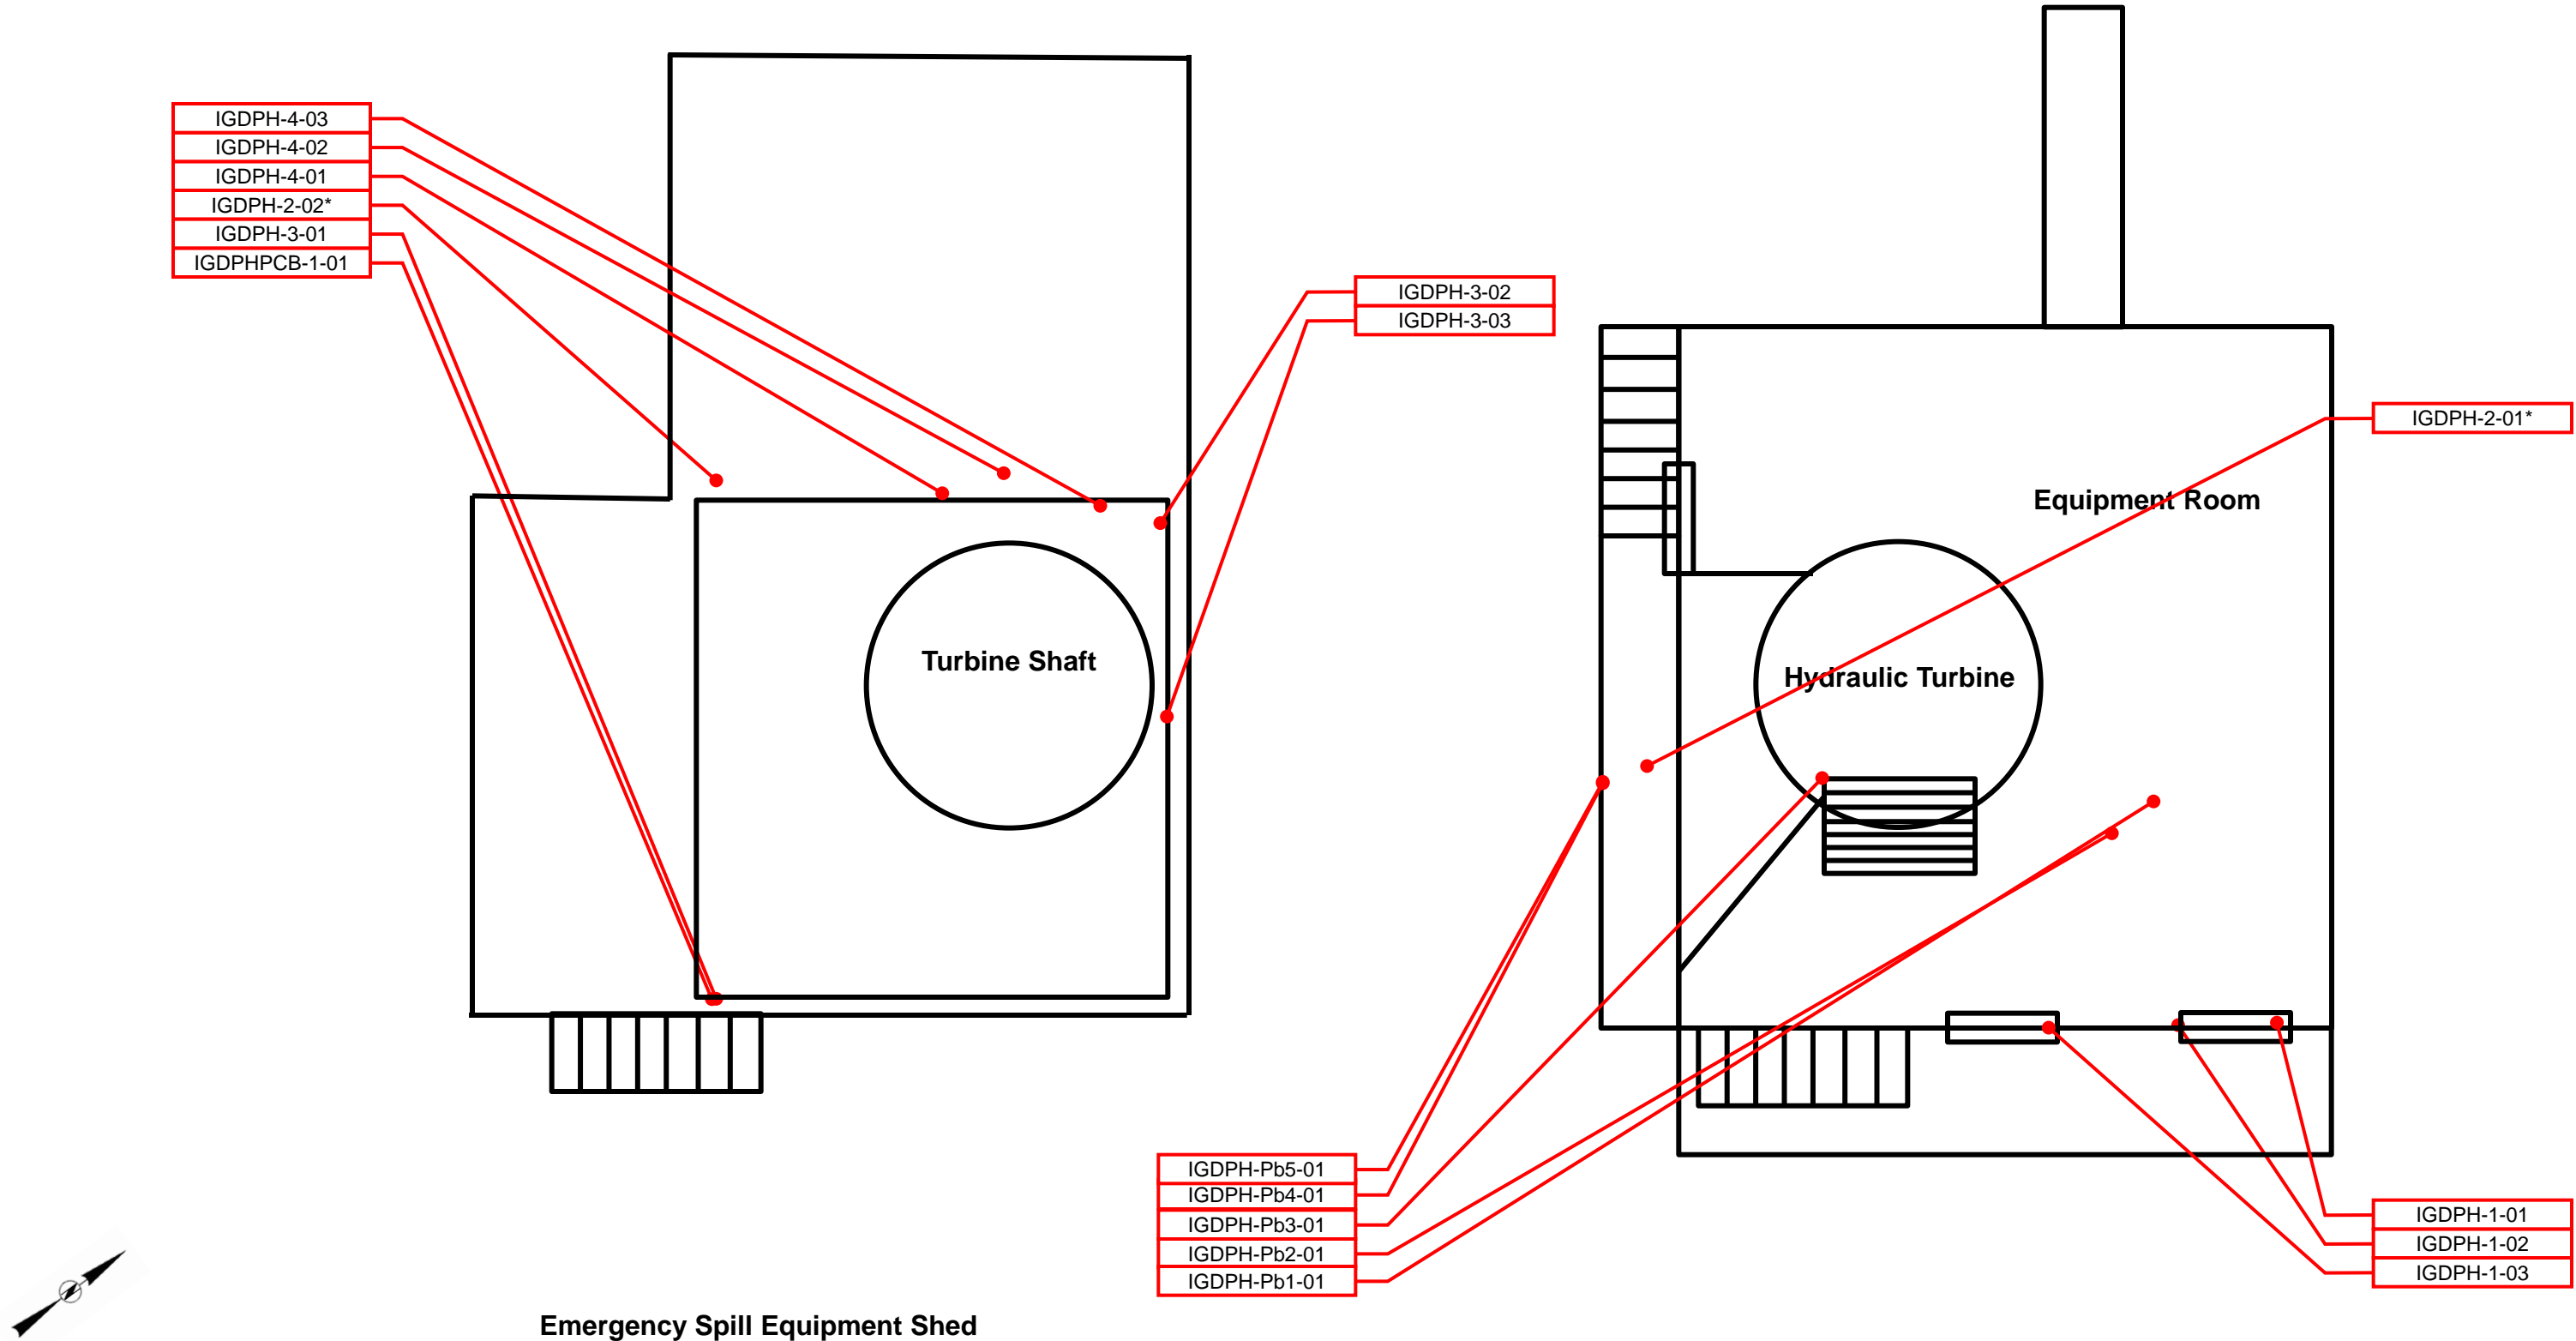

Legend
 IGDFHF – HSA# – ## = Asbestos sample location
 IGDFHF – Pb# – ## = Lead paint sample location
 *Concrete sample analyzed via PLM CARB (Detection limit of .25%)


Job No. 60537920 Drawing Not to Scale – Schematic Only

Figure 7
Asbestos and Lead Sample Locations
Powerhouse

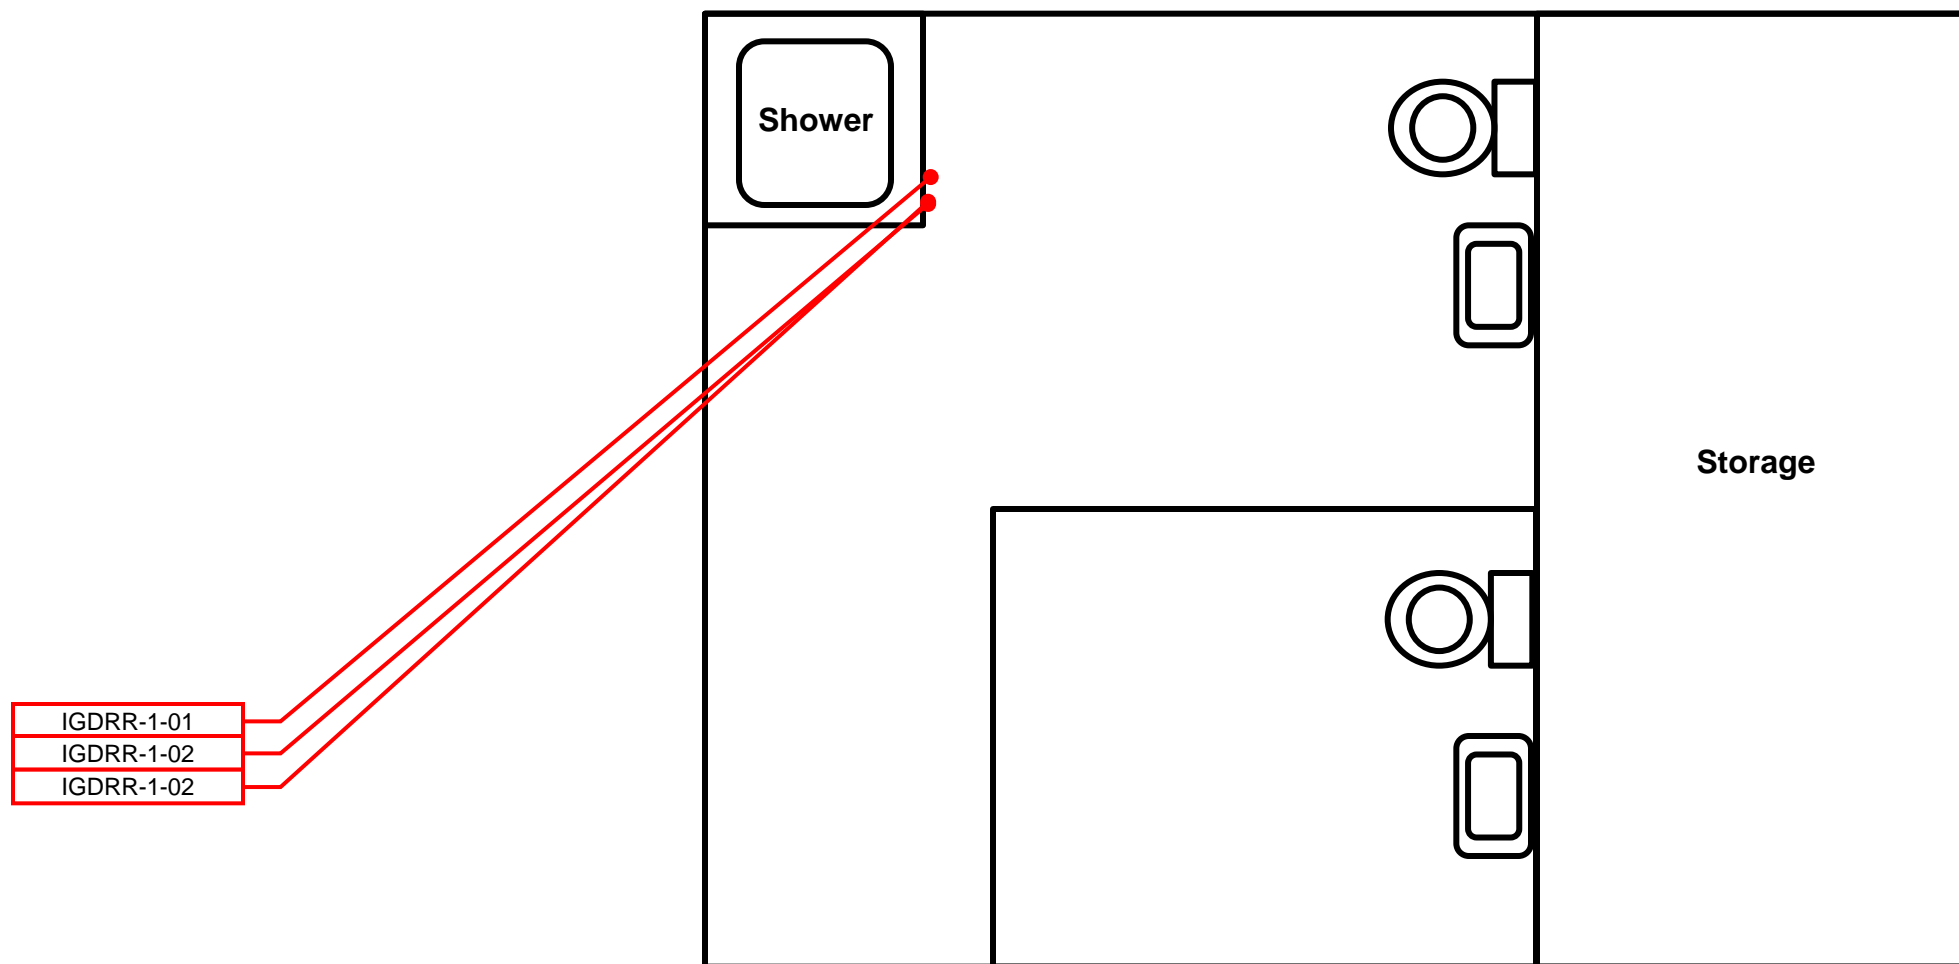

Legend
IGDFHF – HSA# – ## = Asbestos sample location
IGDFHF – Pb# – ## = Lead paint sample location

Figure 8
Asbestos and Lead Sample Locations
Restroom

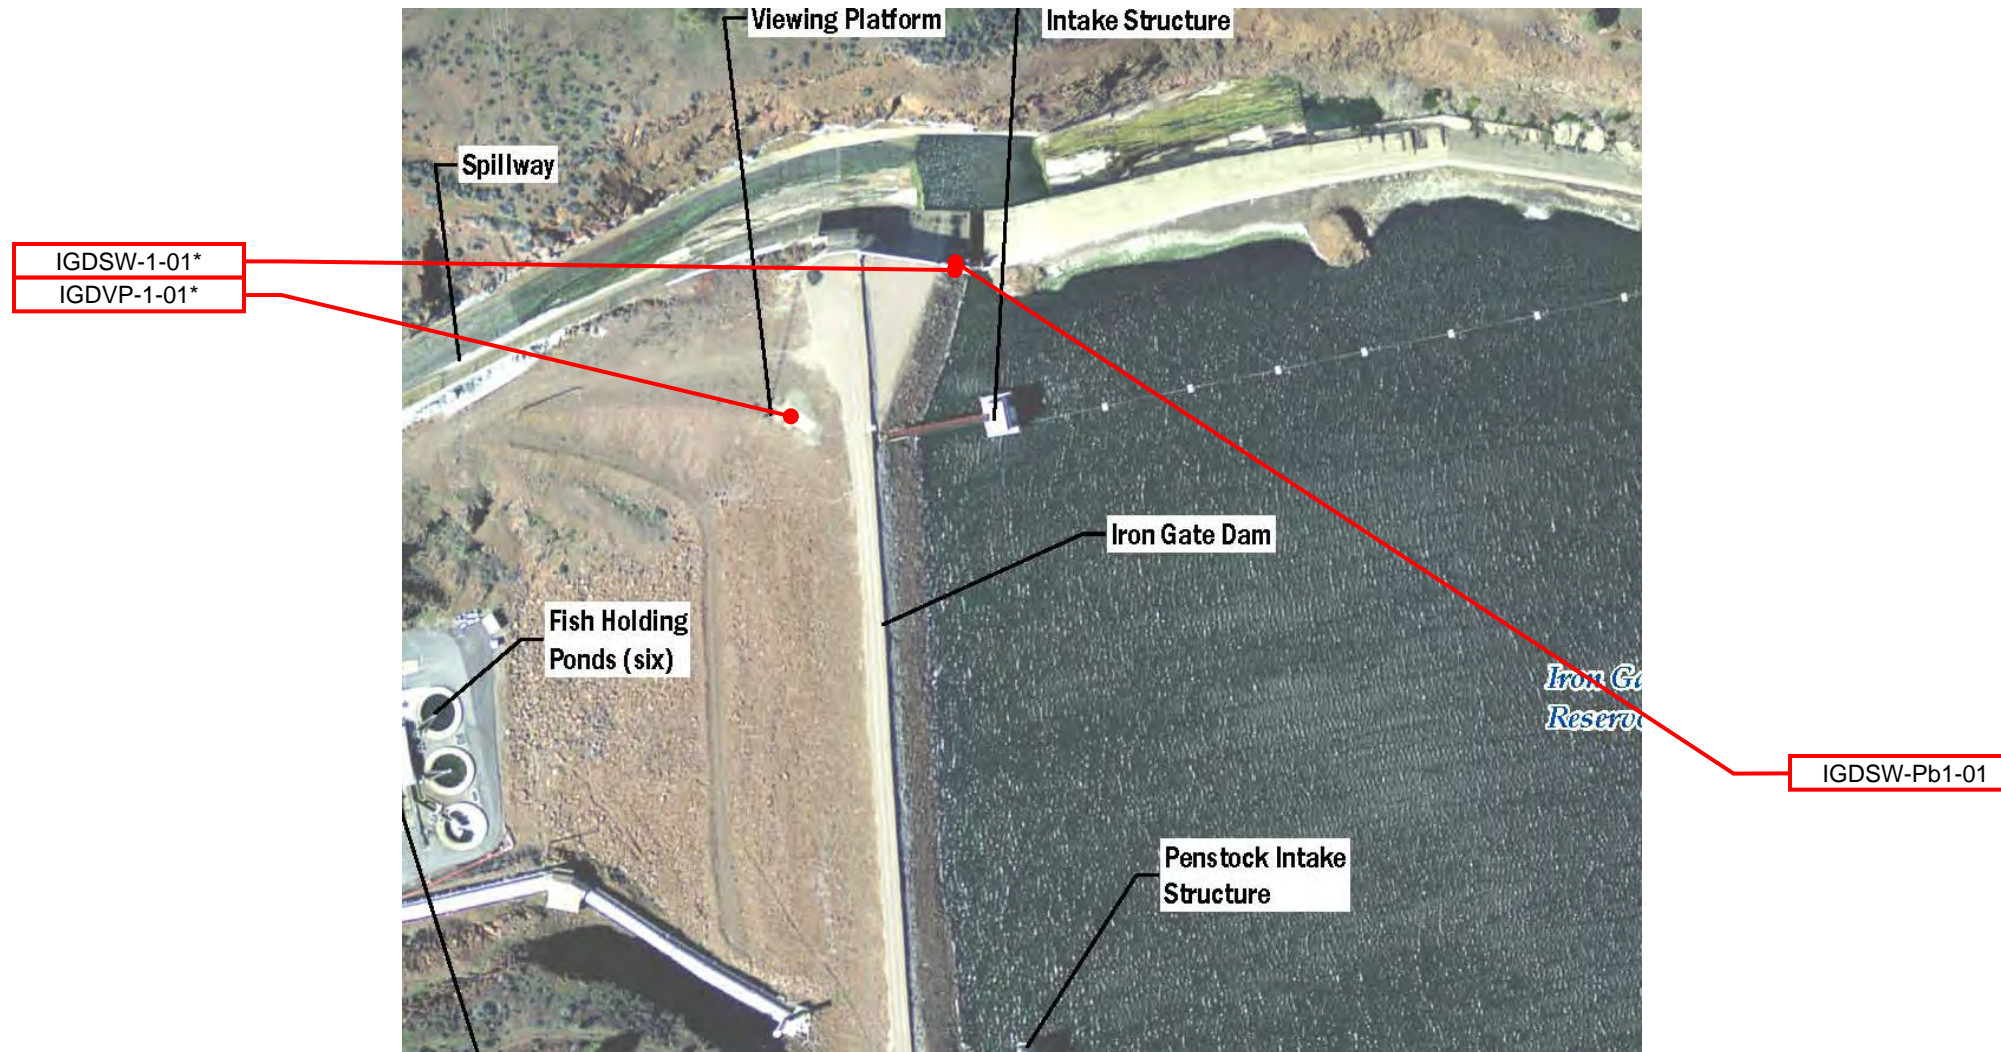





Legend
 IGDSW – Pb# – ## = Lead paint sample location
 *Concrete sample analyzed via PLM CARB (Detection limit of .25%)





Job No. 60537920 Drawing Not to Scale – Schematic Only

Figure 9
Asbestos and Lead Sample Locations
Spillway





Legend

-  IGDAE-03: Assumed asbestos-containing gaskets (M)
-  IGDPIS-01: Asbestos-containing white brittle window putty (M)
-  IGDFHF-01: Gray brittle patch window putty (M)



-  IGDMS-01, IGDMS-02, and IGDMB-03: Assumed asbestos-containing silver woven electrical wire insulation, assumed asbestos-containing electrical panel backing, and assumed asbestos-containing roofing paper (M)

-  IGDDIS-01: Asbestos-containing gray window putty (M)
-  IDGPH-01: Asbestos-containing gray brittle window putty (M)
-  IGDPH-05: Assumed asbestos-containing wicket gate (M)
-  IGDPH-06: Assumed asbestos-containing metal-clad fire door insulation (M)

Drawing should be printed in color

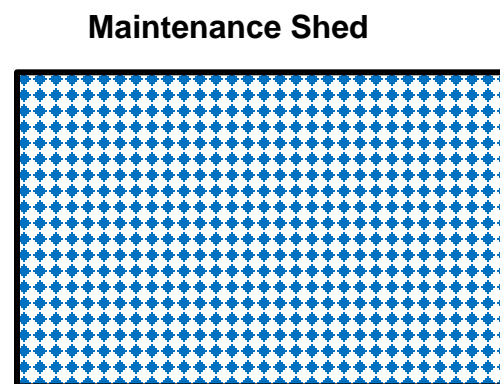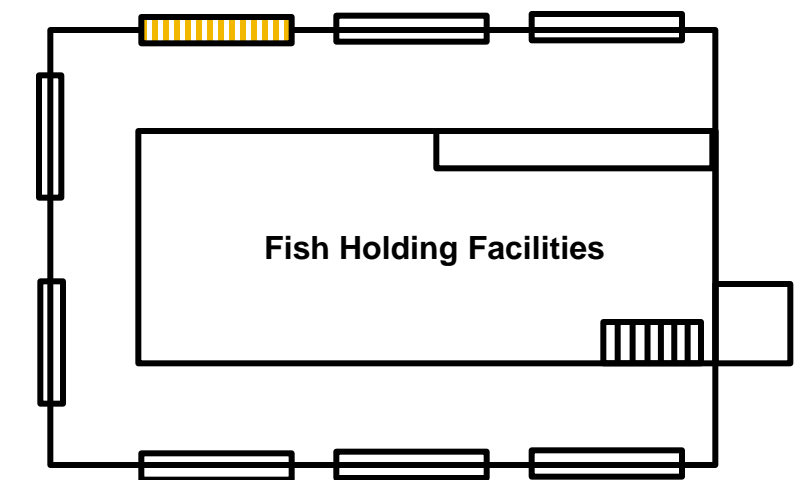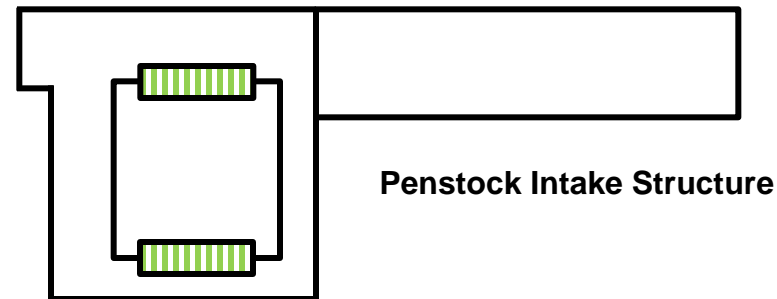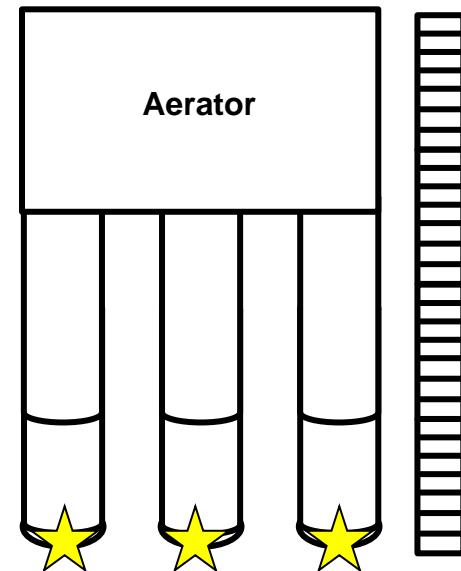

Diversion Tunnel Intake Structure

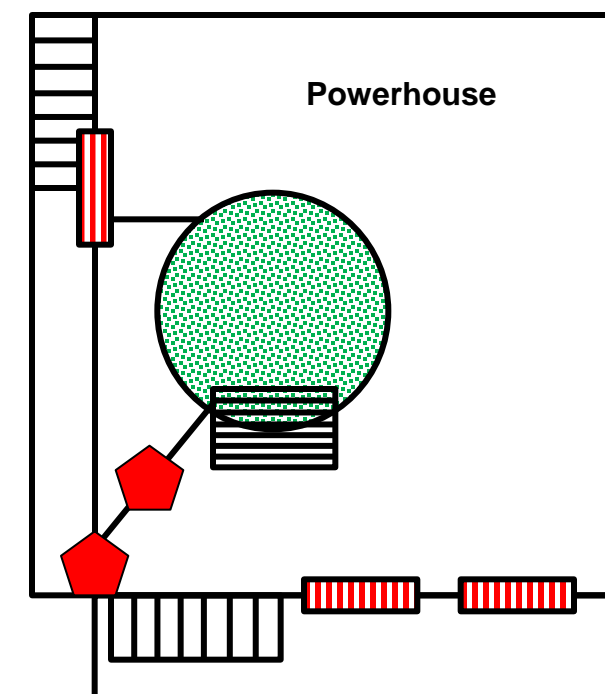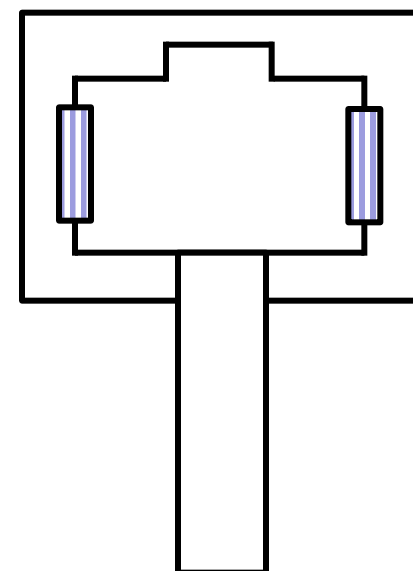

Assumed asbestos-containing buried Transite piping is assumed to be throughout the Iron Gate Development. Not shown on figures.

Figure 9
Approximate ACM Locations
Aerator, Penstock Intake Structure,
Fish Holding Facilities, Maintenance Shed,
Diversion Tunnel Intake Structure,
and Powerhouse

APPENDIX B HSA PHOTOLOGS

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Aerator

Project No.
60567920

Photo No./ Material ID: ---	Date: 9/12/2018
Structure: Iron Gate Dam Aerator	



Photo No./ Material ID: IGDAE - 01	Date: 9/12/2018
Structure/Material Location: Iron Gate Dam Aerator/ Aerator piping, hatchery water supply	
*Description (by layer): 1: Black asphaltic pipe wrap (M)	



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDAE

Client Name:
Klamath River Renewal
Corporation**Site Location:** Iron Gate Dam, Aerator**Project No.**
60567920**Photo No./
Material ID:**

IGDAE - 02

Date:

9/12/2018

Structure/Material Location:Iron Gate Dam Aerator/
Ceiling throughout all rooms***Description (by layer):**

- 1: Silver paint (M)
- 2: Black asphaltic pipe wrap (M)

**Photo No./
Material ID:**

IGDAE - 03

Date:

9/12/2018

Structure/Material Location:Iron Gate Dam Aerator/
Ceiling throughout all rooms***Description (by layer):**

- 1: Red gasket (M)



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDAE

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Communication
Building

Project No.
60567920

**Photo No./
Material ID:**

Date:

9/12/2018

Structure:

Iron Gate Dam Aerator



**Photo No./
Material ID:**

IGDAE - 01

Date:

9/12/2018

Structure/Material Location:

Iron Gate Dam Aerator/ Flooring
in office area

***Description (by layer):**

- 1: Gray vinyl floor sheeting with
terrazzo pattern (M)
- 2: Gray paper backing with
mastic (M)
- 3: Tan mastic (M)



Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Communication
Building

Project No.
60567920

**Photo No./
Material ID:**

IGDAE - 02

Date:

9/12/2018

Structure/Material Location:

Iron Gate Dam Aerator/
Walls in office area

***Description (by layer):**

- 1: 4" gray rubber cove base (M)
- 2: White mastic (M)



**Photo No./
Material ID:**

IGDAE - 03

Date:

9/12/2018

Structure/Material Location:

Iron Gate Dam Aerator/
Ceiling throughout all rooms

***Description (by layer):**

- 1: White joint compound with paper (M)
- 2: White gypsum wallboard with paper (M)
- 3: White joint compound with paper (M)
- 4: Peach gypsum wallboard with paper (M)



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDAE Page 2 of 2 AECOM Project Number: 60567920

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Diversion Tunnel
Intake Structure

Project No.
60567920

**Photo No./
Material ID:**

Date:

9/17/2018

Structure:

Iron Gate Dam Diversion Tunnel
Intake Structure



**Photo No./
Material ID:**

IDGDTI - 01

Date:

9/14/2018

Structure/Material Location:

Iron Gate Dam Diversion Tunnel
Intake Structure/ Flooring in
office area

***Description (by layer):**

- 1: Silver paint (M)
- 2: **Gray window putty (M)**



Client Name:
Klamath River Renewal
Corporation**Site Location:** Iron Gate Dam, Diversion Tunnel
Intake Structure**Project No.**
60567920**Photo No./
Material ID:**

IDGDTI - 02

Date:

9/14/2018

Structure/Material Location:Iron Gate Dam Diversion Tunnel
Intake Structure/ Exterior
window frames***Description (by layer):**1: Beige exterior window
caulking (M)

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Emergency Spill
Equipment Shed

Project No.
60567920

**Photo No./
Material ID:**

Date:

9/14/2018

Structure:

Iron Gate Dam Emergency Spill
Equipment Shed



**Photo No./
Material ID:**

IGDES - 01

Date:

9/14/2018

Structure/Material Location:

Iron Gate Dam Emergency Spill
Equipment Shed/ Roofing
throughout shed

***Description (by layer):**

1: Asphaltic roofing shingle with
granules (M)



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDES Page 1 of 1 AECOM Project Number: 60567920

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Fish Holding Facility

Project No.
60567920

**Photo No./
Material ID:**

Date:

9/14/2018

Structure:

Iron Gate Dam Fish Holding
Facility



**Photo No./
Material ID:**

IGDFHF - 01

Date:

9/14/2018

Structure/Material Location:

Iron Gate Dam Fish Holding
Facility/ Patch sealant on one
window only

***Description (by layer):**

**1: Gray brittle window putty
(M)**



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDFHF Page 1 of 1 AECOM Project Number: 60567920

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Maintenance Shed

Project No.
60567920

**Photo No./
Material ID:**

Date:

9/14/2018

Structure:

Iron Gate Dam Maintenance
Shed



**Photo No./
Material ID:**

IGDMS - 01

Date:

9/14/2018

Structure/Material Location:

Iron Gate Dam Maintenance
Shed/ Throughout Maintenance
Shed

***Description (by layer):**

**Assumed asbestos-containing
silver woven electrical wire
insulation**



Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Maintenance Shed

Project No.
60567920

Photo No./ Material ID:	Date:
IGDMS - 02	9/14/2018
Structure/Material Location: Iron Gate Dam Maintenance Shed/ Throughout Maintenance Shed	
*Description (by layer): Assumed asbestos-containing electrical panel backing in older electrical panels	



Photo No./ Material ID:	Date:
IGDMS - 03	9/14/2018
Structure/Material Location: Iron Gate Dam Maintenance Shed/ Throughout Maintenance Shed roof, underneath corrugated metal roofing	
*Description (by layer): Assumed asbestos-containing roofing paper	



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Penstock Intake
Structure

Project No.
60567920

**Photo No./
Material ID:**

Date:

9/14/2018

Structure:

Iron Gate Dam Penstock Intake
Structure



**Photo No./
Material ID:**

IGDPIS - 01

Date:

9/14/2018

Structure/Material Location:

Iron Gate Dam Penstock Intake
Structure/ Interior window panes

***Description (by layer):**

1: Gray putty material (M)



Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Dam, Penstock Intake
Structure

Project No.
60567920

Photo No./ Material ID: IGDPIS - 02	Date: 9/14/2018
Structure/Material Location: Iron Gate Dam Penstock Intake Structure/ Doorway to interior	
*Description (by layer): 1: White caulking at base of doorway (M) 2: Gray brittle material (M)	



Photo No./ Material ID: IGDPIS - 03	Date: 9/14/2018
Structure/Material Location: Iron Gate Dam Penstock Intake Structure/ Exterior metal siding seams	
*Description (by layer): 1: White caulking (M) 2: Beige soft material with paint (M)	



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Development, Penstock

Project No.
60567920

Photo No./ Material ID: ---	Date: 9/14/2018
Structure: Iron Gate Dam Penstock	



Photo No./ Material ID: IGDPS - 01	Date: 9/14/2018
Structure/Material Location: Iron Gate Dam Penstock/ Hatchery water supply piping (M)	
*Description (by layer): 1:Black asphaltic pipe wrap (M)	



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDPS

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Development, Penstock

Project No.
60567920

Photo No./ Material ID: IGDPS - 02	Date: 9/14/2018
Structure/Material Location: Iron Gate Dam Penstock/ Hatchery water supply piping	
*Description (by layer): 1: Thick silver paint (M) 2: Black asphaltic pipe wrap (M)	



Photo No./ Material ID: IGDPS - 03	Date: 9/14/2018
Structure/Material Location: Iron Gate Dam Penstock/ Hatchery water supply piping	
*Description (by layer): 1: Brown fibrous gasket at pipe line saddles (M)	



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDPS Page 2 of 4 AECOM Project Number: 60567920

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Development, Penstock

Project No.
60567920

Photo No./ Material ID: IGDPS - 04	Date: 9/14/2018
Structure/Material Location: Iron Gate Dam Penstock/ Hatchery water supply piping	
*Description (by layer): 1: Red gasket (M)	


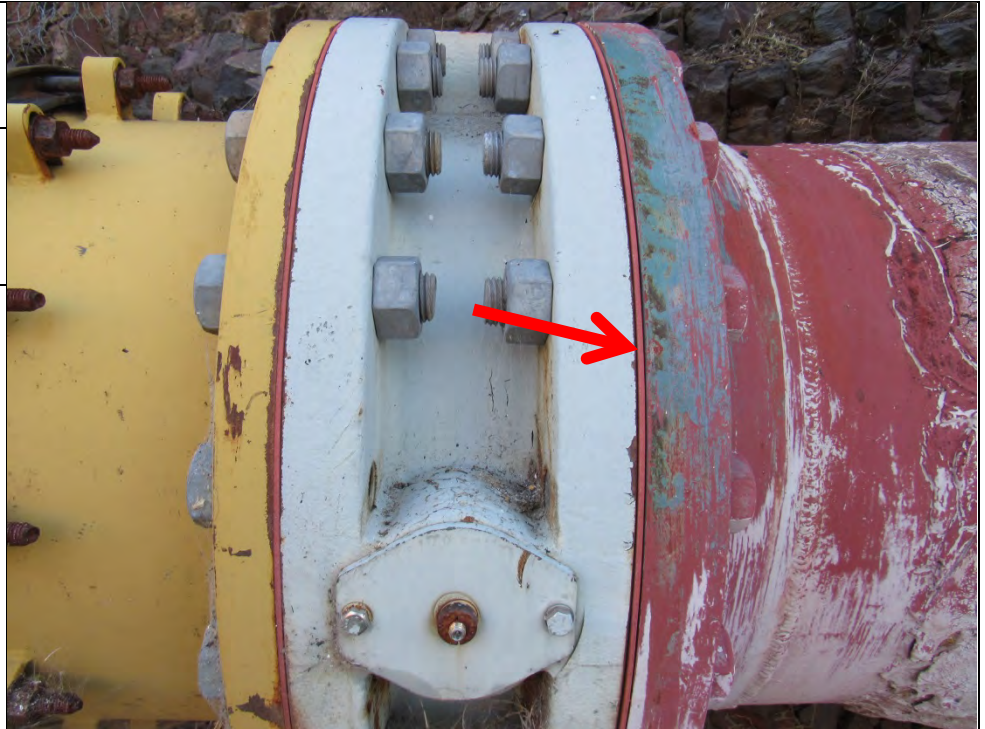


Photo No./ Material ID: IGDPS - 05	Date: 9/14/2018
Structure/Material Location: Iron Gate Dam Penstock/ Hatchery water supply piping	
*Description (by layer): 1: Black gasket (M)	

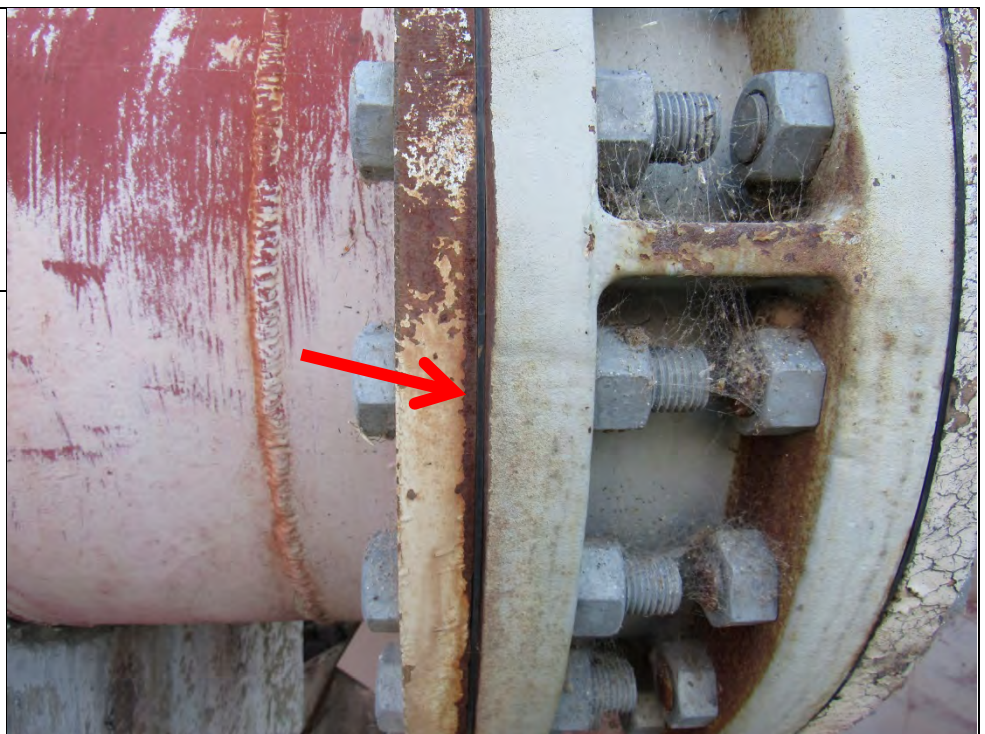

*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDPS

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Development, Penstock

Project No.
60567920

**Photo No./
Material ID:**

IGDPS - 06

Date:

9/14/2018

Structure/Material Location:

Iron Gate Dam Penstock/
Hatchery water supply piping

***Description (by layer):**

1: Tar coating on fish hatchery
water supply (M)



Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Development, Powerhouse

Project No.
60567920

**Photo No./
Material ID:**

Date:

9/14/2018

Structure:

Iron Gate Dam Powerhouse



**Photo No./
Material ID:**

IGDPH - 01

Date:

9/14/2018

Structure/Material Location:

Iron Gate Dam Powerhouse/
Interior/exterior windows

***Description (by layer):**

1: Gray brittle window putty (M)



Client Name: Klamath River Renewal Corporation	Site Location: Iron Gate Development, Powerhouse	Project No. 60567920
--	---	--------------------------------

Photo No./ Material ID: IGDPH - 02	Date: ---	
Structure/Material Location: Not used		
*Description (by layer):		

Photo No./ Material ID: IGDPH - 03	Date: 9/14/2018	
Structure/Material Location: Iron Gate Dam Powerhouse/ Exterior seams, roof of Powerhouse (concrete pad)		
*Description (by layer): 1: Gray expansion joint caulking (M)		

Client Name:
Klamath River Renewal
Corporation

Site Location: Iron Gate Development, Powerhouse

Project No.
60567920

**Photo No./
Material ID:**

IGDPH - 04

Date:

9/14/2018

Structure/Material Location:

Iron Gate Dam Powerhouse/
Roof of Powerhouse (concrete
pad)

***Description (by layer):**

1: Brown epoxy coating (M)



Client Name:
Klamath River Renewal
Corporation**Site Location:** Iron Gate Development, Restrooms**Project No.**
60567920**Photo No./
Material ID:**

Date:

9/14/2018

Structure:

Iron Gate Dam Restrooms

**Photo No./
Material ID:**

IGDRR - 01

Date:

9/14/2018

Structure/Material Location:Iron Gate Dam Restrooms/
Shower base interior of restroom***Description (by layer):**

1: White brittle terrazzo (M)



*Layers in bold text are asbestos-containing or are assumed to be asbestos-containing

Categories per AHERA and Cal-OSHA: (S): Surfacing material; (M): Miscellaneous material; (TSI): Thermal System Insulation
Site Photograph Log – IGDRR Page 1 of 1 AECOM Project Number: 60567920

APPENDIX C LABORATORY ANALYTICAL RESULTS

October 8, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819445.00

Client Project: 60537920 Task 2.4
Location: IGD Aerator

Dear Ms. Gladu,

Enclosed please find test results for the 6 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Matt Macfarlane".

Matt Macfarlane, Asbestos Lab Supervisor



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Aerator

Batch #: 1819445.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 6

Samples Analyzed: 6

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099616 Client Sample #: IGDAE-1-01

Location: IGD Aerator

Layer 1 of 1 Description: Black asphaltic fibrous built-up material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Asphalt/Binder, Fine particles, Debris	Cellulose 3%	
Insect parts	Glass fibers 17%	
	Spider silk 2%	

Lab ID: 18099617 Client Sample #: IGDAE-1-02

Location: IGD Aerator

Layer 1 of 1 Description: Black asphaltic fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Asphalt/Binder, Fine particles	Cellulose 3%	
	Glass fibers 26%	

Lab ID: 18099618 Client Sample #: IGDAE-1-03

Location: IGD Aerator

Layer 1 of 1 Description: Black asphaltic fibrous material with granules

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Asphalt/Binder, Fine particles, Granules	Cellulose 3%	
	Glass fibers 36%	

Lab ID: 18100184 Client Sample #: IGDAE-2-01

Location: IGD Aerator

Layer 1 of 2 Description: Silver paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Metallic paint, Fine particles	Cellulose 3%	

Sampled by: Client

Analyzed by: Matthew McCallum

Reviewed by: Matt Macfarlane

Date: 10/08/2018

Date: 10/08/2018

Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Aerator

Batch #: 1819445.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 6

Samples Analyzed: 6

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Layer 2 of 2	Description: Black asphaltic fibrous felt		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Asphalt/Binder, Organic debris, Fine particles	Cellulose 62%	None Detected ND

Lab ID: 18100185 **Client Sample #: IGDAE-2-02**

Location: IGD Aerator

Layer 1 of 2	Description: Silver paint		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Metallic paint, Fine particles	Cellulose 2%	None Detected ND

Layer 2 of 2	Description: Black asphaltic fibrous felt		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Asphalt/Binder, Organic debris, Fine particles	Cellulose 67%	None Detected ND

Lab ID: 18100186 **Client Sample #: IGDAE-2-03**

Location: IGD Aerator

Layer 1 of 2	Description: Silver paint		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Metallic paint, Fine particles	Cellulose 2%	None Detected ND

Layer 2 of 2	Description: Black asphaltic fibrous felt		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Asphalt/Binder, Organic debris, Fine particles	Cellulose 64%	None Detected ND

Sampled by: Client

Analyzed by: Matthew McCallum

Reviewed by: Matt Macfarlane

Date: 10/08/2018

Date: 10/08/2018

Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle
Address 1111 3rd Avenue Ste. 1600
 Seattle, WA 98101
Project Manager Ms. Nicole Gladu
Phone (206) 438-2700
Cell (206) 240-0644
NVL Batch Number 1819445.00
TAT 4 Days **AH** No
Rush TAT
Due Date 10/8/2018 **Time** 5:00 PM
Email nicole.gladu@aecom.com
Fax (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Aerator

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 6

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099616	IGDAE-1-01		A
2	18099617	IGDAE-1-02		A
3	18099618	IGDAE-1-03		A
4	18100184	IGDAE-2-01		A
5	18100185	IGDAE-2-02		A
6	18100186	IGDAE-2-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Matthew McCallum		NVL	10/8/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 9:40 AM

Entered By: Emily Schubert



ASBESTOS CHAIN OF CUSTODY

1819445

Turn Around Time

- | | | |
|----------------------------------|-----------------------------------|----------------------------------|
| <input type="checkbox"/> 1 Hour | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 4 Days |
| <input type="checkbox"/> 2 Hours | <input type="checkbox"/> 2 Days | <input type="checkbox"/> 5 Days |
| <input type="checkbox"/> 4 Hours | <input type="checkbox"/> 3 Days | <input type="checkbox"/> 10 Days |

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation
Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
Phone 206.438.2700

Project Manager Nicole Gladu
Cell (206) 240 - 0644
Email nicole.gladu@aecom.com
Fax (866) 495 - 5288

Project Name/Number <u>60537920 Task 2.4</u>	Project Location <u>IGD AERATOR</u>
<input type="checkbox"/> PCM Air (NIOSH 7400) <input type="checkbox"/> TEM (NIOSH 7402) <input type="checkbox"/> TEM (AHERA) <input type="checkbox"/> TEM (EPA Level II Modified)	
<input checked="" type="checkbox"/> PLM (EPA 600/R-93-116) <input type="checkbox"/> EPA 400 Points (600/R-93-116) <input type="checkbox"/> EPA 1000 Points (600/R-93-116)	
<input type="checkbox"/> PLM Gravimetry (600/R-93-116) <input type="checkbox"/> Asbestos in Vermiculite (EPA 600/R-04/004) <input type="checkbox"/> Asbestos in Sediment (EPA 1900 Points)	
<input type="checkbox"/> Asbestos Friable/Non-Friable (EPA 600/R-93/116) <input type="checkbox"/> Other _____	

Reporting Instructions email Nicole Gladu
☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 3

Sample ID	Description	A/R
1 <u>IGDAE-1-01</u>		
2 <u>" - 1-02</u>		
3 <u>" - 1-03</u>		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

	Print Name	Signature	Company	Date	Time
Sampled by	<u>David Simon, CAC</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>9/14/18</u>	<u>8am-4pm</u>
Relinquish by	<u>Shannon MacKay</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>10/2/18</u>	<u>5pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/2/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					

Emily Schubert

From: MacKay, Shannon <shannon.mackay@aecom.com>
Sent: Wednesday, October 03, 2018 4:05 PM
To: Client Services
Subject: RE: Extra Samples

Please add the three samples to the COC, exactly as labeled below.
Thanks!

Shannon MacKay
Sr. Environmental Scientist, Environmental Compliance
D 206-438-2232 C 206-999-2112
shannon.mackay@aecom.com

AECOM
1111 3rd Avenue, Suite 1600 Seattle, WA 98101
206-438-2700 Fax 866-438-2166
www.aecom.com

From: Client Services [<mailto:ClientServices@nvlabs.com>]
Sent: Wednesday, October 03, 2018 4:03 PM
To: MacKay, Shannon
Cc: Client Services
Subject: Extra Samples

Good afternoon,

In reference to the attached COC we received 3 extra samples in this batch that are not listed on the COC.

Please confirm if you would like to add these sample to the existing COC or we can dispose of them for you.

1. IGDAE-2-01
2. IGDAE-2-02
3. IGDAE-2-03

Your samples will be placed on hold until we receive confirmation for these samples. Please let us know if you have any other questions or concerns.

Thanks & Regards,

Client Services



www.nvlabs.com
ph: 206.547.0100 | fax: 206.634.1936

December 28, 2018



Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1825181.01

Client Project: 60537920 Task 2.4
Location: N-A

Dear Ms. Gladu,

Enclosed please find test results for the 2 sample(s) submitted to our laboratory for analysis on 12/21/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read 'Matt Macfarlane'.

Matt Macfarlane, Asbestos Lab Supervisor

The logo for NVLAP (National Voluntary Laboratory Accreditation Program). It features the letters 'NVLAP' in a large, stylized, outlined font. The 'A' is particularly large and has a unique shape.

Lab Code: 102063-0

Enc.: Sample Results

Phone: 206.547.0100 | Fax: 206.634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: N-A

Batch #: 1825181.01

Client Project #: 60537920 Task 2.4

Date Received: 12/21/2018

Samples Received: 2

Samples Analyzed: 2

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18129768 Client Sample #: IGDCB-1-04

Location: N-A

Layer 1 of 2 Description: Gray sheet vinyl

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Vinyl/Binder, Fine particles, Synthetic foam	None Detected ND	None Detected ND

Layer 2 of 2 Description: Gray fibrous material with yellow soft mastic

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Mastic/Binder, Fine particles	Cellulose 40%	None Detected ND
	Glass fibers 20%	
	Synthetic fibers <1%	

Lab ID: 18129769 Client Sample #: IGDCB-2-04

Location: N-A

Layer 1 of 2 Description: Gray rubbery material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Vinyl/Binder, Fine particles	None Detected ND	None Detected ND

Layer 2 of 2 Description: White soft mastic

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Mastic/Binder, Fine particles, Wood flakes	Cellulose 2%	None Detected ND
Insect parts		

Sampled by: Client

Analyzed by: Tiffany Cummings

Reviewed by: Matt Macfarlane

Date: 12/26/2018

Date: 12/28/2018

Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company AECOM-Seattle
Address 1111 3rd Avenue Ste. 1600
 Seattle, WA 98101
Project Manager Ms. Nicole Gladu
Phone (206) 438-2700
Cell (206) 240-0644
NVL Batch Number 1825181.00
TAT 1 Day **AH** No
Rush TAT
Due Date 12/26/2018 **Time** 4:55 PM
Email nicole.gladu@aecom.com
Fax (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 2

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18129768	IGDCB-1-04		A
2	18129769	IGDCB-2-04		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	12/21/18	1655
Analyzed by	Tiffany Cummings		NVL	12/26/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 12/26/2018
 Time: 10:52 AM
 Entered By: Shaina Mitchell



ASBESTOS CHAIN OF CUSTODY

Turn Around Tim.

☐ 1 Hour
☐ 2 Hours
☐ 4 Hours
☒ 24 Hours
☐ 2 Days
☐ 3 Days

dm
☐ 4 Days
☐ 5 Days
☐ 10 Days

Please call for TAT less than 24 Hours

1825181

Laboratory | Management | Training

Company AECOM Corporation
Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
Phone 206.438.2700

Project Manager Nicole Gladu
Cell (206) 240 - 0644
Email nicole.gladu@aecom.com
Fax (866) 495 - 5288

Project Name/Number 60537920 Task 2.4 Project Location

- ☐ PCM Air (NIOSH 7400) ☐ TEM (NIOSH 7402) ☐ TEM (AHERA) ☐ TEM (EPA Level II Modified)
☒ PLM (EPA 600/R-93-116) ☐ EPA 400 Points (600/R-93-116) ☐ EPA 1000 Points (600/R-93-116)
☐ PLM Gravimetry (600/R-93-116) ☐ Asbestos in Vermiculite (EPA 600/R-04/004) ☐ Asbestos in Sediment (EPA 1900 Points)
☐ Asbestos Friable/Non-Friable (EPA 600/R-93/116) ☐ Other

Reporting Instructions email Nicole Gladu

☐ Call ☐ Fax ☒ Email shannon.mackay@aecom.com

Total Number of Samples 2

	Sample ID	Description	A/R
1	IGDCB-1-04		
2	IGDCB-2-04		
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	David Simon, CAC	<i>David Simon</i>	AECOM	12/19/18	2pm
Relinquish by	Shannon MacKay	<i>Shannon MacKay</i>	AECOM	12/21/18	6pm

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	S. Mitchell	<i>S. Mitchell</i>	NVL	12/21/18	1655
Analyzed by					
Called by					
Faxed/Email by					

October 8, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819479.00

Client Project: 60537920 Task 2.4
Location: IGD Communications Bldg

Dear Ms. Gladu,

Enclosed please find test results for the 9 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Nick Ly".

Nick Ly, Technical Director



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Communications Bldg

Batch #: 1819479.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099801 Client Sample #: IGDCB-1-01

Location: IGD Communications Bldg

Layer 1 of 3 Description: Gray vinyl

Non-Fibrous Materials:
Vinyl/Binder, Calcareous particles

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Layer 2 of 3 Description: Gray fibrous backing

Non-Fibrous Materials:
Binder/Filler, Fine particles

Other Fibrous Materials:%
Cellulose 34%
Glass fibers 25%

Asbestos Type: %
None Detected ND

Layer 3 of 3 Description: Tan firm mastic

Non-Fibrous Materials:
Mastic/Binder, Insect parts, Fine particles
Calcareous particles, Wood flakes, Fine grains

Other Fibrous Materials:%
Cellulose 3%
Synthetic fibers <1%
Glass fibers <1%

Asbestos Type: %
None Detected ND

Lab ID: 18099802 Client Sample #: IGDCB-1-02

Location: IGD Communications Bldg

Layer 1 of 3 Description: Gray vinyl

Non-Fibrous Materials:
Vinyl/Binder, Calcareous particles

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Layer 2 of 3 Description: Gray fibrous backing

Non-Fibrous Materials:
Binder/Filler, Fine particles, Calcareous particles

Other Fibrous Materials:%
Cellulose 35%
Glass fibers 26%

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: William Minor

Reviewed by: Nick Ly

Date: 10/08/2018

Date: 10/08/2018



Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Communications Bldg

Batch #: 1819479.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Layer 3 of 3	Description: Tan brittle mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder, Fine particles, Insect parts	Cellulose 3%		None Detected ND
	Wood flakes, Fine grains, Calcareous particles	Glass fibers 2%		
		Synthetic fibers <1%		

Lab ID: 18099803 Client Sample #: IGDCB-1-03

Location: IGD Communications Bldg

Layer 1 of 2	Description: Gray vinyl			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Vinyl/Binder, Calcareous particles	None Detected ND		None Detected ND

Layer 2 of 2	Description: Gray fibrous backing with tan mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder, Fine grains, Fine particles	Cellulose 36%		None Detected ND
	Fine grains, Calcareous particles	Glass fibers 26%		

Lab ID: 18099804 Client Sample #: IGDCB-2-01

Location: IGD Communications Bldg

Layer 1 of 1	Description: Gray rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Vinyl/Binder	None Detected ND		None Detected ND

Lab ID: 18099805 Client Sample #: IGDCB-2-02

Location: IGD Communications Bldg

Layer 1 of 2	Description: Gray rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Vinyl/Binder	None Detected ND		None Detected ND

Sampled by: Client

Analyzed by: William Minor

Reviewed by: Nick Ly

Date: 10/08/2018

Date: 10/08/2018



Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Communications Bldg

Batch #: 1819479.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Layer 2 of 2	Description: White firm mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder, Calcareous particles, Fine particles	Cellulose 2%		None Detected ND
		Synthetic fibers <1%		
		Spider silk <1%		

Lab ID: 18099806 Client Sample #: IGDCB-2-03

Location: IGD Communications Bldg

Layer 1 of 2	Description: Gray rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Vinyl/Binder	None Detected ND		None Detected ND

Layer 2 of 2	Description: White firm mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder, Calcareous particles, Fine particles	Cellulose 2%		None Detected ND

Lab ID: 18099807 Client Sample #: IGDCB-3-01

Location: IGD Communications Bldg

Layer 1 of 3	Description: White compacted powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Calcareous binder, Calcareous particles	Cellulose <1%		None Detected ND

Layer 2 of 3	Description: White compacted powdery material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Calcareous binder, Calcareous particles	Cellulose 2%		None Detected ND

Layer 3 of 3	Description: Peach chalky material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Gypsum/Binder, Fine particles, Metal	Cellulose 22%		None Detected ND

Sampled by: Client

Analyzed by: William Minor

Reviewed by: Nick Ly

Date: 10/08/2018

Date: 10/08/2018



Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Communications Bldg

Batch #: 1819479.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Glass fibers 2%

Lab ID: 18099808 Client Sample #: IGDCB-3-02

Location: IGD Communications Bldg

Layer 1 of 3 Description: White compacted powdery material

Non-Fibrous Materials: Other Fibrous Materials:%

Calcareous binder, Calcareous particles Cellulose 2%

Asbestos Type: %

None Detected ND

Layer 2 of 3 Description: White compacted powdery material with paper

Non-Fibrous Materials: Other Fibrous Materials:%

Calcareous binder, Calcareous particles Cellulose 2%

Asbestos Type: %

None Detected ND

Layer 3 of 3 Description: Peach chalky material with paper & paint

Non-Fibrous Materials: Other Fibrous Materials:%

Gypsum/Binder, Fine particles Cellulose 24%

Asbestos Type: %

None Detected ND

Glass fibers 3%

Lab ID: 18099809 Client Sample #: IGDCB-3-03

Location: IGD Communications Bldg

Comments: Unsure of correct layer sequence.

Layer 1 of 4 Description: White compacted powdery material

Non-Fibrous Materials: Other Fibrous Materials:%

Calcareous binder, Calcareous particles Cellulose 2%

Asbestos Type: %

None Detected ND

Layer 2 of 4 Description: White chalky material with paper

Non-Fibrous Materials: Other Fibrous Materials:%

Gypsum/Binder Cellulose 18%

Asbestos Type: %

None Detected ND

Glass fibers 3%

Sampled by: Client

Analyzed by: William Minor

Reviewed by: Nick Ly

Date: 10/08/2018

Date: 10/08/2018



Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Communications Bldg

Batch #: 1819479.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Layer 3 of 4	Description: White compacted powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Calcareous binder, Calcareous particles	Cellulose <1%		None Detected ND
Layer 4 of 4	Description: Peach chalky material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Gypsum/Binder, Fine particles	Cellulose 22%		None Detected ND
		Glass fibers 3%		

Sampled by: Client

Analyzed by: William Minor

Reviewed by: Nick Ly

Date: 10/08/2018

Date: 10/08/2018



Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle **NVL Batch Number** 1819479.00
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Communications Bldg

Subcategory PLM Bulk

Item Code ASB-02 **EPA 600/R-93-116 Asbestos by PLM <bulk>**

Total Number of Samples 9

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099801	IGDCB-1-01		A
2	18099802	IGDCB-1-02		A
3	18099803	IGDCB-1-03		A
4	18099804	IGDCB-2-01		A
5	18099805	IGDCB-2-02		A
6	18099806	IGDCB-2-03		A
7	18099807	IGDCB-3-01		A
8	18099808	IGDCB-3-02		A
9	18099809	IGDCB-3-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	William Minor		NVL	10/8/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 11:11 AM

Entered By: Emily Schubert



ASBESTOS CHAIN OF CUSTODY

1819479

Turn Around Time

- | | | |
|----------------------------------|-----------------------------------|----------------------------------|
| <input type="checkbox"/> 1 Hour | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 4 Days |
| <input type="checkbox"/> 2 Hours | <input type="checkbox"/> 2 Days | <input type="checkbox"/> 5 Days |
| <input type="checkbox"/> 4 Hours | <input type="checkbox"/> 3 Days | <input type="checkbox"/> 10 Days |

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation
Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
Phone 206.438.2700

Project Manager Nicole Gladu
Cell (206) 240 - 0644
Email nicole.gladu@aecom.com
Fax (866) 495 - 5288

Project Name/Number 60537920 Task 2.4 Project Location IQD COMMUNICATIONS BLDG.

- | | | | |
|--|---|---|--|
| <input type="checkbox"/> PCM Air (NIOSH 7400) | <input type="checkbox"/> TEM (NIOSH 7402) | <input type="checkbox"/> TEM (AHERA) | <input type="checkbox"/> TEM (EPA Level II Modified) |
| <input checked="" type="checkbox"/> PLM (EPA 600/R-93-116) | <input type="checkbox"/> EPA 400 Points (600/R-93-116) | <input type="checkbox"/> EPA 1000 Points (600/R-93-116) | |
| <input type="checkbox"/> PLM Gravimetry (600/R-93-116) | <input type="checkbox"/> Asbestos in Vermiculite (EPA 600/R-04/004) | <input type="checkbox"/> Asbestos in Sediment (EPA 1900 Points) | |
| <input type="checkbox"/> Asbestos Friable/Non-Friable (EPA 600/R-93/116) | <input type="checkbox"/> Other | | |

Reporting Instructions email Nicole Gladu EMAIL EDD ALONG WITH RESULTS
☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 9

	Sample ID	Description	A/R
1	<u>IGDCB-1-01</u>		
2	<u>11 -1-02</u>		
3	<u>11 -1-03</u>		
4	<u>11 -2-01</u>		
5	<u>11 -2-02</u>		
6	<u>11 -2-03</u>		
7	<u>11 -3-01</u>		
8	<u>11 -3-02</u>		
9	<u>11 -3-03</u>		
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	<u>David Simon, CAC</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>9/14/18</u>	<u>8am - 4pm</u>
Relinquish by	<u>Shannon MacKay</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>10/02/18</u>	<u>5:00pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/12/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					

October 8, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819458.00

Client Project: 60537920 Task 2.4
Location: IGD Diversion Tunnel Intake

Dear Ms. Gladu,

Enclosed please find test results for the 6 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Matt Macfarlane".

Matt Macfarlane, Asbestos Lab Supervisor



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Diversion Tunnel Intake

Batch #: 1819458.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 6

Samples Analyzed: 6

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099686 Client Sample #: IGDDTI-1-01

Location: IGD Diversion Tunnel Intake

Layer 1 of 1 Description: Off-white crumbly material

Non-Fibrous Materials:
Binder/Filler, Calcareous particles, Fine grains

Other Fibrous Materials:%
Cellulose 3%

Asbestos Type: %
Chrysotile 5%

Lab ID: 18099687 Client Sample #: IGDDTI-1-02

Location: IGD Diversion Tunnel Intake

Layer 1 of 1 Description: Gray crumbly material

Non-Fibrous Materials:
Binder/Filler, Calcareous particles, Fine grains

Other Fibrous Materials:%
Cellulose 2%
Spider silk 2%

Asbestos Type: %
Chrysotile 6%

Lab ID: 18099688 Client Sample #: IGDDTI-1-03

Location: IGD Diversion Tunnel Intake

Layer 1 of 2 Description: Silver paint

Non-Fibrous Materials:
Paint

Other Fibrous Materials:%
Cellulose 1%

Asbestos Type: %
None Detected ND

Layer 2 of 2 Description: Gray crumbly material

Non-Fibrous Materials:
Binder/Filler, Calcareous particles, Fine grains

Other Fibrous Materials:%
Cellulose 2%

Asbestos Type: %
Chrysotile 6%

Lab ID: 18099689 Client Sample #: IGDDTI-2-01

Location: IGD Diversion Tunnel Intake

Layer 1 of 1 Description: Beige rubbery material

Non-Fibrous Materials:
Rubber/Binder, Fine particles

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: Akane Yoshikawa

Reviewed by: Matt Macfarlane

Date: 10/08/2018

Date: 10/08/2018

Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Diversion Tunnel Intake

Batch #: 1819458.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 6

Samples Analyzed: 6

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099690 Client Sample #: IGDDTI-2-02

Location: IGD Diversion Tunnel Intake

Layer 1 of 1 Description: Beige rubbery material

Non-Fibrous Materials:
Rubber/Binder, Fine particles, Insect parts

Other Fibrous Materials:%
Spider silk 2%

Asbestos Type: %
None Detected ND

Lab ID: 18099691 Client Sample #: IGDDTI-2-03

Location: IGD Diversion Tunnel Intake

Layer 1 of 1 Description: Beige rubbery material

Non-Fibrous Materials:
Rubber/Binder, Fine particles

Other Fibrous Materials:%
Synthetic fibers 3%

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: Akane Yoshikawa

Reviewed by: Matt Macfarlane

Date: 10/08/2018

Date: 10/08/2018


Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle **NVL Batch Number** **1819458.00**
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Diversion Tunnel Intake

Subcategory PLM Bulk

Item Code ASB-02 **EPA 600/R-93-116 Asbestos by PLM <bulk>**

Total Number of Samples 6

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099686	IGDDTI-1-01		A
2	18099687	IGDDTI-1-02		A
3	18099688	IGDDTI-1-03		A
4	18099689	IGDDTI-2-01		A
5	18099690	IGDDTI-2-02		A
6	18099691	IGDDTI-2-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Akane Yoshikawa		NVL	10/8/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 10:10 AM

Entered By: Shaina Mitchell



ASBESTOS CHAIN OF CUSTODY

1819458

Turn Around Time

- | | | |
|----------------------------------|-----------------------------------|----------------------------------|
| <input type="checkbox"/> 1 Hour | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 4 Days |
| <input type="checkbox"/> 2 Hours | <input type="checkbox"/> 2 Days | <input type="checkbox"/> 5 Days |
| <input type="checkbox"/> 4 Hours | <input type="checkbox"/> 3 Days | <input type="checkbox"/> 10 Days |

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation

Project Manager Nicole Gladu

Address 1111 3rd Avenue, Suite 1600

Cell (206) 240 - 0644

Seattle, WA 98101

Email nicole.gladu@aecom.com

Phone 206.438.2700

Fax (866) 495 - 5288

Project Name/Number 60537920 Task 2.4

Project Location IGD DIVERSION TUNNEL INTAKE

- | | | | |
|--|---|---|--|
| <input type="checkbox"/> PCM Air (NIOSH 7400) | <input type="checkbox"/> TEM (NIOSH 7402) | <input type="checkbox"/> TEM (AHERA) | <input type="checkbox"/> TEM (EPA Level II Modified) |
| <input checked="" type="checkbox"/> PLM (EPA 600/R-93-116) | <input type="checkbox"/> EPA 400 Points (600/R-93-116) | <input type="checkbox"/> EPA 1000 Points (600/R-93-116) | |
| <input type="checkbox"/> PLM Gravimetry (600/R-93-116) | <input type="checkbox"/> Asbestos in Vermiculite (EPA 600/R-04/004) | <input type="checkbox"/> Asbestos in Sediment (EPA 1900 Points) | |
| <input type="checkbox"/> Asbestos Friable/Non-Friable (EPA 600/R-93/116) | <input type="checkbox"/> Other | | |

Reporting Instructions email Nicole Gladu EMAIL EDD ALONG WITH RESULTS

☐ Call ()

☐ Fax ()

☒ Email shannon.mackay@aecom.com

Total Number of Samples

6

	Sample ID	Description	A/R
1	IGDDTI-1-01		
2	" - 1-02		
3	" - 1-03		
4	" - 2-01		
5	" - 2-02		
6	" - 2-03		
7			
8			
9			
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	David Simon, CAC	<i>David Simon</i>	AECOM	9/17-9/18/18	8am-4pm
Relinquish by	Shannon MacKay	<i>Shannon MacKay</i>	AECOM	10/02/18	5:00pm

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	S. Mitchell	<i>S. Mitchell</i>	NVL	10/12/18	1:00
Analyzed by					
Called by					
Faxed/Email by					

October 8, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819469.00

Client Project: 60537920 Task 2.4
Location: IGP Emergency Spill Equipment Shed

Dear Ms. Gladu,

Enclosed please find test results for the 3 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Matt Macfarlane".

Matt Macfarlane, Asbestos Lab Supervisor



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGP Emergency Spill Equipment Shed

Batch #: 1819469.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 3

Samples Analyzed: 3

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099731 Client Sample #: IGDES-1-01

Location: IGP Emergency Spill Equipment Shed

Layer 1 of 1 Description: Black asphaltic fibrous material with granules

Non-Fibrous Materials:	Other Fibrous Materials: %
Asphalt/Binder, Granules, Fine grains	Glass fibers 60%

Asbestos Type: %
None Detected ND

Lab ID: 18099732 Client Sample #: IGDES-1-02

Location: IGP Emergency Spill Equipment Shed

Layer 1 of 1 Description: Black asphaltic fibrous material with granules

Non-Fibrous Materials:	Other Fibrous Materials: %
Asphalt/Binder, Granules, Fine particles	Glass fibers 63%

Asbestos Type: %
None Detected ND

Lab ID: 18099733 Client Sample #: IGDES-1-03

Location: IGP Emergency Spill Equipment Shed

Layer 1 of 1 Description: Black asphaltic fibrous material with granules

Non-Fibrous Materials:	Other Fibrous Materials: %
Asphalt/Binder, Granules, Fine particles	Glass fibers 62%

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: Michael Jenkins

Reviewed by: Matt Macfarlane

Date: 10/08/2018

Date: 10/08/2018


Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle **NVL Batch Number** **1819469.00**
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGP Emergency Spill Equipment Shed

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 3

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099731	IGDES-1-01		A
2	18099732	IGDES-1-02		A
3	18099733	IGDES-1-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Michael Jenkins		NVL	10/8/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 10:45 AM

Entered By: Shaina Mitchell



ASBESTOS CHAIN OF CUSTODY

1819469

Turn Around Time

- ☐ 1 Hour ☐ 24 Hours ☐ 4 Days
☐ 2 Hours ☐ 2 Days ☐ 5 Days
☐ 4 Hours ☐ 3 Days ☐ 10 Days

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation
Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
Phone 206.438.2700

Project Manager Nicole Gladu
Cell (206) 240 - 0644
Email nicole.gladu@aecom.com
Fax (866) 495 - 5288

Project Name/Number	60537920 Task 2.4	Project Location	IGP EMERGENCY SPILL EQUIPMENT SHED
<input type="checkbox"/> PCM Air (NIOSH 7400)	<input type="checkbox"/> TEM (NIOSH 7402)	<input type="checkbox"/> TEM (AHERA)	<input type="checkbox"/> TEM (EPA Level II Modified)
<input checked="" type="checkbox"/> PLM (EPA 600/R-93-116)	<input type="checkbox"/> EPA 400 Points (600/R-93-116)	<input type="checkbox"/> EPA 1000 Points (600/R-93-116)	
<input type="checkbox"/> PLM Gravimetry (600/R-93-116)	<input type="checkbox"/> Asbestos in Vermiculite (EPA 600/R-04/004)	<input type="checkbox"/> Asbestos in Sediment (EPA 1900 Points)	
<input type="checkbox"/> Asbestos Friable/Non-Friable (EPA 600/R-93/116)	<input type="checkbox"/> Other		

Reporting Instructions email Nicole Gladu

☐ Call ☐ Fax ☒ Email shannon.mackay@aecom.com

Total Number of Samples 3

Sample ID	Description	A/R
1 IGDES-1-01		
2 " - 1-02		
3 " - 1-03		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

	Print Name	Signature	Company	Date	Time
Sampled by	David Simon, CAC		AECOM	9/14/18	8am-4pm
Relinquish by	Shannon MacKay		AECOM	10/2/18	5pm

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	S. Mitchell		NVL	10/2/18	1700
Analyzed by			NVL	10/19/18	1200
Called by					
Faxed/Email by					

October 8, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819460.00

Client Project: 60537920 Task 2.4
Location: IGD Fish Holding Facilities

Dear Ms. Gladu,

Enclosed please find test results for the 3 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Matt Macfarlane".

Matt Macfarlane, Asbestos Lab Supervisor



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Fish Holding Facilities

Batch #: 1819460.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 3

Samples Analyzed: 3

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099704 Client Sample #: IGDFHF-1-01

Location: IGD Fish Holding Facilities

Layer 1 of 1 Description: Gray soft material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Putty Compound, Fine particles	Cellulose 1%	Chrysotile 4%

Lab ID: 18099705 Client Sample #: IGDFHF-1-02

Location: IGD Fish Holding Facilities

Layer 1 of 1 Description: Gray soft material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Putty Compound, Fine particles	Cellulose <1%	Chrysotile 6%

Lab ID: 18099706 Client Sample #: IGDFHF-1-03

Location: IGD Fish Holding Facilities

Layer 1 of 1 Description: Gray soft material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Putty Compound, Fine particles	Cellulose <1%	Chrysotile 4%

Sampled by: Client

Analyzed by: Matthew McCallum

Reviewed by: Matt Macfarlane

Date: 10/08/2018

Date: 10/08/2018


Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle **NVL Batch Number** **1819460.00**
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Fish Holding Facilities

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 3

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099704	IGDFHF-1-01		A
2	18099705	IGDFHF-1-02		A
3	18099706	IGDFHF-1-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Matthew McCallum		NVL	10/8/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 10:12 AM

Entered By: Shaina Mitchell



ASBESTOS CHAIN OF CUSTODY

1819460

Turn Around Time

- | | | |
|----------------------------------|-----------------------------------|----------------------------------|
| <input type="checkbox"/> 1 Hour | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 4 Days |
| <input type="checkbox"/> 2 Hours | <input type="checkbox"/> 2 Days | <input type="checkbox"/> 5 Days |
| <input type="checkbox"/> 4 Hours | <input type="checkbox"/> 3 Days | <input type="checkbox"/> 10 Days |

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation
Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
Phone 206.438.2700

Project Manager Nicole Gladu
Cell (206) 240 - 0644
Email nicole.gladu@aecom.com
Fax (866) 495 - 5288

Project Name/Number 60537920 Task 2.4 Project Location IDG FISH HOLDING FACILITIES

- | | | | |
|--|---|---|--|
| <input type="checkbox"/> PCM Air (NIOSH 7400) | <input type="checkbox"/> TEM (NIOSH 7402) | <input type="checkbox"/> TEM (AHERA) | <input type="checkbox"/> TEM (EPA Level II Modified) |
| <input checked="" type="checkbox"/> PLM (EPA 600/R-93-116) | <input type="checkbox"/> EPA 400 Points (600/R-93-116) | <input type="checkbox"/> EPA 1000 Points (600/R-93-116) | |
| <input type="checkbox"/> PLM Gravimetry (600/R-93-116) | <input type="checkbox"/> Asbestos in Vermiculite (EPA 600/R-04/004) | <input type="checkbox"/> Asbestos in Sediment (EPA 1900 Points) | |
| <input type="checkbox"/> Asbestos Friable/Non-Friable (EPA 600/R-93/116) | | <input type="checkbox"/> Other _____ | |

Reporting Instructions email Nicole Gladu EMAIL EDD ALONG WITH RESULTS
☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 3

Sample ID	Description	A/R
1 <u>101 IDG FHF-1-01</u>		
2 <u>" - 1-02</u>		
3 <u>" - 1-03</u>		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

	Print Name	Signature	Company	Date	Time
Sampled by	David Simon, CAC	<i>David Simon</i>	AECOM	9/17-9/18/18	8am-4pm
Relinquish by	Shannon MacKay	<i>Shannon MacKay</i>	AECOM	10/02/18	5:00pm

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<i>S. Mitchell</i>	<i>SM</i>	NVL	10/2/18	1700
Analyzed by					
Called by					
Faxed/Email by					

October 5, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819456.00

Client Project: 60537920 Task 2.4
Location: IGD Penstock Intake Structure

Dear Ms. Gladu,

Enclosed please find test results for the 9 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Matt Macfarlane".

Matt Macfarlane, Asbestos Lab Supervisor



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Penstock Intake Structure

Batch #: 1819456.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099657 **Client Sample #: IGDPIS-1-01**

Location: IGD Penstock Intake Structure

Layer 1 of 1 **Description:** Gray putty material

Non-Fibrous Materials:

Putty Compound, Calcareous particles

Other Fibrous Materials: %

None Detected ND

Asbestos Type: %

Chrysotile 5%

Lab ID: 18099658 **Client Sample #: IGDPIS-1-02**

Location: IGD Penstock Intake Structure

Layer 1 of 1 **Description:** Gray putty material

Non-Fibrous Materials:

Putty Compound, Calcareous particles

Other Fibrous Materials: %

None Detected ND

Asbestos Type: %

Chrysotile 4%

Lab ID: 18099659 **Client Sample #: IGDPIS-1-03**

Location: IGD Penstock Intake Structure

Layer 1 of 1 **Description:** Gray putty material with paint

Non-Fibrous Materials:

Putty Compound, Calcareous particles

Other Fibrous Materials: %

Cellulose <1%

Asbestos Type: %

Chrysotile 4%

Lab ID: 18099660 **Client Sample #: IGDPIS-2-01**

Location: IGD Penstock Intake Structure

Layer 1 of 2 **Description:** Tan soft elastic material with paint

Non-Fibrous Materials:

Caulking compound, Paint

Other Fibrous Materials: %

None Detected ND

Asbestos Type: %

None Detected ND

Layer 2 of 2 **Description:** Gray brittle material

Non-Fibrous Materials:

Mineral grains, Fine particles

Other Fibrous Materials: %

None Detected ND

Asbestos Type: %

None Detected ND

Lab ID: 18099661 **Client Sample #: IGDPIS-2-02**

Location: IGD Penstock Intake Structure

Sampled by: Client

Analyzed by: Welly Hsieh

Reviewed by: Matt Macfarlane

Date: 10/05/2018

Date: 10/05/2018

Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Penstock Intake Structure

Batch #: 1819456.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Layer 1 of 1	Description: Tan soft elastic material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %	
	Caulking compound, Paint, Rust	None Detected ND	None Detected ND	

Lab ID: 18099662 **Client Sample #: IGDPIS-2-03**

Location: IGD Penstock Intake Structure

Layer 1 of 1	Description: Tan soft elastic material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %	
	Caulking compound, Paint, Rust	None Detected ND	None Detected ND	

Lab ID: 18099663 **Client Sample #: IGDPIS-3-01**

Location: IGD Penstock Intake Structure

Layer 1 of 1	Description: Off-white soft elastic material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %	
	Caulking compound, Calcareous particles, Paint	None Detected ND	None Detected ND	

Lab ID: 18099664 **Client Sample #: IGDPIS-3-02**

Location: IGD Penstock Intake Structure

Layer 1 of 2	Description: Beige soft material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %	
	Caulking compound, Paint, Calcareous particles	Cellulose <1%	None Detected ND	

Layer 2 of 2	Description: White compacted powdery material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %	
	Calcareous binder, Paint	None Detected ND	None Detected ND	

Lab ID: 18099665 **Client Sample #: IGDPIS-3-03**

Location: IGD Penstock Intake Structure

Sampled by: Client

Analyzed by: Welly Hsieh

Reviewed by: Matt Macfarlane

Date: 10/05/2018

Date: 10/05/2018

Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Penstock Intake Structure

Batch #: 1819456.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Layer 1 of 1 **Description:** Off-white soft elastic material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %
Caulking compound, Calcareous particles, Paint	Cellulose <1%

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: Welly Hsieh

Reviewed by: Matt Macfarlane

Date: 10/05/2018

Date: 10/05/2018


Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle **NVL Batch Number** 1819456.00
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Penstock Intake Structure

Subcategory PLM Bulk

Item Code ASB-02 **EPA 600/R-93-116 Asbestos by PLM <bulk>**

Total Number of Samples 9

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099657	IGDPIS-1-01		A
2	18099658	IGDPIS-1-02		A
3	18099659	IGDPIS-1-03		A
4	18099660	IGDPIS-2-01		A
5	18099661	IGDPIS-2-02		A
6	18099662	IGDPIS-2-03		A
7	18099663	IGDPIS-3-01		A
8	18099664	IGDPIS-3-02		A
9	18099665	IGDPIS-3-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Welly Hsieh		NVL	10/5/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 10:05 AM

Entered By: Shaina Mitchell

1819456



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- ☐ 1 Hour ☐ 24 Hours ☐ 4 Days
☐ 2 Hours ☐ 2 Days ☐ 5 Days
☐ 4 Hours ☐ 3 Days ☐ 10 Days

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation
 Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
 Phone 206.438.2700

Project Manager Nicole Gladu
 Cell (206) 240 - 0644
 Email nicole.gladu@aecom.com
 Fax (866) 495 - 5288

Project Name/Number 60537920 Task 2.4 Project Location IGD PENSTOCK INTAKE STRUCTURE

- ☐ PCM Air (NIOSH 7400) ☐ TEM (NIOSH 7402) ☐ TEM (AHERA) ☐ TEM (EPA Level II Modified)
☒ PLM (EPA 600/R-93-116) ☐ EPA 400 Points (600/R-93-116) ☐ EPA 1000 Points (600/R-93-116)
☐ PLM Gravimetry (600/R-93-116) ☐ Asbestos in Vermiculite (EPA 600/R-04/004) ☐ Asbestos in Sediment (EPA 1900 Points)
☐ Asbestos Friable/Non-Friable (EPA 600/R-93/116) ☐ Other _____

Reporting Instructions email Nicole Gladu EMAIL ADD ALONG WITH RESULTS
☐ Call _____ ☐ Fax _____ ☒ Email shannon.mackay@aecom.com

Total Number of Samples

9

	Sample ID	Description	A/R
1	IGDPIS -1-01		
2	" - 1-02		
3	" - 1-03		
4	" - 2-01		
5	" - 2-02		
6	" - 2-03		
7	" - 3-01		
8	" - 3-02		
9	" - 3-03		
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	David Simon, CAC	<i>David Simon</i>	AECOM	9/17/18-9/18/18	8am-4pm
Relinquish by	Shannon MacKay	<i>Shannon MacKay</i>	AECOM	10/02/18	5:00pm

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	S. Mitchell	<i>S. Mitchell</i>	NVL	10/2/18	1:00
Analyzed by					
Called by					
Faxed/Email by					

October 8, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819446.00

Client Project: 60537920 Task 2.4
Location: IGD Penstock

Dear Ms. Gladu,

Enclosed please find test results for the 12 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Matt Macfarlane".

Matt Macfarlane, Asbestos Lab Supervisor



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Penstock

Batch #: 1819446.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 12

Samples Analyzed: 12

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099619 Client Sample #: IGDPs-1-01

Location: IGD Penstock

Layer 1 of 1 Description: Black asphaltic mastic

Non-Fibrous Materials:
Asphalt/Binder, Miscellaneous particles

Other Fibrous Materials:%
Glass fibers 4%

Asbestos Type: %
None Detected ND

Lab ID: 18099620 Client Sample #: IGDPs-1-02

Location: IGD Penstock

Layer 1 of 1 Description: Black asphaltic mastic

Non-Fibrous Materials:
Asphalt/Binder, Miscellaneous particles

Other Fibrous Materials:%
Glass fibers 5%

Asbestos Type: %
None Detected ND

Lab ID: 18099621 Client Sample #: IGDPs-1-03

Location: IGD Penstock

Layer 1 of 1 Description: Black asphaltic mastic

Non-Fibrous Materials:
Asphalt/Binder, Miscellaneous particles

Other Fibrous Materials:%
Glass fibers 4%

Asbestos Type: %
None Detected ND

Lab ID: 18099622 Client Sample #: IGDPs-2-01

Location: IGD Penstock

Layer 1 of 2 Description: Silver-colored reflective coating with paint

Non-Fibrous Materials:
Binder/Filler, Metal, Paint

Other Fibrous Materials:%
Cellulose 1%

Asbestos Type: %
None Detected ND

Layer 2 of 2 Description: Black asphaltic mastic

Non-Fibrous Materials:
Asphalt/Binder, Miscellaneous particles

Other Fibrous Materials:%
Cellulose 6%

Asbestos Type: %
None Detected ND

Lab ID: 18099623 Client Sample #: IGDPs-2-02

Location: IGD Penstock


Sampled by: Client

Analyzed by: Daniel Charbonneaux

Reviewed by: Matt Macfarlane

Date: 10/06/2018

Date: 10/08/2018


Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Penstock

Batch #: 1819446.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 12

Samples Analyzed: 12

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Layer 1 of 2	Description: Silver-colored reflective coating with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Binder/Filler, Metal, Paint	Cellulose 2%	
Layer 2 of 2	Description: Black asphaltic mastic	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Asphalt/Binder, Miscellaneous particles	Cellulose 4%	

Lab ID: 18099624 Client Sample #: IGDPS-2-03

Location: IGD Penstock

Layer 1 of 2	Description: Silver-colored reflective coating with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Binder/Filler, Metal, Paint	Cellulose 1%	
Layer 2 of 2	Description: Black asphaltic mastic	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Asphalt/Binder, Miscellaneous particles	Cellulose 5%	

Lab ID: 18099625 Client Sample #: IGDPS-3-01

Location: IGD Penstock

Layer 1 of 1	Description: Brown fibrous material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Binder/Filler, Organic debris	Synthetic fibers 75% Cellulose 12%	

Lab ID: 18099626 Client Sample #: IGDPS-3-02

Location: IGD Penstock

Layer 1 of 1	Description: Brown fibrous material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
		Binder/Filler, Organic debris	Synthetic fibers 78%	

Sampled by: Client

Analyzed by: Daniel Charbonneaux

Reviewed by: Matt Macfarlane

Date: 10/06/2018

Date: 10/08/2018

Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Penstock

Batch #: 1819446.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 12

Samples Analyzed: 12

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Cellulose 11%

Lab ID: 18099627 Client Sample #: IGDP5-3-03

Location: IGD Penstock

Layer 1 of 1 Description: Brown fibrous material

Non-Fibrous Materials:
Binder/Filler, Organic debris

Other Fibrous Materials:%
Synthetic fibers 74%
Cellulose 14%

Asbestos Type: %
None Detected ND

Lab ID: 18099628 Client Sample #: IGDP5-6-01

Location: IGD Penstock

Layer 1 of 1 Description: Black asphaltic mastic

Non-Fibrous Materials:
Asphalt/Binder, Miscellaneous particles

Other Fibrous Materials:%
Glass fibers 1%

Asbestos Type: %
None Detected ND

Lab ID: 18099629 Client Sample #: IGDP5-6-02

Location: IGD Penstock

Layer 1 of 1 Description: Black asphaltic mastic

Non-Fibrous Materials:
Asphalt/Binder, Miscellaneous particles

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Lab ID: 18099630 Client Sample #: IGDP5-6-03

Location: IGD Penstock

Layer 1 of 1 Description: Black asphaltic mastic

Non-Fibrous Materials:
Asphalt/Binder, Miscellaneous particles

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: Daniel Charbonneaux

Reviewed by: Matt Macfarlane

Date: 10/06/2018

Date: 10/08/2018


Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle **NVL Batch Number** **1819446.00**
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Penstock

Subcategory PLM Bulk

Item Code ASB-02 **EPA 600/R-93-116 Asbestos by PLM <bulk>**

Total Number of Samples 12

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099619	IGDPS-1-01		A
2	18099620	IGDPS-1-02		A
3	18099621	IGDPS-1-03		A
4	18099622	IGDPS-2-01		A
5	18099623	IGDPS-2-02		A
6	18099624	IGDPS-2-03		A
7	18099625	IGDPS-3-01		A
8	18099626	IGDPS-3-02		A
9	18099627	IGDPS-3-03		A
10	18099628	IGDPS-6-01		A
11	18099629	IGDPS-6-02		A
12	18099630	IGDPS-6-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Daniel		NVL	10/6/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 9:42 AM

Entered By: Emily Schubert



ASBESTOS CHAIN OF CUSTODY

1819446

Turn Around Time

- | | | |
|----------------------------------|-----------------------------------|----------------------------------|
| <input type="checkbox"/> 1 Hour | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 4 Days |
| <input type="checkbox"/> 2 Hours | <input type="checkbox"/> 2 Days | <input type="checkbox"/> 5 Days |
| <input type="checkbox"/> 4 Hours | <input type="checkbox"/> 3 Days | <input type="checkbox"/> 10 Days |

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation
Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
Phone 206.438.2700

Project Manager Nicole Gladu
Cell (206) 240 - 0644
Email nicole.gladu@aecom.com
Fax (866) 495 - 5288

Project Name/Number 60537920 Task 2.4 Project Location SM ~~IGD~~ IGD PENSTOCK

- | | | | |
|--|---|---|--|
| <input type="checkbox"/> PCM Air (NIOSH 7400) | <input type="checkbox"/> TEM (NIOSH 7402) | <input type="checkbox"/> TEM (AHERA) | <input type="checkbox"/> TEM (EPA Level II Modified) |
| <input checked="" type="checkbox"/> PLM (EPA 600/R-93-116) | <input type="checkbox"/> EPA 400 Points (600/R-93-116) | <input type="checkbox"/> EPA 1000 Points (600/R-93-116) | |
| <input type="checkbox"/> PLM Gravimetry (600/R-93-116) | <input type="checkbox"/> Asbestos in Vermiculite (EPA 600/R-04/004) | <input type="checkbox"/> Asbestos in Sediment (EPA 1900 Points) | |
| <input type="checkbox"/> Asbestos Friable/Non-Friable (EPA 600/R-93/116) | <input type="checkbox"/> Other | | |

Reporting Instructions email Nicole Gladu EMAIL EDD ALONG WITH RESULTS
☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 12

	Sample ID	Description	A/R
1	<u>IGDPS-1-01</u>		
2	<u>" -1-02</u>		
3	<u>" -1-03</u>		
4	<u>" -2-01</u>		
5	<u>" -2-02</u>		
6	<u>" -2-03</u>		
7	<u>" -3-01</u>		
8	<u>" -3-02</u>		
9	<u>" -3-03</u>		
10	<u>" -6-01</u>		
11	<u>" -6-02</u>		
12	<u>" -6-03</u>		
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	<u>David Simon, CAC</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>9/14/18</u>	<u>8am-4pm</u>
Relinquish by	<u>Shannon MacKay</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>10/2/18</u>	<u>5:00pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/2/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					

October 5, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819495.00

Client Project: 60537920 Task 2.4
Location: IGD Powerhouse

Dear Ms. Gladu,

Enclosed please find test results for the 9 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Matt Macfarlane".

Matt Macfarlane, Asbestos Lab Supervisor



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Powerhouse

Batch #: 1819495.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099908 Client Sample #: IGDPH-1-01

Location: IGD Powerhouse

Layer 1 of 1 Description: Gray putty material with silver paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Putty Compound, Calcareous particles, Metallic paint	None Detected ND	Chrysotile 4%

Lab ID: 18099909 Client Sample #: IGDPH-1-02

Location: IGD Powerhouse

Layer 1 of 1 Description: Gray putty material with silver paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Putty Compound, Calcareous particles, Metallic paint	None Detected ND	Chrysotile 5%

Lab ID: 18099910 Client Sample #: IGDPH-1-03

Location: IGD Powerhouse

Layer 1 of 1 Description: Gray putty material with silver paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Putty Compound, Calcareous particles, Metallic paint	None Detected ND	Chrysotile 4%

Lab ID: 18099911 Client Sample #: IGDPH-3-01

Location: IGD Powerhouse

Layer 1 of 1 Description: Gray soft elastic material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Caulking compound	None Detected ND	None Detected ND

Lab ID: 18099912 Client Sample #: IGDPH-3-02

Location: IGD Powerhouse

Layer 1 of 1 Description: Gray soft elastic material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Caulking compound, Fine particles	None Detected ND	None Detected ND

Sampled by: Client

Analyzed by: Welly Hsieh

Reviewed by: Matt Macfarlane

Date: 10/05/2018

Date: 10/05/2018

Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Powerhouse

Batch #: 1819495.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 9

Samples Analyzed: 9

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099913 Client Sample #: IGDPH-3-03

Location: IGD Powerhouse

Layer 1 of 1 Description: Gray soft elastic material

Non-Fibrous Materials:
Caulking compound, Synthetic foam

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Lab ID: 18099914 Client Sample #: IGDPH-4-01

Location: IGD Powerhouse

Layer 1 of 1 Description: Brown/clear brittle material

Non-Fibrous Materials:
Binder/Filler

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Lab ID: 18099915 Client Sample #: IGDPH-4-02

Location: IGD Powerhouse

Layer 1 of 1 Description: Brown/clear brittle material

Non-Fibrous Materials:
Binder/Filler, Mineral grains

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Lab ID: 18099916 Client Sample #: IGDPH-4-03

Location: IGD Powerhouse

Layer 1 of 1 Description: Brown/clear brittle material

Non-Fibrous Materials:
Binder/Filler, Mineral grains

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: Welly Hsieh

Reviewed by: Matt Macfarlane

Date: 10/05/2018

Date: 10/05/2018


Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle
Address 1111 3rd Avenue Ste. 1600
 Seattle, WA 98101
Project Manager Ms. Nicole Gladu
Phone (206) 438-2700
Cell (206) 240-0644
NVL Batch Number 1819495.00
TAT 4 Days **AH** No
Rush TAT
Due Date 10/8/2018 **Time** 5:00 PM
Email nicole.gladu@aecom.com
Fax (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Powerhouse

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 9

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099908	IGDPH-1-01		A
2	18099909	IGDPH-1-02		A
3	18099910	IGDPH-1-03		A
4	18099911	IGDPH-3-01		A
5	18099912	IGDPH-3-02		A
6	18099913	IGDPH-3-03		A
7	18099914	IGDPH-4-01		A
8	18099915	IGDPH-4-02		A
9	18099916	IGDPH-4-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Welly Hsieh		NVL	10/5/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 11:50 AM

Entered By: Emily Schubert



ASBESTOS CHAIN OF CUSTODY

1819495

Turn Around Time

- | | | |
|----------------------------------|-----------------------------------|----------------------------------|
| <input type="checkbox"/> 1 Hour | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 4 Days |
| <input type="checkbox"/> 2 Hours | <input type="checkbox"/> 2 Days | <input type="checkbox"/> 5 Days |
| <input type="checkbox"/> 4 Hours | <input type="checkbox"/> 3 Days | <input type="checkbox"/> 10 Days |

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation

Project Manager Nicole Gladu

Address 1111 3rd Avenue, Suite 1600

Cell (206) 240 - 0644

Seattle, WA 98101

Email nicole.gladu@aecom.com

Phone 206.438.2700

Fax (866) 495 - 5288

Project Name/Number 60537920 Task 2.4

Project Location IGD POWERHOUSE

- | | | | |
|--|---|---|--|
| <input type="checkbox"/> PCM Air (NIOSH 7400) | <input type="checkbox"/> TEM (NIOSH 7402) | <input type="checkbox"/> TEM (AHERA) | <input type="checkbox"/> TEM (EPA Level II Modified) |
| <input checked="" type="checkbox"/> PLM (EPA 600/R-93-116) | <input type="checkbox"/> EPA 400 Points (600/R-93-116) | <input type="checkbox"/> EPA 1000 Points (600/R-93-116) | |
| <input type="checkbox"/> PLM Gravimetry (600/R-93-116) | <input type="checkbox"/> Asbestos in Vermiculite (EPA 600/R-04/004) | <input type="checkbox"/> Asbestos in Sediment (EPA 1900 Points) | |
| <input type="checkbox"/> Asbestos Friable/Non-Friable (EPA 600/R-93/116) | <input type="checkbox"/> Other | | |

Reporting Instructions email Nicole Gladu - EMAIL GOD ALONG WITH RESULTS

☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 9

Sample ID	Description	A/R
1 <u>IGDPH-1-01</u>		
2 <u>" - 1-02</u>		
3 <u>" - 1-03</u>		
4 <u>" - 3-01</u>		
5 <u>" - 3-02</u>		
6 <u>" - 3-03</u>		
7 <u>" - 4-01</u>		
8 <u>" - 4-02</u>		
9 <u>" - 4-03</u>		
10		
11		
12		
13		
14		
15		

	Print Name	Signature	Company	Date	Time
Sampled by	<u>David Simon, CAC</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>9/13 - 9/18/18</u>	<u>8am-4pm</u>
Relinquish by	<u>Shannon MacKay</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>10/02/18</u>	<u>5:00pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/12/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					

October 8, 2018

Nicole Gladu
AECOM-Seattle
1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 1819509.00

Client Project: 60537920 Task 2.4
Location: IGD Restroom

Dear Ms. Gladu,

Enclosed please find test results for the 3 sample(s) submitted to our laboratory for analysis on 10/2/2018.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with both **EPA 600/M4-82-020**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116** Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Matt Macfarlane".

Matt Macfarlane, Asbestos Lab Supervisor



Lab Code: 102063-0

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com

Enc.: Sample Results

NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Restroom

Batch #: 1819509.00

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 3

Samples Analyzed: 3

Method: EPA/600/R-93/116
& EPA/600/M4-82-020

Lab ID: 18099987 Client Sample #: IGDRR-1-01

Location: IGD Restroom

Layer 1 of 1 Description: White brittle material

Non-Fibrous Materials:
Binder/Filler, Calcareous particles, Mineral grains

Other Fibrous Materials:%
Spider silk 4%

Asbestos Type: %
None Detected ND

Lab ID: 18099988 Client Sample #: IGDRR-1-02

Location: IGD Restroom

Layer 1 of 1 Description: White brittle material

Non-Fibrous Materials:
Binder/Filler, Calcareous particles, Mineral grains

Other Fibrous Materials:%
Spider silk 2%

Asbestos Type: %
None Detected ND

Lab ID: 18099989 Client Sample #: IGDRR-1-03

Location: IGD Restroom

Layer 1 of 1 Description: White brittle material

Non-Fibrous Materials:
Binder/Filler, Calcareous particles, Mineral grains

Other Fibrous Materials:%
None Detected ND

Asbestos Type: %
None Detected ND

Sampled by: Client

Analyzed by: Michael Jenkins

Reviewed by: Matt Macfarlane

Date: 10/08/2018

Date: 10/08/2018


Matt Macfarlane, Asbestos Lab Supervisor

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

Company AECOM-Seattle **NVL Batch Number** 1819509.00
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Restroom

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 3

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099987	IGDRR-1-01		A
2	18099988	IGDRR-1-02		A
3	18099989	IGDRR-1-03		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Michael Jenkins		NVL	10/8/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 12:11 PM

Entered By: Emily Schubert



ASBESTOS CHAIN OF CUSTODY

1819509

Turn Around Time

- | | | |
|----------------------------------|-----------------------------------|----------------------------------|
| <input type="checkbox"/> 1 Hour | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 4 Days |
| <input type="checkbox"/> 2 Hours | <input type="checkbox"/> 2 Days | <input type="checkbox"/> 5 Days |
| <input type="checkbox"/> 4 Hours | <input type="checkbox"/> 3 Days | <input type="checkbox"/> 10 Days |

Please call for TAT less than 24 Hours

Laboratory | Management | Training

Company AECOM Corporation
Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
Phone 206.438.2700

Project Manager Nicole Gladu
Cell (206) 240 - 0644
Email nicole.gladu@aecom.com
Fax (866) 495 - 5288

Project Name/Number 60537920 Task 2.4 Project Location IGD RESTROOM

- | | | | |
|--|---|---|--|
| <input type="checkbox"/> PCM Air (NIOSH 7400) | <input type="checkbox"/> TEM (NIOSH 7402) | <input type="checkbox"/> TEM (AHERA) | <input type="checkbox"/> TEM (EPA Level II Modified) |
| <input checked="" type="checkbox"/> PLM (EPA 600/R-93-116) | <input type="checkbox"/> EPA 400 Points (600/R-93-116) | <input type="checkbox"/> EPA 1000Points (600/R-93-116) | |
| <input type="checkbox"/> PLM Gravimetry (600/R-93-116) | <input type="checkbox"/> Asbestos in Vermiculite (EPA 600/R-04/004) | <input type="checkbox"/> Asbestos in Sediment (EPA 1900 Points) | |
| <input type="checkbox"/> Asbestos Friable/Non-Friable (EPA 600/R-93/116) | <input type="checkbox"/> Other | | |

Reporting Instructions email Nicole Gladu

☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples

	Sample ID	Description	A/R
1	IGDRR-1-01		
2	" -1-02		
3	" -1-03		
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	David Simon, CAC	<i>David Simon</i>	AECOM	9/14/18	8am-4pm
Relinquish by	Shannon MacKay	<i>Shannon MacKay</i>	AECOM	10/2/18	9pm

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	S. Mitchell	<i>S. Mitchell</i>	NVL	10/2/18	1700
Analyzed by					
Called by					
Faxed/Email by					

October 5, 2018

Nicole Gladu

AECOM-Seattle

1111 3rd Avenue Ste. 1600

Seattle, WA 98101



Laboratory | Management | Training

RE: Metals Analysis; NVL Batch # 1819531.00

Dear Ms. Gladu,

Enclosed please find the test results for samples submitted to our laboratory for analysis. Preparation of these samples was conducted following protocol outlined in EPA Method SW 846 -3051 unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with U.S. EPA, NIOSH, OSHA and other ASTM methods.

For matrix materials submitted as paint, dust wipe, soil or TCLP samples, analysis for the presence of total metals is conducted using published U.S. EPA Methods. Paint and soil results are usually expressed in mg/Kg which is equivalent to parts per million (ppm). Lead (Pb) in paint is usually expressed in mg/Kg (ppm), Percent (%) or mg/cm² by area. Dust wipe sample results are usually expressed in ug/wipe and ug/ft². TCLP samples are reported in mg/L (ppm). For air filter samples, analyses are conducted using NIOSH and OSHA Methods. Results are expressed in ug/filter and ug/m³. Other matrix materials are analyzed accordingly using published methods or specified by client. The reported test results pertain only to items tested and are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more details.

This report is considered highly confidential and will not be released without your approval. Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. If you need further assistance please feel free to call us at 206-547-0100 or 1-888-NVLLABS.

Sincerely,

A handwritten signature in black ink, appearing to read "Shalini Patel".

Shalini Patel, Lab Supervisor

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com



NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Analysis Report

Total Lead (Pb)

Client: AECOM-Seattle
Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu
Project Location: IGD Diversion Tunnel Intake

Batch #: 1819531.00

Matrix: Paint
Method: EPA 3051/7000B
Client Project #: 60537920 Task 2.4
Date Received: 10/2/2018
Samples Received: 2
Samples Analyzed: 2

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
18100026	IGDDTI-Pb1-01	0.2157	46	470	0.047
18100027	IGDDTI-Pb2-01	0.1976	51	1500	0.15


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/05/2018

Date Issued: 10/05/2018


Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Company AECOM-Seattle **NVL Batch Number** 1819531.00
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Diversion Tunnel Intake

Subcategory Flame AA (FAA)

Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 2

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18100026	IGDDTI-Pb1-01		A
2	18100027	IGDDTI-Pb2-01		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Yasuyuki Hida		NVL	10/5/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 1:07 PM

Entered By: Emily Schubert

1819531



METALS CHAIN OF CUSTODY

Turn Around Time

- ☐ 2 Hour ☐ 4 Hours ☐ 24 Hours
☐ 2 Days ☐ 3 Days ☒ 4 Days
☐ 5 Days ☐ 6-10 Days
 Please call for TAT less than 24 Hours

Company AECOM Project Manager Nicole Gladu
 Address 1111 3rd Avenue, Suite 1600 Cell (206) 240-0644
Seattle, WA 98101 Email nicole.gladu@aecom.com
 Phone 206-438-2700 Fax (206) 495-5288

Project Name/Number 60537920 Task 2.4 Project Location IGD DIVERSION TUNNEL INTAKE

☒ Total Metals ☒ FAA (ppm) ☐ Air Filter ☒ Paint Chips (%) ☐ Soil RCRA 8 RCRA 11
☐ TCLP ☐ ICP (PPM) ☐ Paint Chips (cm) Dust Wipes ☐ Barium ☐ Chromium ☐ Silver ☐ Copper
☐ GFAA (ppb) ☐ Drinking Water ☐ Waste Water ☐ Arsenic ☐ Mercury ☒ Lead ☐ Zinc
☐ CVAA (ppb) ☐ Other ☐ Selenium ☐ Cadmium ☐ Other

Reporting Instructions EMAIL EDD ALONG WITH RESULTS
☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples

Sample ID	Description	A/R
1	IGD DTI - Pb1 - 01	
2	" - Pb2 - 01	
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

	Print Name	Signature	Company	Date	Time
Sampled by	Shannon MacKay/David Simon	<i>[Signature]</i>	AECOM	9/17/18-9/18/18	8am-4pm
Relinquish by	Shannon MacKay	<i>[Signature]</i>	AECOM	10/02/18	5:00pm

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	S. Mitchell	<i>[Signature]</i>	NVL	10/2/18	1700
Analyzed by					
Called by					
Faxed/Email by					

October 4, 2018

Nicole Gladu

AECOM-Seattle

1111 3rd Avenue Ste. 1600

Seattle, WA 98101



Laboratory | Management | Training

RE: Metals Analysis; NVL Batch # 1819511.00

Dear Ms. Gladu,

Enclosed please find the test results for samples submitted to our laboratory for analysis. Preparation of these samples was conducted following protocol outlined in EPA Method SW 846 -3051 unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with U.S. EPA, NIOSH, OSHA and other ASTM methods.

For matrix materials submitted as paint, dust wipe, soil or TCLP samples, analysis for the presence of total metals is conducted using published U.S. EPA Methods. Paint and soil results are usually expressed in mg/Kg which is equivalent to parts per million (ppm). Lead (Pb) in paint is usually expressed in mg/Kg (ppm), Percent (%) or mg/cm² by area. Dust wipe sample results are usually expressed in ug/wipe and ug/ft². TCLP samples are reported in mg/L (ppm). For air filter samples, analyses are conducted using NIOSH and OSHA Methods. Results are expressed in ug/filter and ug/m³. Other matrix materials are analyzed accordingly using published methods or specified by client. The reported test results pertain only to items tested and are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more details.

This report is considered highly confidential and will not be released without your approval. Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. If you need further assistance please feel free to call us at 206-547-0100 or 1-888-NVLLABS.

Sincerely,

A handwritten signature in black ink, appearing to read "Shalini Patel".

Shalini Patel, Lab Supervisor

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com



NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Analysis Report

Total Lead (Pb)

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101**Attention: Ms. Nicole Gladu**

Project Location: IGD Emergency Spill Equipment Shed

Batch #: 1819511.00

Matrix: Paint

Method: EPA 3051/7000B

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 1

Samples Analyzed: 1

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
18099992	IGDES-Pb1-01	0.0697	140	< 140	<0.014


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/04/2018

Date Issued: 10/04/2018


Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Company AECOM-Seattle **NVL Batch Number** 1819511.00
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Emergency Spill Equipment Shed

Subcategory Flame AA (FAA)

Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 1

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099992	IGDES-Pb1-01		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Yasuyuki Hida		NVL	10/4/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 12:13 PM

Entered By: Emily Schubert

1819511



METALS CHAIN OF CUSTODY

Turn Around Tin

☐ 2 Hour☐ 4 Hours☐ 24 Hours☐ 2 Days☐ 3 Days☒ 4 Days☐ 5 Days☐ 6-10 Days

Please call for TAT less than 24 Hours

Company AECOMProject Manager Nicole GladuAddress 1111 3rd Avenue, Suite 1600Cell (206) 240-0644Seattle, WA 98101Email nicole.gladu@aecom.comPhone 206-438-2700Fax (206) 495-5288Project Name/Number 60537920 Task 2.4Project Location IGD EMERGENCY SPILL EQUIPMENT SHED☒ Total Metals☒ FAA (ppm)☐ Air Filter☒ Paint Chips (%)☐ Soil

RCRA 8

RCRA 11

☐ TCLP☐ ICP (PPM)☐ Paint Chips (cm)☐ Dust Wipes☐ Barium☐ Chromium☐ Silver☐ Copper☐ GFAA (ppb)☐ Drinking Water☐ Waste Water☐ Arsenic☐ Mercury☒ Lead☐ Zinc☐ CVAA (ppb)☐ Other☐ Selenium☐ Cadmium☐ Other

Reporting Instructions

ANALYZED ALONG WITH RESULTS☐ Call ()☐ Fax ()☒ Email shannon.mackay@aecom.comTotal Number of Samples 1

	Sample ID	Description	A/R
1	<u>IGDES-Pb1-01</u>		
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Shannon MacKay/David Simon</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>9/14/18</u>	<u>8am-4pm</u>
Relinquish by	<u>Shannon MacKay</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>10/02/18</u>	<u>5pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/12/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					

October 4, 2018

Nicole Gladu

AECOM-Seattle

1111 3rd Avenue Ste. 1600

Seattle, WA 98101



Laboratory | Management | Training

RE: Metals Analysis; NVL Batch # 1819426.00

Dear Ms. Gladu,

Enclosed please find the test results for samples submitted to our laboratory for analysis. Preparation of these samples was conducted following protocol outlined in EPA Method SW 846 -3051 unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with U.S. EPA, NIOSH, OSHA and other ASTM methods.

For matrix materials submitted as paint, dust wipe, soil or TCLP samples, analysis for the presence of total metals is conducted using published U.S. EPA Methods. Paint and soil results are usually expressed in mg/Kg which is equivalent to parts per million (ppm). Lead (Pb) in paint is usually expressed in mg/Kg (ppm), Percent (%) or mg/cm² by area. Dust wipe sample results are usually expressed in ug/wipe and ug/ft². TCLP samples are reported in mg/L (ppm). For air filter samples, analyses are conducted using NIOSH and OSHA Methods. Results are expressed in ug/filter and ug/m³. Other matrix materials are analyzed accordingly using published methods or specified by client. The reported test results pertain only to items tested and are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more details.

This report is considered highly confidential and will not be released without your approval. Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. If you need further assistance please feel free to call us at 206-547-0100 or 1-888-NVLLABS.

Sincerely,

A handwritten signature in black ink, appearing to read "Shalini Patel".

Shalini Patel, Lab Supervisor

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com



NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Analysis Report

Total Lead (Pb)

Client: AECOM-Seattle
Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Batch #: 1819426.00

Matrix: Paint
Method: EPA 3051/7000B
Client Project #: 60537920 Task 2.4
Date Received: 10/2/2018
Samples Received: 3
Samples Analyzed: 3

Attention: Ms. Nicole Gladu

Project Location: IDG Fish Holding Facilities and Ponds

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
18099568	IDGFHF-Pb1-01	0.1950	51	500	0.050
18099569	IDGFHF-Pb2-01	0.2016	50	< 50	<0.0050
18099570	IDGFHF-Pb3-01	0.1990	50	110000	11


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/04/2018

Date Issued: 10/04/2018


Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Company AECOM-Seattle **NVL Batch Number** **1819426.00**
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IDG Fish Holding Facilities and Ponds

Subcategory Flame AA (FAA)

Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 3

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099568	IDGFHF-Pb1-01		A
2	18099569	IDGFHF-Pb2-01		A
3	18099570	IDGFHF-Pb3-01		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Yasuyuki Hida		NVL	10/4/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special
Instructions:

Date: 10/3/2018

Time: 7:54 AM

Entered By: Emily Schubert

1819426



METALS CHAIN OF CUSTODY

Turn Around Time

- ☐ 2 Hour ☐ 4 Hours ☐ 24 Hours
☐ 2 Days ☐ 3 Days ☒ 4 Days
☐ 5 Days ☐ 6-10 Days
 Please call for TAT less than 24 Hours

Company AECOM
 Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
 Phone 206-438-2700

Project Manager Nicole Gladu
 Cell (206) 240-0644
 Email nicole.gladu@aecom.com
 Fax (206) 495-5288

Project Name/Number 60537920 Task 2.4 Project Location IDG FISH HOLDING FACILITIES AND PONDS

<input checked="" type="checkbox"/> Total Metals	<input checked="" type="checkbox"/> FAA (ppm)	<input type="checkbox"/> Air Filter	<input checked="" type="checkbox"/> Paint Chips (%)	<input type="checkbox"/> Soil	RCRA 8	RCRA 11
<input type="checkbox"/> TCLP	<input type="checkbox"/> ICP (PPM)	<input type="checkbox"/> Paint Chips (cm)	Dust Wipes		<input type="checkbox"/> Barium	<input type="checkbox"/> Chromium
	<input type="checkbox"/> GFAA (ppb)	<input type="checkbox"/> Drinking Water	<input type="checkbox"/> Waste Water		<input type="checkbox"/> Arsenic	<input type="checkbox"/> Mercury
	<input type="checkbox"/> CVAA (ppb)	<input type="checkbox"/> Other			<input type="checkbox"/> Selenium	<input type="checkbox"/> Cadmium
					<input type="checkbox"/> Silver	<input type="checkbox"/> Copper
					<input checked="" type="checkbox"/> Lead	<input type="checkbox"/> Zinc
						<input type="checkbox"/> Other

Reporting Instructions EMAILED ALONG WITH RESULTS

☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 3

Sample ID	Description	A/R
1 <u>IDGFHF-Pb1-01</u>		
2 <u>" - Pb2-01</u>		
3 <u>" - Pb3-01</u>	<u>Pond</u>	
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Shannon MacKay/David Simon</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>9/17/18-9/18/18</u>	<u>8am-4pm</u>
Relinquish by	<u>Shannon MacKay</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>10/02/18</u>	<u>5:00pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/2/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					

October 4, 2018

Nicole Gladu

AECOM-Seattle

1111 3rd Avenue Ste. 1600
Seattle, WA 98101



Laboratory | Management | Training

RE: Metals Analysis; NVL Batch # 1819503.00

Dear Ms. Gladu,

Enclosed please find the test results for samples submitted to our laboratory for analysis. Preparation of these samples was conducted following protocol outlined in EPA Method SW 846 -3051 unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with U.S. EPA, NIOSH, OSHA and other ASTM methods.

For matrix materials submitted as paint, dust wipe, soil or TCLP samples, analysis for the presence of total metals is conducted using published U.S. EPA Methods. Paint and soil results are usually expressed in mg/Kg which is equivalent to parts per million (ppm). Lead (Pb) in paint is usually expressed in mg/Kg (ppm), Percent (%) or mg/cm² by area. Dust wipe sample results are usually expressed in ug/wipe and ug/ft². TCLP samples are reported in mg/L (ppm). For air filter samples, analyses are conducted using NIOSH and OSHA Methods. Results are expressed in ug/filter and ug/m³. Other matrix materials are analyzed accordingly using published methods or specified by client. The reported test results pertain only to items tested and are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more details.

This report is considered highly confidential and will not be released without your approval. Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. If you need further assistance please feel free to call us at 206-547-0100 or 1-888-NVLLABS.

Sincerely,

A handwritten signature in black ink, appearing to read "Shalini Patel".

Shalini Patel, Lab Supervisor

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com



NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Analysis Report

Total Lead (Pb)

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101**Attention: Ms. Nicole Gladu**

Project Location: IGD Penstock Intake Structure

Batch #: 1819503.00

Matrix: Paint

Method: EPA 3051/7000B

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 1

Samples Analyzed: 1

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
18099951	IGDPIS-Pb1-01	0.1977	51	140	0.014


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/04/2018

Date Issued: 10/04/2018


Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Company AECOM-Seattle **NVL Batch Number** **1819503.00**
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Penstock Intake Structure

Subcategory Flame AA (FAA)

Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 1

Rush Samples _____

	Lab ID	Sample ID	Description	A/R
1	18099951	IGDPIS-Pb1-01		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Yasuyuki Hida		NVL	10/4/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/3/2018

Time: 12:03 PM

Entered By: Shaina Mitchell

1819503



METALS CHAIN OF CUSTODY

Turn Around Time

- ☐ 2 Hour ☐ 4 Hours ☐ 24 Hours
☐ 2 Days ☐ 3 Days ☒ 4 Days
☐ 5 Days ☐ 6-10 Days
 Please call for TAT less than 24 Hours

Company AECOM
 Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
 Phone 206-438-2700

Project Manager Nicole Gladu
 Cell (206) 240-0644
 Email nicole.gladu@aecom.com
 Fax (206) 495-5288

Project Name/Number 60537920 Task 2.4 Project Location IGD PENSTOCK INTAKE STRUCTURE

<input checked="" type="checkbox"/> Total Metals <input type="checkbox"/> TCLP	<input checked="" type="checkbox"/> FAA (ppm) <input type="checkbox"/> ICP (PPM) <input type="checkbox"/> GFAA (ppb) <input type="checkbox"/> CVAA (ppb)	<input type="checkbox"/> Air Filter <input type="checkbox"/> Paint Chips (cm) <input type="checkbox"/> Drinking Water <input type="checkbox"/> Other	<input checked="" type="checkbox"/> Paint Chips (%) <input type="checkbox"/> Dust Wipes <input type="checkbox"/> Waste Water	<input type="checkbox"/> Soil RCRA 8 <input type="checkbox"/> Barium <input type="checkbox"/> Chromium <input type="checkbox"/> Silver <input type="checkbox"/> Arsenic <input type="checkbox"/> Mercury <input checked="" type="checkbox"/> Lead <input type="checkbox"/> Selenium <input type="checkbox"/> Cadmium	RCRA 11 <input type="checkbox"/> Copper <input type="checkbox"/> Zinc <input type="checkbox"/> Other
---	---	---	--	--	---

Reporting Instructions EMAILED ALONG WITH RESULTS
☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 1

	Sample ID	Description	A/R
1	<u>IGDPIS-Pb1-01</u>		
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Shannon MacKay/David Simon</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>9/17/18 9/18/18</u>	<u>8am-4pm</u>
Relinquish by	<u>Shannon MacKay</u>		<u>AECOM</u>	<u>10/02/18</u>	<u>5:00pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/2/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					

October 4, 2018

Nicole Gladu

AECOM-Seattle

1111 3rd Avenue Ste. 1600

Seattle, WA 98101



Laboratory | Management | Training

RE: Metals Analysis; NVL Batch # 1819536.00

Dear Ms. Gladu,

Enclosed please find the test results for samples submitted to our laboratory for analysis. Preparation of these samples was conducted following protocol outlined in EPA Method SW 846 -3051 unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with U.S. EPA, NIOSH, OSHA and other ASTM methods.

For matrix materials submitted as paint, dust wipe, soil or TCLP samples, analysis for the presence of total metals is conducted using published U.S. EPA Methods. Paint and soil results are usually expressed in mg/Kg which is equivalent to parts per million (ppm). Lead (Pb) in paint is usually expressed in mg/Kg (ppm), Percent (%) or mg/cm² by area. Dust wipe sample results are usually expressed in ug/wipe and ug/ft². TCLP samples are reported in mg/L (ppm). For air filter samples, analyses are conducted using NIOSH and OSHA Methods. Results are expressed in ug/filter and ug/m³. Other matrix materials are analyzed accordingly using published methods or specified by client. The reported test results pertain only to items tested and are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more details.

This report is considered highly confidential and will not be released without your approval. Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. If you need further assistance please feel free to call us at 206-547-0100 or 1-888-NVLLABS.

Sincerely,

A handwritten signature in black ink, appearing to read "Shalini Patel".

Shalini Patel, Lab Supervisor

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com



NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Analysis Report

Total Lead (Pb)

Client: AECOM-Seattle
Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu
Project Location: IGD Penstock

Batch #: 1819536.00

Matrix: Paint
Method: EPA 3051/7000B
Client Project #: 60537920 Task 2.4
Date Received: 10/2/2018
Samples Received: 2
Samples Analyzed: 2

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
18100035	IGDPS-Pb1-01	0.1355	74	65000	6.5
18100036	IGDPS-Pb2-01	0.2030	49	60	0.0060


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/04/2018

Date Issued: 10/04/2018


Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Company AECOM-Seattle **NVL Batch Number** 1819536.00
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Penstock

Subcategory Flame AA (FAA)

Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 2

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18100035	IGDPS-Pb1-01		A
2	18100036	IGDPS-Pb2-01		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Yasuyuki Hida		NVL	10/4/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 1:13 PM

Entered By: Emily Schubert

1819536



METALS CHAIN OF CUSTODY

Turn Around Time

- ☐ 2 Hour ☐ 4 Hours ☐ 24 Hours
☐ 2 Days 3 Days ☒ 4 Days
☐ 5 Days ☐ 6-10 Days

Please call for TAT less than 24 Hours

Company AECOM
 Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
 Phone 206-438-2700

Project Manager Nicole Gladu
 Cell (206) 240-0644
 Email nicole.gladu@aecom.com
 Fax (206) 495-5288

Project Name/Number 60537920 Task 2.4 Project Location IGD PENSTOCK

<input checked="" type="checkbox"/> Total Metals	<input checked="" type="checkbox"/> FAA (ppm)	<input type="checkbox"/> Air Filter	<input checked="" type="checkbox"/> Paint Chips (%)	<input type="checkbox"/> Soil	RCRA 8	RCRA 11
<input type="checkbox"/> TCLP	<input type="checkbox"/> ICP (PPM)	<input type="checkbox"/> Paint Chips (cm)	Dust Wipes		<input type="checkbox"/> Barium	<input type="checkbox"/> Chromium
	<input type="checkbox"/> GFAA (ppb)	<input type="checkbox"/> Drinking Water	<input type="checkbox"/> Waste Water		<input type="checkbox"/> Arsenic	<input type="checkbox"/> Mercury
	<input type="checkbox"/> CVAA (ppb)	<input type="checkbox"/> Other			<input type="checkbox"/> Selenium	<input type="checkbox"/> Cadmium
					<input checked="" type="checkbox"/> Lead	<input type="checkbox"/> Silver
						<input type="checkbox"/> Copper
						<input type="checkbox"/> Zinc
						<input type="checkbox"/> Other

Reporting Instructions EMAIL EDD ALONG WITH RESULTS

☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 2

Sample ID	Description	A/R
1 <u>IGDPS-Pb1-01</u>		
2 <u>IGDPS-Pb2-01</u>		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

	Print Name	Signature	Company	Date	Time
Sampled by	Shannon MacKay/David Simon	<i>Shannon MacKay</i>	AECOM	9/14/18	8am-4pm
Relinquish by	Shannon MacKay	<i>Shannon MacKay</i>	AECOM	10/02/18	5:00pm

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<i>Smith</i>	<i>AS</i>	NVL	10/12/18	1700
Analyzed by					
Called by					
Faxed/Email by					

October 5, 2018

Nicole Gladu

AECOM-Seattle

1111 3rd Avenue Ste. 1600

Seattle, WA 98101



Laboratory | Management | Training

RE: Metals Analysis; NVL Batch # 1819427.00

Dear Ms. Gladu,

Enclosed please find the test results for samples submitted to our laboratory for analysis. Preparation of these samples was conducted following protocol outlined in EPA Method SW 846 -3051 unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with U.S. EPA, NIOSH, OSHA and other ASTM methods.

For matrix materials submitted as paint, dust wipe, soil or TCLP samples, analysis for the presence of total metals is conducted using published U.S. EPA Methods. Paint and soil results are usually expressed in mg/Kg which is equivalent to parts per million (ppm). Lead (Pb) in paint is usually expressed in mg/Kg (ppm), Percent (%) or mg/cm² by area. Dust wipe sample results are usually expressed in ug/wipe and ug/ft². TCLP samples are reported in mg/L (ppm). For air filter samples, analyses are conducted using NIOSH and OSHA Methods. Results are expressed in ug/filter and ug/m³. Other matrix materials are analyzed accordingly using published methods or specified by client. The reported test results pertain only to items tested and are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more details.

This report is considered highly confidential and will not be released without your approval. Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. If you need further assistance please feel free to call us at 206-547-0100 or 1-888-NVLLABS.

Sincerely,

A handwritten signature in black ink, appearing to read "Shalini Patel".

Shalini Patel, Lab Supervisor

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com



NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Analysis Report

Total Lead (Pb)

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Powerhouse

Batch #: 1819427.00

Matrix: Paint

Method: EPA 3051/7000B

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 5

Samples Analyzed: 5

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
18099571	IGDPH-Pb1-01	0.1436	70	83000	8.3
18099572	IGDPH-Pb2-01	0.1590	63	980	0.098
18099573	IGDPH-Pb3-01	0.1602	62	7200	0.72
18099574	IGDPH-Pb4-01	0.1754	57	860	0.086
18099575	IGDPH-Pb5-01	0.0095	530	150000	15

Comments: Small sample size (<0.05g) for IGDPH-Pb5-01.


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/05/2018

Date Issued: 10/05/2018


Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Company AECOM-Seattle **NVL Batch Number** 1819427.00
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Powerhouse

Subcategory Flame AA (FAA)

Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 5

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099571	IGDPH-Pb1-01		A
2	18099572	IGDPH-Pb2-01		A
3	18099573	IGDPH-Pb3-01		A
4	18099574	IGDPH-Pb4-01		A
5	18099575	IGDPH-Pb5-01		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Yasuyuki Hida		NVL	10/5/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 7:56 AM

Entered By: Emily Schubert

1819427



METALS CHAIN OF CUSTODY

Turn Around Time

- ☐ 2 Hour ☐ 4 Hours ☐ 24 Hours
☐ 2 Days ☐ 3 Days ☒ 4 Days
☐ 5 Days ☐ 6-10 Days
 Please call for TAT less than 24 Hours

Company AECOM
 Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
 Phone 206-438-2700

Project Manager Nicole Gladu
 Cell (206) 240-0644
 Email nicole.gladu@aecom.com
 Fax (206) 495-5288

Project Name/Number 60537920 Task 2.4 Project Location IQD POWERHOUSE

<input checked="" type="checkbox"/> Total Metals	<input checked="" type="checkbox"/> FAA (ppm)	<input type="checkbox"/> Air Filter	<input checked="" type="checkbox"/> Paint Chips (%)	<input type="checkbox"/> Soil	RCRA 8	RCRA 11
<input type="checkbox"/> TCLP	<input type="checkbox"/> ICP (PPM)	<input type="checkbox"/> Paint Chips (cm)	Dust Wipes		<input type="checkbox"/> Barium	<input type="checkbox"/> Chromium
	<input type="checkbox"/> GFAA (ppb)	<input type="checkbox"/> Drinking Water	<input type="checkbox"/> Waste Water		<input type="checkbox"/> Arsenic	<input type="checkbox"/> Mercury
	<input type="checkbox"/> CVAA (ppb)	<input type="checkbox"/> Other			<input type="checkbox"/> Selenium	<input type="checkbox"/> Cadmium
					<input checked="" type="checkbox"/> Lead	<input type="checkbox"/> Silver
						<input type="checkbox"/> Copper
						<input type="checkbox"/> Zinc
						<input type="checkbox"/> Other

Reporting Instructions EMAILLED ALONG WITH RESULTS
☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 5

	Sample ID	Description	A/R
1	<u>IQDPH-Pb1-01</u>		
2	<u>" - Pb2-01</u>		
3	<u>" - Pb3-01</u>		
4	<u>" - Pb4-01</u>		
5	<u>" - Pb5-01</u>		
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Shannon MacKay/David Simon</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>7/17/18-9/18/18</u>	<u>8am-4pm</u>
Relinquish by	<u>Shannon MacKay</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>10/02/18</u>	<u>5pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/2/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					

October 5, 2018

Nicole Gladu

AECOM-Seattle

1111 3rd Avenue Ste. 1600

Seattle, WA 98101



Laboratory | Management | Training

RE: Metals Analysis; NVL Batch # 1819508.00

Dear Ms. Gladu,

Enclosed please find the test results for samples submitted to our laboratory for analysis. Preparation of these samples was conducted following protocol outlined in EPA Method SW 846 -3051 unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with U.S. EPA, NIOSH, OSHA and other ASTM methods.

For matrix materials submitted as paint, dust wipe, soil or TCLP samples, analysis for the presence of total metals is conducted using published U.S. EPA Methods. Paint and soil results are usually expressed in mg/Kg which is equivalent to parts per million (ppm). Lead (Pb) in paint is usually expressed in mg/Kg (ppm), Percent (%) or mg/cm² by area. Dust wipe sample results are usually expressed in ug/wipe and ug/ft². TCLP samples are reported in mg/L (ppm). For air filter samples, analyses are conducted using NIOSH and OSHA Methods. Results are expressed in ug/filter and ug/m³. Other matrix materials are analyzed accordingly using published methods or specified by client. The reported test results pertain only to items tested and are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more details.

This report is considered highly confidential and will not be released without your approval. Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. If you need further assistance please feel free to call us at 206-547-0100 or 1-888-NVLLABS.

Sincerely,

A handwritten signature in black ink, appearing to read "Shalini Patel".

Shalini Patel, Lab Supervisor

1.888.NVL.LABS
1.888.(685.5227)
www.nvllabs.com



NVL Laboratories, Inc.
4708 Aurora Ave N, Seattle, WA 98103
p 206.547.0100 | f 206.634.1936

Analysis Report

Total Lead (Pb)

Client: AECOM-Seattle

Address: 1111 3rd Avenue Ste. 1600
Seattle, WA 98101

Attention: Ms. Nicole Gladu

Project Location: IGD Spillway

Batch #: 1819508.00

Matrix: Paint

Method: EPA 3051/7000B

Client Project #: 60537920 Task 2.4

Date Received: 10/2/2018

Samples Received: 1

Samples Analyzed: 1

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
18099986	IGDSW-Pb1-01	0.0880	110	< 110	<0.011


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/05/2018

Date Issued: 10/05/2018


Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Company AECOM-Seattle **NVL Batch Number** 1819508.00
Address 1111 3rd Avenue Ste. 1600 **TAT** 4 Days **AH** No
 Seattle, WA 98101 **Rush TAT**
Project Manager Ms. Nicole Gladu **Due Date** 10/8/2018 **Time** 5:00 PM
Phone (206) 438-2700 **Email** nicole.gladu@aecom.com
Cell (206) 240-0644 **Fax** (866) 495-5288

Project Name/Number: 60537920 Task 2.4 **Project Location:** IGD Spillway

Subcategory Flame AA (FAA)

Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 1

Rush Samples

	Lab ID	Sample ID	Description	A/R
1	18099986	IGDSW-Pb1-01		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Client				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Shaina Mitchell		NVL	10/2/18	1700
Analyzed by	Yasuyuki Hida		NVL	10/5/18	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/3/2018

Time: 12:11 PM

Entered By: Shaina Mitchell

1819508



METALS CHAIN OF CUSTODY

Turn Around Tin

- ☐ 2 Hour ☐ 4 Hours ☐ 24 Hours
☐ 2 Days 3 Days ☒ 4 Days
☐ 5 Days ☐ 6-10 Days

Please call for TAT less than 24 Hours

Company AECOM
 Address 1111 3rd Avenue, Suite 1600
Seattle, WA 98101
 Phone 206-438-2700

Project Manager Nicole Gladu
 Cell (206) 240-0644
 Email nicole.gladu@aecom.com
 Fax (206) 495-5288

Project Name/Number 60537920 Task 2.4 Project Location 81 IQD SPILLWAY

<input checked="" type="checkbox"/> Total Metals	<input checked="" type="checkbox"/> FAA (ppm)	<input type="checkbox"/> Air Filter	<input checked="" type="checkbox"/> Paint Chips (%)	<input type="checkbox"/> Soil	RCRA 8	RCRA 11
<input type="checkbox"/> TCLP	<input type="checkbox"/> ICP (PPM)	<input type="checkbox"/> Paint Chips (cm)	Dust Wipes		<input type="checkbox"/> Barium	<input type="checkbox"/> Chromium
	<input type="checkbox"/> GFAA (ppb)	<input type="checkbox"/> Drinking Water	<input type="checkbox"/> Waste Water		<input type="checkbox"/> Arsenic	<input type="checkbox"/> Mercury
	<input type="checkbox"/> CVAA (ppb)	<input type="checkbox"/> Other			<input type="checkbox"/> Selenium	<input type="checkbox"/> Cadmium
					<input checked="" type="checkbox"/> Lead	<input type="checkbox"/> Silver
						<input type="checkbox"/> Copper
						<input type="checkbox"/> Zinc
						<input type="checkbox"/> Other

Reporting Instructions EMAIL EDD ALONG WITH RESULTS

☐ Call () ☐ Fax () ☒ Email shannon.mackay@aecom.com

Total Number of Samples 1

	Sample ID	Description	A/R
1	<u>IQDSW-Pb1-01</u>		
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Shannon MacKay/David Simon</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>9/17-9/18/18</u>	<u>8am-4pm</u>
Relinquish by	<u>Shannon MacKay</u>	<u>[Signature]</u>	<u>AECOM</u>	<u>10/02/18</u>	<u>5:00pm</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>S. Mitchell</u>	<u>[Signature]</u>	<u>NVL</u>	<u>10/2/18</u>	<u>1700</u>
Analyzed by					
Called by					
Faxed/Email by					



3600 Fremont Ave. N.
Seattle, WA 98103
T: (206) 352-3790
F: (206) 352-7178
info@fremontanalytical.com

AECOM

Nicole Gladu
1111 3rd Avenue Suite 1600
Seattle, WA 98101

RE: Iron Gate Dam
Work Order Number: 1810400

October 31, 2018

Attention Nicole Gladu:

Fremont Analytical, Inc. received 1 sample(s) on 10/24/2018 for the analyses presented in the following report.

Polychlorinated Biphenyls (PCB) by EPA 8270 (GCMS)

This report consists of the following:

- Case Narrative
- Analytical Results
- Applicable Quality Control Summary Reports
- Chain of Custody

All analyses were performed consistent with the Quality Assurance program of Fremont Analytical, Inc. Please contact the laboratory if you should have any questions about the results.

Thank you for using Fremont Analytical.

Sincerely,

Mike Ridgeway
Laboratory Director

CC:
Shannon Mackay



Date: 10/31/2018

CLIENT: AECOM

Project: Iron Gate Dam

Work Order: 1810400

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Date/Time Collected	Date/Time Received
1810400-001	IGDPH-PCB1-01	09/17/2018 11:00 AM	10/24/2018 4:40 PM

CLIENT: AECOM
Project: Iron Gate Dam

WorkOrder Narrative:

I. SAMPLE RECEIPT:

Samples receipt information is recorded on the attached Sample Receipt Checklist.

II. GENERAL REPORTING COMMENTS:

Results are reported on a wet weight basis unless dry-weight correction is denoted in the units field on the analytical report ("mg/kg-dry" or "ug/kg-dry").

The validity of the analytical procedures for which data is reported in this analytical report is determined by the Laboratory Control Sample (LCS) and the Method Blank (MB). The LCS and the MB are processed with the samples to ensure method criteria are achieved throughout the entire analytical process.

III. ANALYSES AND EXCEPTIONS:

Exceptions associated with this report will be footnoted in the analytical results page(s) or the quality control summary page(s) and/or noted below.

Qualifiers:

- * - Flagged value is not within established control limits
- B - Analyte detected in the associated Method Blank
- D - Dilution was required
- E - Value above quantitation range
- H - Holding times for preparation or analysis exceeded
- I - Analyte with an internal standard that does not meet established acceptance criteria
- J - Analyte detected below Reporting Limit
- N - Tentatively Identified Compound (TIC)
- Q - Analyte with an initial or continuing calibration that does not meet established acceptance criteria (<20%RSD, <20% Drift or minimum RRF)
- S - Spike recovery outside accepted recovery limits
- ND - Not detected at the Reporting Limit
- R - High relative percent difference observed

Acronyms:

- %Rec - Percent Recovery
- CCB - Continued Calibration Blank
- CCV - Continued Calibration Verification
- DF - Dilution Factor
- HEM - Hexane Extractable Material
- ICV - Initial Calibration Verification
- LCS/LCSD - Laboratory Control Sample / Laboratory Control Sample Duplicate
- MB or MBLANK - Method Blank
- MDL - Method Detection Limit
- MS/MSD - Matrix Spike / Matrix Spike Duplicate
- PDS - Post Digestion Spike
- Ref Val - Reference Value
- RL - Reporting Limit
- RPD - Relative Percent Difference
- SD - Serial Dilution
- SGT - Silica Gel Treatment
- SPK - Spike
- Surr - Surrogate



Analytical Report

Work Order: 1810400
Date Reported: 10/31/2018

Client: AECOM

Collection Date: 9/17/2018 11:00:00 AM

Project: Iron Gate Dam

Lab ID: 1810400-001

Matrix: Product

Client Sample ID: IGDPH-PCB1-01

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

Polychlorinated Biphenyls (PCB) by EPA 8270 (GCMS)

Batch ID: 22421

Analyst: IH

Aroclor 1016	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Aroclor 1221	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Aroclor 1232	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Aroclor 1242	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Aroclor 1248	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Aroclor 1254	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Aroclor 1260	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Aroclor 1262	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Aroclor 1268	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Total PCBs	ND	1.02		mg/Kg	1	10/31/2018 1:02:25 PM
Surr: Decachlorobiphenyl	194	20 - 191	S	%Rec	1	10/31/2018 1:02:25 PM
Surr: Tetrachloro-m-xylene	103	20 - 173		%Rec	1	10/31/2018 1:02:25 PM

NOTES:

S - Outlying spike recovery observed (high bias). Samples are non-detect for this analyte; no further action required.

Work Order: 1810400
CLIENT: AECOM
Project: Iron Gate Dam

QC SUMMARY REPORT

Polychlorinated Biphenyls (PCB) by EPA 8270 (GCMS)

Sample ID	MB-22421	SampType:	MBLK		Units:	mg/Kg			Prep Date:	10/26/2018		RunNo:	47290	
Client ID:	MBLKS	Batch ID:	22421						Analysis Date:	10/31/2018		SeqNo:	920924	
Analyte		Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val		%RPD	RPDLimit	Qual	
Aroclor 1016		ND	0.100											
Aroclor 1221		ND	0.100											
Aroclor 1232		ND	0.100											
Aroclor 1242		ND	0.100											
Aroclor 1248		ND	0.100											
Aroclor 1254		ND	0.100											
Aroclor 1260		ND	0.100											
Aroclor 1262		ND	0.100											
Aroclor 1268		ND	0.100											
Surr: Decachlorobiphenyl		0.0488		0.05000		97.7	20	191						
Surr: Tetrachloro-m-xylene		0.0562		0.05000		112	20	173						

Sample ID	LCS1-22421	SampType:	LCS	Units:	mg/Kg	Prep Date:	10/26/2018	RunNo:	47290		
Client ID:	LCSS	Batch ID:	22421			Analysis Date:	10/31/2018	SeqNo:	920925		
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Aroclor 1016	0.954	0.100	1.000	0	95.4	38.4	155				
Aroclor 1260	1.05	0.100	1.000	0	105	42.8	168				
Surr: Decachlorobiphenyl	0.0540		0.05000		108	20	191				
Surr: Tetrachloro-m-xylene	0.0510		0.05000		102	20	173				

Sample ID	LCS1D-22421	SampType:	LCSD	Units:	mg/Kg	Prep Date:	10/26/2018	RunNo:	47290		
Client ID:	LCSS02	Batch ID:	22421			Analysis Date:	10/31/2018	SeqNo:	920926		
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Aroclor 1016	1.20	0.100	1.000	0	120	38.4	155	0.9542	22.8	30	
Aroclor 1260	1.27	0.100	1.000	0	127	42.8	168	1.047	19.0	30	
Surr: Decachlorobiphenyl	0.0511		0.05000		102	20	191		0		
Surr: Tetrachloro-m-xylene	0.0565		0.05000		113	20	173		0		



Date: 10/31/2018

Work Order: 1810400
CLIENT: AECOM
Project: Iron Gate Dam

QC SUMMARY REPORT

Polychlorinated Biphenyls (PCB) by EPA 8270 (GCMS)

Sample ID	LCS2-22421	SampType:	LCS	Units:	mg/Kg	Prep Date:	10/26/2018	RunNo:	47290		
Client ID:	LCSS	Batch ID:	22421			Analysis Date:	10/31/2018	SeqNo:	920962		
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Aroclor 1254	1.14	0.100	1.000	0	114	40.9	164				
Surr: Decachlorobiphenyl	0.0509		0.05000		102	20	191				
Surr: Tetrachloro-m-xylene	0.0459		0.05000		91.8	20	173				

Client Name: **URS**

Work Order Number: **1810400**

Logged by: **Clare Griggs**

Date Received: **10/24/2018 4:40:00 PM**

Chain of Custody

1. Is Chain of Custody complete? Yes ☒ No ☐ Not Present ☐
2. How was the sample delivered? Client

Log In

3. Coolers are present? Yes ☐ No ☒ NA ☐

Product Sample

4. Shipping container/cooler in good condition? Yes ☒ No ☐
5. Custody Seals present on shipping container/cooler?
(Refer to comments for Custody Seals not intact) Yes ☐ No ☐ Not Required ☒
6. Was an attempt made to cool the samples? Yes ☐ No ☐ NA ☒
7. Were all items received at a temperature of $>0^{\circ}\text{C}$ to 10.0°C * Yes ☐ No ☐ NA ☒
8. Sample(s) in proper container(s)? Yes ☒ No ☐
9. Sufficient sample volume for indicated test(s)? Yes ☒ No ☐
10. Are samples properly preserved? Yes ☒ No ☐
11. Was preservative added to bottles? Yes ☐ No ☒ NA ☐
12. Is there headspace in the VOA vials? Yes ☐ No ☐ NA ☒
13. Did all samples containers arrive in good condition(unbroken)? Yes ☒ No ☐
14. Does paperwork match bottle labels? Yes ☒ No ☐
15. Are matrices correctly identified on Chain of Custody? Yes ☒ No ☐
16. Is it clear what analyses were requested? Yes ☒ No ☐
17. Were all holding times able to be met? Yes ☒ No ☐

Special Handling (if applicable)

18. Was client notified of all discrepancies with this order? Yes ☐ No ☐ NA ☒

Person Notified:	<input type="text"/>	Date	<input type="text"/>
By Whom:	<input type="text"/>	Via:	<input type="checkbox"/> eMail <input type="checkbox"/> Phone <input type="checkbox"/> Fax <input type="checkbox"/> In Person
Regarding:	<input type="text"/>		
Client Instructions:	<input type="text"/>		

19. Additional remarks:

Item Information

Item #	Temp $^{\circ}\text{C}$
Sample	22.6

* Note: DoD/ELAP and TNI require items to be received at 4°C +/- 2°C



3600 Fremont Ave N.
Seattle, WA 98103
Tel: 206-352-3790
Fax: 206-352-7178

Chain of Custody Record & Laboratory Services Agreement

Date: 10/24/2018 Page: 1 of 1

Project Name: MON GATE DAM

Project No: 100537920 Task 2.4

Collected by: David Simon/Shannon Mackay

Location: 7th

Report To (PM): Nicole Gladu

PM Email: Shannon.mackay@aecm.com

Laboratory Project No (internal): 1810400

Special Remarks:

Sample Disposal: ☐ Return to client ☐ Disposal by lab (after 30 days)

Client: AECM

Address: 1111 3rd Avenue Ste 1600

City, State, Zip: Seattle, WA 98101

Telephone: 206-999-2112

Fax:

Sample Name	Sample Date	Sample Time	Sample Type (Matrix)*	VOCS (EPA 8260 / 624)	GX/BTEX	BTEX	Gasoline Range Organics (GX)	Hydrocarbon Identification (HCD)	Diesel/Heavy Oil Range Organics (DO)	SVOCS (EPA 8270 / 625)	PAHs (EPA 8270 - SIM)	PCBs (EPA 8082 / 608)	Metals** (EPA 6020 / 200.8)	Total (T) Dissolved (D)	Anions (IC)**	EDB (8011)	PCB 8270	Comments
-------------	-------------	-------------	-----------------------	-----------------------	---------	------	------------------------------	----------------------------------	--------------------------------------	------------------------	-----------------------	-----------------------	-----------------------------	---------------------------	---------------	------------	----------	----------

1 1GDPH-PCB1-01 9/17/18 11am P

X

2																		
3																		
4																		
5																		
6																		
7																		
8																		
9																		
10																		

*Matrix: A = Air, AQ = Aqueous, B = Bulk, O = Other, P = Product, S = Soil, SD = Sediment, SL = Solid, W = Water, DW = Drinking Water, GW = Ground Water, SW = Storm Water, WW = Waste Water

**Metals (Circle): MTCA-5 RCRA-8 Priority Pollutants TAL Individual: Ag Al As B Ba Be Ca Cd Co Cr Cu Fe Hg K Mg Mn Mo Na Ni Pb Sb Se Sr Sn Ti U V Zn

***Anions (Circle): Nitrate Nitrite Chloride Sulfate Bromide O-Phosphate Fluoride Nitrate+Nitrite

I represent that I am authorized to enter into this Agreement with Fremont Analytical on behalf of the Client named above and that I have verified Client's agreement to each of the terms on the front and backside of this Agreement.

Relinquished Date/Time 10/24/2018 16:40 Received Date/Time 10/24/18 #4 16:40

Relinquished Date/Time 10/24/2018 16:40 Received Date/Time 10/24/18 #4 16:40

Relinquished Date/Time 10/24/2018 16:40 Received Date/Time 10/24/18 #4 16:40

Turn-around Time:

☒ Standard

☐ 3 Day

☐ 2 Day

☐ Next Day

Same Day

(Specify)

APPENDIX D PERSONNEL AND LABORATORY CERTIFICATIONS

State of California Department of Public Health

Lead-Related
Construction
Certificate

Certificate
Type

Expiration
Date



Project Monitor

01/06/2019



David L. Simon

ID # 24204

State of California
Division of Occupational Safety and Health
Certified Asbestos Consultant

David Leo Simon

Name

Certification No. 92-0005

Expires on 06/24/19



This certification was issued by the Division of Occupational Safety and Health as authorized by Sections 7180 et seq. of the Business and Professions Code.

Certificate Of Completion

Asbestos Building Inspector Refresher Course

DOSH #:CA-015-06

Shannon MacKay

ABIR0115190004N18965

David Wallach

Principal Instructor

1/15/2019

Course Start Date

1/15/2019

Course End Date

1/15/2019

Exam Date

1/15/2020

Expiration Date

This course satisfies the education requirements for Asbestos accreditation under the Toxic Substances Control Act, Title II. This course has been approved by the Department of Industrial Relations, Division of Occupational Safety and Health of the State of California

NATEC International, Inc.

National Association of Training and Environmental Consulting

1100 Technology Circle- Suite A, Anaheim, CA 92805 • www.natecintl.com • 800-969-3228



Important Industry Contacts

CAL-OSHA: Ph# (916) 574-2993
(916) 483-0572 Fax Notification
Web: www.dir.ca.gov or calosha.com

CDPH/CLPPB: Ph# (510) 620-5600
Web: www.cdph.ca.gov/programs/CLPPB

SCAQMD: Ph# (909) 396-3739
Fax#(909) 396-3342

BAAQMD: Ph# (415) 749-4762

NATEC International, Inc.

National Association of Training and Environmental Consulting

Anaheim, CA • Oakland, CA • Fresno, CA • Sacramento, CA

Asbestos • Lead • Mold • HAZWOPER

P.O. Box 25205 Anaheim, CA 92825-5205
(714) 678-2750, (800) 969-3228, Fax (714) 678-2757
www.natecintl.com

NATEC International, Inc.

National Association of Training and Environmental Consulting
*Note: Card is not suitable substitute for certificate and is not accepted by SCAQMD as proof of certification

This Card Acknowledges That
Shannon MacKay

Holds Training Certification For
Asbestos Building Inspector Refresher Course

Expiration: 01/15/2020

Training Date 1/15/2019
Certificate No. ABIR0115190004N18965

Michael W. Horner
Training Director

Certificate of Completion

This is to certify that
Shannon R. MacKay

has satisfactorily completed
4 hours of refresher training as an
AHERA Building Inspector

to comply with the training requirements of
TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

167196
Certificate Number



Instructor



May 2, 2018
Date(s) of Training

Expires in 1 year.

Exam Score:
If appropriate:

ARGUS PACIFIC, INC / 1900 WEST NICKERSON ST, SUITE 315 / SEATTLE, WASHINGTON 98119 / 206.285.3373 / ARGUSPACIFIC.COM



STATE WATER RESOURCES CONTROL BOARD
REGIONAL WATER QUALITY CONTROL BOARDS

CALIFORNIA STATE



ENVIRONMENTAL LABORATORY ACCREDITATION PROGRAM

CERTIFICATE OF ENVIRONMENTAL ACCREDITATION

Is hereby granted to

NVL Laboratory

4708 Aurora Avenue North

Seattle, WA 98103

Scope of the certificate is limited to the
"Fields of Testing"
which accompany this Certificate.

Continued accredited status depends on successful completion of on-site inspection,
proficiency testing studies, and payment of applicable fees.

This Certificate is granted in accordance with provisions of
Section 100825, et seq. of the Health and Safety Code.

Certificate No.: **2757**

Expiration Date: **9/30/2019**

Effective Date: **10/1/2018**

Sacramento, California
subject to forfeiture or revocation

A handwritten signature in black ink, reading "Christine Sotelo".

Christine Sotelo, Chief
Environmental Laboratory Accreditation Program



**CALIFORNIA STATE
ENVIRONMENTAL LABORATORY ACCREDITATION PROGRAM
Accredited Fields of Testing**



NVL Laboratories, Inc.
PLM Dept.
4708 Aurora Avenue North
Seattle, WA 98103
Phone: (206) 547-0100

Certificate No. 2757
Expiration Date 9/30/2019

Field of Testing: 121 - Bulk Asbestos Analysis of Hazardous Waste

121.010 001	Bulk Asbestos	EPA 600/M4-82-020
-------------	---------------	-------------------

United States Department of Commerce
National Institute of Standards and Technology



Certificate of Accreditation to ISO/IEC 17025:2005

NVLAP LAB CODE: 102063-0

NVL Laboratories, Inc.
Seattle, WA


*is accredited by the National Voluntary Laboratory Accreditation Program for specific services,
listed on the Scope of Accreditation, for:*

Asbestos Fiber Analysis

*This laboratory is accredited in accordance with the recognized International Standard ISO/IEC 17025:2005.
This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality
management system (refer to joint ISO-ILAC-IAF Communique dated January 2009).*

2018-10-01 through 2019-09-30

Effective Dates

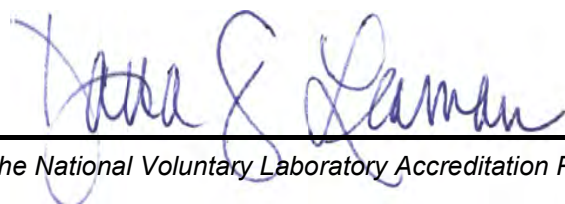

For the National Voluntary Laboratory Accreditation Program



AIHA Laboratory Accreditation Programs, LLC

acknowledges that

NVL Laboratories, Inc.

4708 Aurora Avenue N., Seattle, WA 98103

Laboratory ID: 101861

along with all premises from which key activities are performed, as listed above, has fulfilled the requirements of the AIHA Laboratory Accreditation Programs (AIHA-LAP), LLC accreditation to the ISO/IEC 17025:2005 international standard, *General Requirements for the Competence of Testing and Calibration Laboratories* in the following:

LABORATORY ACCREDITATION PROGRAMS

- ✓ **INDUSTRIAL HYGIENE**
- ✓ **ENVIRONMENTAL LEAD**
- ✓ **ENVIRONMENTAL MICROBIOLOGY**
- ☐ **FOOD**
- ✓ **UNIQUE SCOPES**

Accreditation Expires: June 01, 2019

Accreditation Expires: June 01, 2019

Accreditation Expires: June 01, 2019

Accreditation Expires:

Accreditation Expires: June 01, 2019

Specific Field(s) of Testing (FoT)/Method(s) within each Accreditation Program for which the above named laboratory maintains accreditation is outlined on the attached **Scope of Accreditation**. Continued accreditation is contingent upon successful on-going compliance with ISO/IEC 17025:2005 and AIHA-LAP, LLC requirements. This certificate is not valid without the attached **Scope of Accreditation**. Please review the AIHA-LAP, LLC website (www.aihaaccreditedlabs.org) for the most current Scope.

William Walsh, CIH
Chairperson, Analytical Accreditation Board

Cheryl O. Morton
Managing Director, AIHA Laboratory Accreditation Programs, LLC

Revision 15: 03/30/2016

Date Issued: 05/31/2017



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

NVL Laboratories, Inc.

4708 Aurora Avenue N., Seattle, WA 98103

Laboratory ID: **101861**

Issue Date: 05/31/2017

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

Industrial Hygiene Laboratory Accreditation Program (IHLAP)

Initial Accreditation Date: 04/01/1997

IHLAP Scope Category	Field of Testing (FoT) (FoTs cover all relevant IH matrices)	Technology sub-type/ Detector	Published Reference Method/Title of In-house Method	Method Description or Analyte <i>(for internal methods only)</i>
Spectrometry Core	Inductively-Coupled Plasma	ICP/AES	EPA 3051	
			NIOSH 7300 Modified	
	X-ray Diffraction (XRD)		NIOSH 7500	
Asbestos/Fiber Microscopy Core	Phase Contrast Microscopy (PCM)		NIOSH 7400	
Miscellaneous Core	Gravimetric		NIOSH 0500 Modified	
			NIOSH 0600 Modified	

A complete listing of currently accredited Industrial Hygiene laboratories is available on the AIHA-LAP, LLC website at: <http://www.aihaaccreditedlabs.org>



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

NVL Laboratories, Inc.

4708 Aurora Avenue N., Seattle, WA 98103

Laboratory ID: **101861**

Issue Date: 05/31/2017

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

The EPA recognizes the AIHA-LAP, LLC ELLAP program as meeting the requirements of the National Lead Laboratory Accreditation Program (NLLAP) established under Title X of the Residential Lead-Based Paint Hazard Reduction Act of 1992 and includes paint, soil and dust wipe analysis. Air and composited wipes analyses are not included as part of the NLLAP.

Environmental Lead Laboratory Accreditation Program (ELLAP)

Initial Accreditation Date: 02/07/1997

Field of Testing (FoT)	Technology sub-type/ Detector	Method	Method Description (for internal methods only)
Paint		EPA SW-846 3051	
		EPA SW-846 7000B	
Soil		EPA SW-846 3051	
		EPA SW-846 7000B	
Settled Dust by Wipe		EPA SW-846 3051	
		EPA SW-846 7000B	
Airborne Dust		EPA SW-846 3051	
		NIOSH 7082	

A complete listing of currently accredited Environmental Lead laboratories is available on the AIHA-LAP, LLC website at: <http://www.aihaaccreditedlabs.org>



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

NVL Laboratories, Inc.

4708 Aurora Avenue N., Seattle, WA 98103

Laboratory ID: **101861**

Issue Date: 05/31/2017

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

Environmental Microbiology Laboratory Accreditation Program (EMLAP)

Initial Accreditation Date: 02/01/1997

EMLAP Category	Field of Testing (FoT)	Method	Method Description <i>(for internal methods only)</i>
Fungal	Air - Direct Examination	SOP 12.133	In-House: Analysis of Spore Trap
	Bulk - Direct Examination	SOP 12.133	In-House: Bulk Analysis
	Surface - Direct Examination	SOP 12.133	In-House: Surface Analysis

A complete listing of currently accredited Environmental Microbiology laboratories is available on the AIHA-LAP, LLC website at: <http://www.aihaaccreditedlabs.org>



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

NVL Laboratories, Inc.

4708 Aurora Avenue N., Seattle, WA 98103

Laboratory ID: **101861**

Issue Date: 05/31/2017

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

Unique Scopes Laboratory Accreditation Program (Unique Scopes)

Initial Accreditation Date: 04/01/2013

Unique Scope Category	Field of Testing (FoT)	Method	Method Description <i>(for internal methods only)</i>
Consumer Product Testing	Lead in Paint and Other Similar Surface Coatings	CPSC-CH-E1003-09.1	
	Total Lead in Metal Children's Products	CPSC-CH-E1001-08.2	
	Total Lead in Non-Metal Children's Products	CPSC-CH-E1002-08.1	

A complete listing of currently accredited Unique Scope laboratories is available on the AIHA-LAP, LLC website at: <http://www.aihaaccreditedlabs.org>



STATE WATER RESOURCES CONTROL BOARD
REGIONAL WATER QUALITY CONTROL BOARDS

CALIFORNIA STATE



ENVIRONMENTAL LABORATORY ACCREDITATION PROGRAM

CERTIFICATE OF ENVIRONMENTAL LABORATORY ACCREDITATION

Is hereby granted to

EMSL Analytical Inc.

200 Route 130 North
Cinnaminson, NJ 08077

Scope of the certificate is limited to the
"Fields of Testing"
which accompany this Certificate.

Continued accredited status depends on successful completion of on-site inspection,
proficiency testing studies, and payment of applicable fees.

This Certificate is granted in accordance with provisions of
Section 100825, et seq. of the Health and Safety Code.

Certificate No.: **1877**

Expiration Date: **3/31/2017**

Effective Date: **4/1/2015**

Sacramento, California
subject to forfeiture or revocation

Christine Sotelo, Chief
Environmental Laboratory Accreditation Program



EMSL Analytical Inc.

200 Route 130 North
Cinnaminson, NJ 08077
Phone: (800) 220-3675

Certificate No. 1877
Expiration Date 3/31/2017

Field of Testing: 102 - Inorganic Chemistry of Drinking Water

102.030	001	Bromide	EPA 300.0
102.030	003	Chloride	EPA 300.0
102.030	005	Fluoride	EPA 300.0
102.030	006	Nitrate	EPA 300.0
102.030	007	Nitrite	EPA 300.0
102.030	008	Phosphate, Ortho	EPA 300.0
102.030	009	Sulfate	EPA 300.0
102.100	001	Alkalinity	SM2320B
102.130	001	Conductivity	SM2510B
102.140	001	Total Dissolved Solids	SM2540C
102.175	001	Chlorine, Free and Total	SM4500-Cl G
102.190	001	Cyanide, Total	SM4500-CN E
102.192	001	Cyanide, amenable	SM4500-CN G
102.262	001	Total Organic Carbon TOC	SM5310C
102.270	001	Surfactants	SM5540C
102.520	001	Calcium	EPA 200.7
102.520	002	Magnesium	EPA 200.7
102.520	003	Potassium	EPA 200.7
102.520	004	Silica	EPA 200.7
102.520	005	Sodium	EPA 200.7
102.520	006	Hardness (calculation)	EPA 200.7

Field of Testing: 103 - Toxic Chemical Elements of Drinking Water

103.030	001	Mercury	SM3112B
103.060	001	Aluminum	SM3120B
103.060	003	Barium	SM3120B
103.060	007	Chromium	SM3120B
103.060	009	Iron	SM3120B
103.060	011	Manganese	SM3120B
103.060	015	Silver	SM3120B
103.060	017	Zinc	SM3120B
103.130	007	Chromium	EPA 200.7
103.130	008	Copper	EPA 200.7
103.130	009	Iron	EPA 200.7
103.130	011	Manganese	EPA 200.7
103.130	015	Silver	EPA 200.7
103.130	017	Zinc	EPA 200.7
103.140	001	Aluminum	EPA 200.8
103.140	002	Antimony	EPA 200.8

As of 9/16/2015, this list supersedes all previous lists for this certificate number.
Customers: Please verify the current accreditation standing with the State.

103.140	003	Arsenic	EPA 200.8
103.140	004	Barium	EPA 200.8
103.140	005	Beryllium	EPA 200.8
103.140	006	Cadmium	EPA 200.8
103.140	007	Chromium	EPA 200.8
103.140	008	Copper	EPA 200.8
103.140	009	Lead	EPA 200.8
103.140	010	Manganese	EPA 200.8
103.140	012	Nickel	EPA 200.8
103.140	013	Selenium	EPA 200.8
103.140	014	Silver	EPA 200.8
103.140	015	Thallium	EPA 200.8
103.140	016	Zinc	EPA 200.8
103.150	009	Lead	EPA 200.9
103.160	001	Mercury	EPA 245.1
103.300	001	Asbestos	EPA 100.1
103.301	001	Asbestos	EPA 100.2

Field of Testing: 104 - Volatile Organic Chemistry of Drinking Water

104.040	000	Volatile Organic Compounds	EPA 524.2
104.040	001	Benzene	EPA 524.2
104.040	007	n-Butylbenzene	EPA 524.2
104.040	008	sec-Butylbenzene	EPA 524.2
104.040	009	tert-Butylbenzene	EPA 524.2
104.040	010	Carbon Tetrachloride	EPA 524.2
104.040	011	Chlorobenzene	EPA 524.2
104.040	015	2-Chlorotoluene	EPA 524.2
104.040	016	4-Chlorotoluene	EPA 524.2
104.040	019	1,3-Dichlorobenzene	EPA 524.2
104.040	020	1,2-Dichlorobenzene	EPA 524.2
104.040	021	1,4-Dichlorobenzene	EPA 524.2
104.040	022	Dichlorodifluoromethane	EPA 524.2
104.040	023	1,1-Dichloroethane	EPA 524.2
104.040	024	1,2-Dichloroethane	EPA 524.2
104.040	025	1,1-Dichloroethene	EPA 524.2
104.040	026	cis-1,2-Dichloroethene	EPA 524.2
104.040	027	trans-1,2-Dichloroethene	EPA 524.2
104.040	028	Dichloromethane	EPA 524.2
104.040	029	1,2-Dichloropropane	EPA 524.2
104.040	033	cis-1,3-Dichloropropene	EPA 524.2
104.040	034	trans-1,3-Dichloropropene	EPA 524.2
104.040	035	Ethylbenzene	EPA 524.2
104.040	037	Isopropylbenzene	EPA 524.2
104.040	039	Naphthalene	EPA 524.2
104.040	041	N-propylbenzene	EPA 524.2
104.040	042	Styrene	EPA 524.2
104.040	044	1,1,2,2-Tetrachloroethane	EPA 524.2
104.040	045	Tetrachloroethene	EPA 524.2

As of 9/16/2015, this list supersedes all previous lists for this certificate number.
Customers: Please verify the current accreditation standing with the State.

104.040	046	Toluene	EPA 524.2
104.040	048	1,2,4-Trichlorobenzene	EPA 524.2
104.040	049	1,1,1-Trichloroethane	EPA 524.2
104.040	050	1,1,2-Trichloroethane	EPA 524.2
104.040	051	Trichloroethene	EPA 524.2
104.040	052	Trichlorofluoromethane	EPA 524.2
104.040	054	1,2,4-Trimethylbenzene	EPA 524.2
104.040	055	1,3,5-Trimethylbenzene	EPA 524.2
104.040	056	Vinyl Chloride	EPA 524.2
104.040	057	Xylenes, Total	EPA 524.2
104.045	001	Bromodichloromethane	EPA 524.2
104.045	002	Bromoform	EPA 524.2
104.045	003	Chloroform	EPA 524.2
104.045	004	Dibromochloromethane	EPA 524.2
104.050	002	Methyl tert-butyl Ether (MTBE)	EPA 524.2
104.050	006	tert-Butyl Alcohol (TBA)	EPA 524.2
104.050	008	Carbon Disulfide	EPA 524.2
104.050	009	Methyl Isobutyl Ketone	EPA 524.2

Field of Testing: 109 - Toxic Chemical Elements of Wastewater

109.010	001	Aluminum	EPA 200.7
109.010	002	Antimony	EPA 200.7
109.010	003	Arsenic	EPA 200.7
109.010	004	Barium	EPA 200.7
109.010	005	Beryllium	EPA 200.7
109.010	007	Cadmium	EPA 200.7
109.010	009	Chromium	EPA 200.7
109.010	010	Cobalt	EPA 200.7
109.010	011	Copper	EPA 200.7
109.010	012	Iron	EPA 200.7
109.010	013	Lead	EPA 200.7
109.010	015	Manganese	EPA 200.7
109.010	016	Molybdenum	EPA 200.7
109.010	017	Nickel	EPA 200.7
109.010	019	Selenium	EPA 200.7
109.010	021	Silver	EPA 200.7
109.010	023	Thallium	EPA 200.7
109.010	024	Tin	EPA 200.7
109.010	026	Vanadium	EPA 200.7
109.010	027	Zinc	EPA 200.7
109.020	001	Aluminum	EPA 200.8
109.020	002	Antimony	EPA 200.8
109.020	003	Arsenic	EPA 200.8
109.020	004	Barium	EPA 200.8
109.020	005	Beryllium	EPA 200.8
109.020	006	Cadmium	EPA 200.8
109.020	007	Chromium	EPA 200.8
109.020	008	Cobalt	EPA 200.8

As of 9/16/2015, this list supersedes all previous lists for this certificate number.
Customers: Please verify the current accreditation standing with the State.

109.020	009	Copper	EPA 200.8
109.020	010	Lead	EPA 200.8
109.020	011	Manganese	EPA 200.8
109.020	012	Molybdenum	EPA 200.8
109.020	013	Nickel	EPA 200.8
109.020	014	Selenium	EPA 200.8
109.020	015	Silver	EPA 200.8
109.020	016	Thallium	EPA 200.8
109.020	017	Vanadium	EPA 200.8
109.020	018	Zinc	EPA 200.8
109.020	021	Iron	EPA 200.8
109.020	022	Tin	EPA 200.8
109.020	023	Titanium	EPA 200.8
109.025	010	Lead	EPA 200.9
109.190	001	Mercury	EPA 245.1
109.370	007	Gold	SM3111B
109.370	010	Lead	SM3111B
109.370	014	Palladium	SM3111B
109.370	015	Platinum	SM3111B
109.400	001	Mercury	SM3112B
109.430	001	Aluminum	SM3120B
109.430	002	Antimony	SM3120B
109.430	005	Beryllium	SM3120B
109.430	007	Cadmium	SM3120B
109.430	009	Chromium	SM3120B
109.430	010	Cobalt	SM3120B
109.430	011	Copper	SM3120B
109.430	012	Iron	SM3120B
109.430	013	Lead	SM3120B
109.430	015	Manganese	SM3120B
109.430	016	Molybdenum	SM3120B
109.430	017	Nickel	SM3120B
109.430	019	Selenium	SM3120B
109.430	021	Silver	SM3120B
109.430	024	Vanadium	SM3120B
109.430	025	Zinc	SM3120B
109.811	001	Chromium (VI)	SM3500-Cr D (18th/19th)

Field of Testing: 114 - Inorganic Chemistry of Hazardous Waste

114.010	001	Antimony	EPA 6010B
114.010	002	Arsenic	EPA 6010B
114.010	003	Barium	EPA 6010B
114.010	004	Beryllium	EPA 6010B
114.010	005	Cadmium	EPA 6010B
114.010	006	Chromium	EPA 6010B
114.010	007	Cobalt	EPA 6010B
114.010	008	Copper	EPA 6010B
114.010	009	Lead	EPA 6010B

As of 9/16/2015, this list supersedes all previous lists for this certificate number.
Customers: Please verify the current accreditation standing with the State.

114.010	010	Molybdenum	EPA 6010B
114.010	011	Nickel	EPA 6010B
114.010	012	Selenium	EPA 6010B
114.010	013	Silver	EPA 6010B
114.010	014	Thallium	EPA 6010B
114.010	015	Vanadium	EPA 6010B
114.010	016	Zinc	EPA 6010B
114.020	001	Antimony	EPA 6020
114.020	002	Arsenic	EPA 6020
114.020	003	Barium	EPA 6020
114.020	004	Beryllium	EPA 6020
114.020	005	Cadmium	EPA 6020
114.020	006	Chromium	EPA 6020
114.020	007	Cobalt	EPA 6020
114.020	008	Copper	EPA 6020
114.020	009	Lead	EPA 6020
114.020	010	Molybdenum	EPA 6020
114.020	011	Nickel	EPA 6020
114.020	012	Selenium	EPA 6020
114.020	013	Silver	EPA 6020
114.020	014	Thallium	EPA 6020
114.020	015	Vanadium	EPA 6020
114.020	016	Zinc	EPA 6020
114.103	001	Chromium (VI)	EPA 7196A
114.130	001	Lead	EPA 7420
114.131	001	Lead	EPA 7421
114.140	001	Mercury	EPA 7470A
114.141	001	Mercury	EPA 7471A

Field of Testing: 115 - Extraction Test of Hazardous Waste

115.020	001	Toxicity Characteristic Leaching Procedure (TCLP)	EPA 1311
115.030	001	Waste Extraction Test (WET)	CCR Chapter 11, Article 5, Appendix II

Field of Testing: 116 - Volatile Organic Chemistry of Hazardous Waste

116.010	000	EDB and DBCP	EPA 8011
116.020	030	Nonhalogenated Volatiles	EPA 8015B
116.020	031	Ethanol and Methanol	EPA 8015B
116.030	001	Gasoline-range Organics	EPA 8015B
116.080	000	Volatile Organic Compounds	EPA 8260B
116.080	120	Oxygenates	EPA 8260B

Field of Testing: 117 - Semi-volatile Organic Chemistry of Hazardous Waste

117.010	001	Diesel-range Total Petroleum Hydrocarbons	EPA 8015B
117.110	000	Extractable Organics	EPA 8270C
117.210	000	Pesticides & PCBs	EPA 8081A
117.220	000	PCBs	EPA 8082
117.250	000	Chlorinated Herbicides	EPA 8151A

Field of Testing: 121 - Bulk Asbestos Analysis of Hazardous Waste

121.010	001	Bulk Asbestos	EPA 600/M4-82-020
---------	-----	---------------	-------------------

As of 9/16/2015, this list supersedes all previous lists for this certificate number.
Customers: Please verify the current accreditation standing with the State.

Field of Testing: 129 - Cryptosporidium & Giardia

129.020	001	Cryptosporidium and Giardia	EPA 1623
129.030	001	Cryptosporidium and Giardia	EPA 1623.1



OREGON

Environmental Laboratory Accreditation Program

ORELAP Fields of Accreditation

ORELAP ID: WA100009

EPA CODE: WA01224

Certificate: WA100009 - 012



Fremont Analytical, Inc.

3600 Fremont Ave. N

Seattle, WA 98103

Issue Date: 5/10/2018 Expiration Date: 5/9/2019

As of 5/10/2018 this list supersedes all previous lists for this certificate number.

Solids

EPA 8270D

5562 Azobenzene
5595 Benzidine
5575 Benzo(a)anthracene
5580 Benzo(a)pyrene
5590 Benzo(g,h,i)perylene
9309 Benzo(j)fluoranthene
5600 Benzo(k)fluoranthene
5585 Benzo[b]fluoranthene
5610 Benzoic acid
5630 Benzyl alcohol
5760 bis(2-Chloroethoxy)methane
5765 bis(2-Chloroethyl) ether
5780 bis(2-Chloroisopropyl) ether
6062 bis(2-Ethylhexyl)adipate
5670 Butyl benzyl phthalate
5680 Carbazole
5855 Chrysene
6065 Di(2-ethylhexyl) phthalate (bis(2-Ethylhexyl)phthalate, DEHP)
9354 Dibenz(a, h) acridine
5900 Dibenz(a, j) acridine
5895 Dibenz(a,h) anthracene
9348 Dibenzo(a, h) pyrene
5890 Dibenzo(a,e) pyrene
5905 Dibenzofuran
6070 Diethyl phthalate
6135 Dimethyl phthalate
5925 Di-n-butyl phthalate
6200 Di-n-octyl phthalate
6205 Diphenylamine
6265 Fluoranthene
6270 Fluorene
6275 Hexachlorobenzene
4835 Hexachlorobutadiene
6285 Hexachlorocyclopentadiene
4840 Hexachloroethane
6315 Indeno(1,2,3-cd) pyrene
6320 Isophorone
5005 Naphthalene
5015 Nitrobenzene
6525 n-Nitrosodiethylamine
6530 n-Nitrosodimethylamine
6545 n-Nitrosodi-n-propylamine
6535 n-Nitrosodiphenylamine



OREGON

Environmental Laboratory Accreditation Program

ORELAP Fields of Accreditation

ORELAP ID: WA100009

EPA CODE: WA01224

Certificate: WA100009 - 012



Fremont Analytical, Inc.

3600 Fremont Ave. N

Seattle, WA 98103

Issue Date: 5/10/2018 Expiration Date: 5/9/2019

As of 5/10/2018 this list supersedes all previous lists for this certificate number.

Solids

EPA 8270D

6605 Pentachlorophenol
6608 Perylene
6615 Phenanthrene
6625 Phenol
6665 Pyrene
5095 Pyridine

EPA 8270D
SIM

10242509

Semivolatile Organic compounds by
GC/MS Selective Ion Monitoring

6380 1-Methylnaphthalene
6385 2-Methylnaphthalene
5500 Acenaphthene
5505 Acenaphthylene
5555 Anthracene
5575 Benzo(a)anthracene
5580 Benzo(a)pyrene
5590 Benzo(g,h,i)perylene
5600 Benzo(k)fluoranthene
5585 Benzo[b]fluoranthene
5670 Butyl benzyl phthalate
5855 Chrysene
6065 Di(2-ethylhexyl) phthalate (bis(2-Ethylhexyl)phthalate, DEHP)
5895 Dibenz(a,h) anthracene
5905 Dibenzofuran
6070 Diethyl phthalate
6135 Dimethyl phthalate
5925 Di-n-butyl phthalate
6200 Di-n-octyl phthalate
6265 Fluoranthene
6270 Fluorene
6315 Indeno(1,2,3-cd) pyrene
5005 Naphthalene
6605 Pentachlorophenol
6615 Phenanthrene
6665 Pyrene

EPA 8270E

988

Semivolatile Organic compounds by
Gas Chromatography/Mass
Spectrometry (GC/MS)

5155 1,2,4-Trichlorobenzene

EPA 8270E

10242543

Semivolatile Organic compounds by
GC/MS

5155 1,2,4-Trichlorobenzene
4610 1,2-Dichlorobenzene
6155 1,2-Dinitrobenzene
4615 1,3-Dichlorobenzene



OREGON

Environmental Laboratory Accreditation Program

ORELAP Fields of Accreditation

ORELAP ID: WA100009

EPA CODE: WA01224

Certificate: WA100009 - 012



Fremont Analytical, Inc.

3600 Fremont Ave. N

Seattle, WA 98103

Issue Date: 5/10/2018 Expiration Date: 5/9/2019

As of 5/10/2018 this list supersedes all previous lists for this certificate number.

Solids	EPA 8270E	6160	1,3-Dinitrobenzene (1,3-DNB)
		4620	1,4-Dichlorobenzene
		6165	1,4-Dinitrobenzene
		6380	1-Methylnaphthalene
		4659	2,2-Oxybis(1-chloropropane)
		6735	2,3,4,6-Tetrachlorophenol
		6740	2,3,5,6-Tetrachlorophenol
		6835	2,4,5-Trichlorophenol
		6840	2,4,6-Trichlorophenol
		6000	2,4-Dichlorophenol
		6130	2,4-Dimethylphenol
		6175	2,4-Dinitrophenol
		6185	2,4-Dinitrotoluene (2,4-DNT)
		6190	2,6-Dinitrotoluene (2,6-DNT)
		5795	2-Chloronaphthalene
		5800	2-Chlorophenol
		6360	2-Methyl-4,6-dinitrophenol (4,6-Dinitro-2-methylphenol)
		5145	2-Methylaniline (o-Toluidine)
		6385	2-Methylnaphthalene
		6400	2-Methylphenol (o-Cresol)
		6460	2-Nitroaniline
		6490	2-Nitrophenol
		6412	3 & 4 Methylphenol
		5945	3,3'-Dichlorobenzidine
		6355	3-Methylcholanthrene
		6465	3-Nitroaniline
		5660	4-Bromophenyl phenyl ether (BDE-3)
		5700	4-Chloro-3-methylphenol
		5745	4-Chloroaniline
		5825	4-Chlorophenyl phenylether
		6470	4-Nitroaniline
		6500	4-Nitrophenol
		5500	Acenaphthene
		5505	Acenaphthylene
		5510	Acetophenone
		5545	Aniline
		5555	Anthracene
		5562	Azobenzene
		5570	Benzaldehyde
		5595	Benzydine
		5575	Benzo(a)anthracene
		5580	Benzo(a)pyrene
		5590	Benzo(g,h,i)perylene



OREGON

Environmental Laboratory Accreditation Program

ORELAP Fields of Accreditation

ORELAP ID: WA100009

EPA CODE: WA01224

Certificate: WA100009 - 012



Fremont Analytical, Inc.

3600 Fremont Ave. N

Seattle, WA 98103

Issue Date: 5/10/2018 Expiration Date: 5/9/2019

As of 5/10/2018 this list supersedes all previous lists for this certificate number.

Solids

EPA 8270E

9309 Benzo(j)fluoranthene
5600 Benzo(k)fluoranthene
5585 Benzo[b]fluoranthene
5610 Benzoic acid
5630 Benzyl alcohol
5635 Benzyl chloride
5760 bis(2-Chloroethoxy)methane
5765 bis(2-Chloroethyl) ether
5780 bis(2-Chloroisopropyl) ether
6062 bis(2-Ethylhexyl)adipate
5670 Butyl benzyl phthalate
5680 Carbazole
5855 Chrysene
6065 Di(2-ethylhexyl) phthalate (bis(2-Ethylhexyl)phthalate, DEHP)
9354 Dibenz(a, h) acridine
5900 Dibenz(a, j) acridine
5895 Dibenz(a,h) anthracene
9348 Dibenzo(a, h) pyrene
9351 Dibenzo(a, i) pyrene
5890 Dibenzo(a,e) pyrene
5905 Dibenzofuran
6070 Diethyl phthalate
6135 Dimethyl phthalate
5925 Di-n-butyl phthalate
6200 Di-n-octyl phthalate
6205 Diphenylamine
6265 Fluoranthene
6270 Fluorene
6275 Hexachlorobenzene
4835 Hexachlorobutadiene
6285 Hexachlorocyclopentadiene
4840 Hexachloroethane
6315 Indeno(1,2,3-cd) pyrene
5005 Naphthalene
5015 Nitrobenzene
6530 n-Nitrosodimethylamine
6545 n-Nitrosodi-n-propylamine
6535 n-Nitrosodiphenylamine
6605 Pentachlorophenol
6608 Perylene
6615 Phenanthrene
6625 Phenol
7985 Phorate



OREGON

Environmental Laboratory Accreditation Program

ORELAP Fields of Accreditation

ORELAP ID: WA100009

EPA CODE: WA01224

Certificate: WA100009 - 012



Fremont Analytical, Inc.

3600 Fremont Ave. N

Seattle, WA 98103

Issue Date: 5/10/2018 Expiration Date: 5/9/2019

As of 5/10/2018 this list supersedes all previous lists for this certificate number.

Solids

EPA 8270E

6665 Pyrene
5095 Pyridine

EPA 8270E SIM

989

Semivolatile Organic compounds by
Gas Chromatography/Mass
Spectrometry (GC/MS) SIM Mode

6380 1-Methylnaphthalene
5795 2-Chloronaphthalene
6385 2-Methylnaphthalene
5500 Acenaphthene
5505 Acenaphthylene
5555 Anthracene
5575 Benzo(a)anthracene
5580 Benzo(a)pyrene
5590 Benzo(g,h,i)perylene
5600 Benzo(k)fluoranthene
5585 Benzo[b]fluoranthene
5670 Butyl benzyl phthalate
5680 Carbazole
5855 Chrysene
6065 Di(2-ethylhexyl) phthalate (bis(2-Ethylhexyl)phthalate, DEHP)
5895 Dibenz(a,h) anthracene
5905 Dibenzofuran
6070 Diethyl phthalate
6135 Dimethyl phthalate
5925 Di-n-butyl phthalate
6200 Di-n-octyl phthalate
6265 Fluoranthene
6270 Fluorene
6315 Indeno(1,2,3-cd) pyrene
5005 Naphthalene
6605 Pentachlorophenol
6615 Phenanthrene
6665 Pyrene

NWTPH-Dx

90018409

Oregon DEQ TPH Diesel Range

9369 Diesel range organics (DRO)
9499 Motor Oil
2050 Total Petroleum Hydrocarbons (TPH)

NWTPH-Gx

90018603

Oregon DEQ TPH Gasoline Range
Organics by GC/FID-PID Purge & Trap

9408 Gasoline range organics (GRO)

Appendix B

California Waste Disposal Plan



**Lower Klamath Project
FERC Project No. 14803**

California Waste Disposal Plan

**Klamath River Renewal Corporation
2001 Addison Street, Suite 317
Berkeley, CA 94704**

**Prepared by:
Camas LLC
680 G Street, Suite C
Jacksonville, OR 97530**

December 2022

This page intentionally left blank.

Table of Contents

1.0	Introduction.....	1
1.1	Purpose of Waste Disposal Plan	1
1.2	Relationship to Other Management Plans	1
2.0	Quantity and Type of Anticipated Non-Hazardous Waste	1
2.1	Material Descriptions	3
3.0	Upland Disposal Sites.....	4
3.1	Erosion and Sediment Control	6
4.0	Powerhouse, Tailrace, and Spillway Disposal Sites.....	6
4.1	Erosion and Sediment Control	9
5.0	References	9

List of Tables

Table 2-1. Copco No. 1 and Copco No. 2 Developments Non-Hazardous Waste Disposal	2
Table 2-2. Iron Gate Development Non-Hazardous Waste Disposal	2
Table 2-3. Material Descriptions	3
Table 3-1. Upland Disposal Sites.....	5
Table 4-1. Powerhouse and Tailrace and Spillway Disposal Sites.....	7

Appendices

Appendix A	Figures
------------	---------

1.0 Introduction

The California Waste Disposal Plan is a sub-plan of the Waste Disposal and Hazardous Materials Management Plan to be implemented as part of the Proposed Action for the Lower Klamath Project.

1.1 Purpose of Waste Disposal Plan

The California Waste Disposal Plan describes the measures the Renewal Corporation (directly or through its contractor) will implement to manage non-hazardous waste resulting from the Proposed Action for portions located in California.

Non-hazardous waste will be stored, managed, and disposed of in accordance with all local, state, and federal applicable laws. Additional consultation with Siskiyou County was conducted and the results of this consultation are included herein.

1.2 Relationship to Other Management Plans

The California Waste Disposal Plan is supported by elements of the following management plans for effective implementation: California Hazardous Materials Management Plan. So as not to duplicate information, elements from this other management plan are not repeated herein but are, where appropriate, referred to in this California Waste Disposal Plan.

2.0 Quantity and Type of Anticipated Non-Hazardous Waste

The precise quantities and types of non-hazardous wastes generated by the Proposed Action will be determined in connection with waste characterization activities at the time of generation. Generally accepted waste characterization procedures, which are described in the California Hazardous Materials Management Plan, will also be observed by the Renewal Corporation (directly or through its contractor) with respect to non-hazardous wastes.

Anticipated non-hazardous waste to be generated during the decommissioning of Copco No. 1, Copco No. 2, and Iron Gate Developments is presented in Table 2-1 and Table 2-2. Specifically, the approximate bulk quantity, type of anticipated non-hazardous waste, and the proposed disposal locations (on-site and off-site) are presented below and are based on the Knight Piésold 100% Design Report (Knight Piésold 2022a). A description of these materials is presented in Section 2.1 (Knight Piésold 2022b).

Table 2-1. Copco No. 1 and Copco No. 2 Developments Non-Hazardous Waste Disposal

TYPE	QUANTITY	ANTICIPATED DISPOSAL LOCATION
Earthen Material ¹	2,100 CY	Disposed of on-site: <ul style="list-style-type: none"> Copco No. 1 Disposal Site Copco No. 1 Powerhouse and Tailrace Disposal Site Copco No. 2 Tailrace Disposal Site
Concrete Rubble ¹	120,600 CY	Disposed of on-site: <ul style="list-style-type: none"> Copco No. 1 Disposal Site Copco No. 2 Tailrace Disposal Site
Building Waste ²	2,600 CY	Disposed of off-site: <ul style="list-style-type: none"> City of Yreka Landfill
Rebar	1,400 tons	Disposed of off-site: <ul style="list-style-type: none"> Schnitzer (recycled)
Mechanical and Electrical Materials	3,300 tons	Disposed of off-site: <ul style="list-style-type: none"> Permitted landfill, pending selected contractor
Transmission Lines	9.5 miles	Disposed off-site: <ul style="list-style-type: none"> Permitted landfill, pending selected contractor

Notes:

1. Subject to confirmation by waste characterization at the time of generation, it is anticipated that earthen materials and concrete rubble removed during decommissioning will constitute Inert waste.
2. Building waste, which is anticipated to be non-hazardous solid waste subject to confirmation by waste characterization, includes but is not limited to steel penstocks, generator equipment, gates, valves, lighting, HVAC etc.

Table 2-2. Iron Gate Development Non-Hazardous Waste Disposal

TYPE	QUANTITY	ANTICIPATED DISPOSAL LOCATION
Earthen Material ¹	1,257,000 CY	Disposed of on-site: <ul style="list-style-type: none"> Iron Gate Spillway Disposal Site Iron Gate Powerhouse and Tailrace Disposal Site Iron Gate Upland Disposal Site
Concrete Rubble ¹	20,700 CY	Disposed of on-site: <ul style="list-style-type: none"> Iron Gate Upland Disposal Site Iron Gate Powerhouse and Tailrace Disposal Site
Building Waste ²	600 CY	Disposed of off-site: <ul style="list-style-type: none"> City of Yreka Landfill
Rebar	700 tons	Disposed of off-site: <ul style="list-style-type: none"> Schnitzer (recycled)
Mechanical and Electrical Materials	1,200 tons	Disposed of off-site: <ul style="list-style-type: none"> Permitted landfill, pending selected contractor
Transmission Lines	0.5 miles	Disposed off-site: <ul style="list-style-type: none"> Permitted landfill, pending selected contractor

Notes:

1. Subject to confirmation by waste characterization at the time of generation, it is anticipated that earthen materials and concrete rubble removed during decommissioning will constitute Inert waste.
2. Building waste, which is anticipated to be non-hazardous solid waste subject to confirmation by waste characterization, includes but is not limited to steel penstocks, generator equipment, gates, valves, lighting, HVAC etc.

2.1 Material Descriptions

Table 2-3 includes materials that will either be placed within on-site disposal sites, used as a capping material, or for erosion and sediment control purposes. In addition, the source of the material is included in the table.

Table 2-3. Material Descriptions

TYPE	DESCRIPTION	DEFINITION
E4	Select Fill	Cobbles, Gravel, and Sand, particles ranging from 4 in. to the #200 Sieve (0.0030 in.), low to no fines content, sourced from offsite.
E6	Bedding	Cobbles and Gravel, particles ranging from 3 in. to 3/8 in., low to no fines content, sourced from offsite.
E7	Erosion Protection	Boulders and Cobbles, particles ranging from +50 in. to 3 in., material subdivided into three classifications E7a/b/c, each with minimum D85, D50 and D15 values, sourced from existing erosion protection at the dam sites, or talus material sourced from nearby borrow areas within limits of work.
E7a	Erosion Protection	Boulders and Cobbles with a nominal diameter size of 9 inches and varies from 5.5 inches to 11.5 inches
E7b	Erosion Protection	Boulders and Cobbles with a nominal diameter size of 21 inches and varies from 21 inches to 27.5 inches
E7c	Erosion Protection	Boulders and Cobbles with a nominal diameter size of 36 inches and varies from 22 inches to 47 inches
E8	Bedding Material	Cobbles and Gravel, particles ranging from 12 in. to 1 in., low to no fines content, sourced from offsite.
E9	General Fill (Earthen Material)	Boulders, Cobbles, Gravel, Sand and Fines, particles ranging from 20 in. to silt and clay, up to 30% fines content, sourced from project excavations or nearby borrow areas within limits of work.
E9a	General Fill (Earthen Material)	Boulders, Cobbles, Gravel, Sand and Fines, particles ranging from 20 in. to silt and clay, up to 40% fines content, sourced from project excavations or nearby borrow areas within limits of work.

TYPE	DESCRIPTION	DEFINITION
E9b	General Fill (Earthen Material)	Boulders, Cobbles, Gravel and Sand, particles ranging from 20 in. to the #200 sieve (0.0030 in), low to no fines content, sourced from project excavations or nearby borrows area within limits of work.
E10	Random Fill (Earthen Material)	Overburden, Rocks or Organics, no gradation requirements, sourced from project excavations.
CR1	Concrete Rubble ^{1,2}	Particles ranging from 36 in. to the #200 Sieve (0.0030 in.), with up to 30% fines content, steel reinforcement to remain concrete, sourced from demolition of onsite concrete structures.
CR2	Concrete Rubble ^{1,2}	Particles ranging from 24 in. to the #200 Sieve (0.0030 in.), with up to 30% fines content, steel reinforcement to remain concrete, sourced from demolition of onsite concrete structures.
NA	Riverbed Material	Material stockpiled on the right bank upstream of the Copco No. 1 Dam originates from the historic Copco No. 1 Dam excavation and is assumed to be suitable for direct placement as riverbed material. Riverbed material not sourced from this area must be well graded material with an upper particle size of approximately 36 inches, and a 15% maximum of material smaller than 6 inches (by volume).

Notes:

1. Hazardous materials and substances will be removed prior to burying concrete rubble in a disposal site.
2. If access to rebar is safe, rebar protruding out of concrete will be cut flush and recycled off-site. Rebar and steel embedded in concrete will remain in its encased condition and buried.

3.0 Upland Disposal Sites

General Fill (Earthen Material) and Concrete Rubble will be disposed of at two on-site upland disposal sites (Upland Disposal Sites). Details pertaining to the location, construction, size, disposal materials, and associated figures for each disposal site are presented in Table 3-1 and in Appendix A, Figures. Disposal site locations were selected where drainage patterns can be preserved, such that onsite disposal would not create a threat to water quality. Appendix A includes two figures for each disposal site: general site location and a plan and profile of the disposal sites.

Table 3-1. Upland Disposal Sites

LOCATION	CONSTRUCTION	SIZE/INFILL CAPACITY	DISPOSAL MATERIALS	FIGURES
COPCO NO. 1 DISPOSAL SITE				
<ul style="list-style-type: none"> Located within an existing depression between Copco No. 1 and Copco No. 2 dams, to the north. The location is approximately at 2,675 (MSL), which is 175 feet above the current Klamath River active stream channel (2,500 MSL). 	<ul style="list-style-type: none"> Located above anticipated post-drawdown Ordinary High Water Mark (OHWM). Demolish existing structures. Relocate existing powerlines. Clear vegetation. Place disposal materials on existing ground surface. 3H:1V slope range (maximum). Cap with a minimum of 2-foot cover of General Fill (E9/E9b). Grade and slope for drainage to surrounding topography. Final stabilization (see Section 3.1) 	<ul style="list-style-type: none"> Disposal area is approx. 5.2 acres. Infill capacity is approx. 189,000 CY. 	<ul style="list-style-type: none"> General Fill (E9). Concrete Rubble (CR1). 	<ul style="list-style-type: none"> Appendix A: Figure A-1. Copco No. 1 Disposal Site Appendix A: Figure A-2. Copco No. 1 Disposal Site – Plan and Profile
IRON GATE UPLAND DISPOSAL SITE				
<ul style="list-style-type: none"> Located in the original borrow site for the Iron Gate dam construction on the south side of the reservoir. The location is approximately 300 to 400 feet above the anticipated Klamath River active stream channel. 	<ul style="list-style-type: none"> Located above anticipated post-drawdown OHWM. Clear vegetation. Place disposal materials on existing ground surface. 5H:1V slope range (maximum). Cap with a minimum of 2-foot cover of General Fill (E9/E9b). Grade and slope for drainage to surrounding topography. Final stabilization (see Section 3.1) 	<ul style="list-style-type: none"> Disposal area is approx. 36 acres Infill capacity is approx. 1,000,000 CY. 	<ul style="list-style-type: none"> General Fill (E9). Random Fill (E10). 	<ul style="list-style-type: none"> Appendix A: Figure A-3. Iron Gate Disposal Site Locations Appendix A: Figure A-4. Iron Gate Upland Disposal Site – Plan and Profile

3.1 Erosion and Sediment Control

Erosion and sediment control temporary best management practices (BMPs) installed during the construction of the disposal sites will be presented in the site-specific Stormwater Pollution Prevention Plan (SWPP) required as part of the National Pollutant Discharge Elimination System (NPDES) California State Water Board Construction General Permit (CGP). If disposal areas are utilized during the rainy season, the disposal sites shall be protected with appropriate BMPs to prevent erosion.

Following the final placement of material within the disposal sites, permanent BMPs will be installed for final stabilization. Monitoring and reporting required as part of the CGP SWPP will be conducted to achieve final stabilization.

4.0 Powerhouse, Tailrace, and Spillway Disposal Sites

General Fill and Concrete Rubble will also be disposed of in existing structures (i.e., powerhouse, tailrace, and spillway). Details pertaining to the location, construction, size, disposal materials, location in relation to the anticipated post-drawdown OHWM and associated figures for each on-site disposal site are presented in Table 4-1. Appendix A includes two figures for each disposal site: general site location and a plan and profile of the disposal sites.

Table 4-1. Powerhouse and Tailrace and Spillway Disposal Sites

LOCATION	CONSTRUCTION	SIZE/INFILL CAPACITY	DISPOSAL MATERIALS	FIGURES
COPCO NO. 1 POWERHOUSE AND TAILRACE DISPOSAL SITE				
<ul style="list-style-type: none"> Located within a portion of existing Copco No.1 powerhouse and tailrace. 	<ul style="list-style-type: none"> Partially located below anticipated post-drawdown OHWM. Remove interior electrical, mechanical, and miscellaneous fixtures not imbedded in concrete from powerhouse prior to backfill. Place disposal materials within powerhouse and portion of tailrace. 1.5 H:1V slope range for powerhouse. 2 H:1V slope range for transition of powerhouse to tailrace. Cap with 4-foot cover of Select Fill (E4) on slope of former powerhouse. Cap with 1-foot cover of Riverbed Material and 4–7-foot cover of Erosion Protection (E7c) on transition of powerhouse to tailrace. Final stabilization of former powerhouse (see Section 4.1). 	<ul style="list-style-type: none"> Disposal area is approx. 0.38 acres Infill capacity is approx. 3,950 CY 	<ul style="list-style-type: none"> General Fill (E9/E9a). Concrete Rubble (CR2). 	<ul style="list-style-type: none"> Appendix A: Figure A-5. Copco No. 1 Powerhouse and Tailrace Disposal Site Appendix A: Figure A-6. Copco No. 1 Powerhouse and Tailrace Disposal Site – Plan Appendix A: Figure A-6a. Copco No. 1 Powerhouse and Tailrace Disposal Site – Profile
COPCO NO. 2 TAILRACE DISPOSAL SITE				
<ul style="list-style-type: none"> Located within a portion of existing Copco No. 2 tailrace. 	<ul style="list-style-type: none"> Partially located below anticipated post-drawdown OHWM. Place disposal materials within former tailrace Details for the placement of fill within the tailrace are currently being designed. Final erosion and sediment control stabilization (see Section 4.1). 	<ul style="list-style-type: none"> Details for the placement of fill within the tailrace are currently being designed. 	<ul style="list-style-type: none"> Details for the placement of fill within the tailrace are currently being designed. 	<ul style="list-style-type: none"> Appendix A: Figure A-7. Copco No. 2 Tailrace Disposal Site

LOCATION	CONSTRUCTION	SIZE/INFILL CAPACITY	DISPOSAL MATERIALS	FIGURES
IRON GATE POWERHOUSE AND TAILRACE DISPOSAL SITE				
<ul style="list-style-type: none"> Powerhouse tailrace located south of dam. 	<ul style="list-style-type: none"> Located partially below anticipated post-drawdown OHWM. Remove interior electrical, mechanical, and miscellaneous fixtures not imbedded in concrete from powerhouse prior to backfill. Place disposal materials within former tailrace and portion of powerhouse. 2.5H:1V slope range Cap former powerhouse portion with 3-foot cover of General Fill (E9) and the former tailrace portion (E7b) with 3-foot cover of Erosion Protection (E7b). Final erosion and sediment control stabilization (see Section 4.1). 	<ul style="list-style-type: none"> Disposal area is approx. 0.99 acres. Infill capacity is approx. 22,615 CY. 	<ul style="list-style-type: none"> General Fill (E9). Concrete Rubble (CR1 and CR2). 	<ul style="list-style-type: none"> Appendix A: Figure A-3. Iron Gate Disposal Site Locations Appendix A: Figure A-8a. Iron Gate Powerhouse Disposal Site – Plan Appendix A: Figure A-8b. Iron Gate Powerhouse Disposal Site – Profile
IRON GATE SPILLWAY DISPOSAL SITE				
<ul style="list-style-type: none"> Spillway located west of dam on river right. 	<ul style="list-style-type: none"> Located above anticipated post-drawdown OHWM. Place disposal materials in existing concrete spillway. Cap horizontal portion with 2-foot General Fill (E9) Place Erosion Protection (E7a/E7b) on downstream toe of spillway or riprap removed from downstream face of dam for lower spillway lifts to establish riprapped toe. Final erosion and sediment control stabilization (see Section 4.1). 	<ul style="list-style-type: none"> Disposal area is approx. 4.2 acres. Infill capacity is approx. 249,200 CY. 	<ul style="list-style-type: none"> General Fill (E9/E9a/E9b) Random Fill (E10) 	<ul style="list-style-type: none"> Appendix A: Figure A-3. Iron Gate Disposal Site Locations Figure A-9. Iron Gate Spillway Disposal Site – Plan and Profile

4.1 Erosion and Sediment Control

Erosion and sediment control temporary BMPs installed during the construction of the disposal sites will be presented in the site-specific SWPP required as part of the NPDES California State Water Board CGP. If disposal areas are utilized during the rainy season, the disposal sites will be protected with appropriate BMPs to prevent erosion.

Following the final placement of material within the disposal sites, permanent BMPs will be installed for final stabilization. Monitoring and reporting required as part of the CGP SWPP will be conducted to achieve final stabilization.

5.0 References


Knight Piésold. 2022a. Design Report. Prepared for Klamath River Renewal Project. June.

Knight Piésold. 2022b. Technical Specifications. Prepared for Klamath River Renewal Project. June.

Appendix A

Figures

Document Path: C:\Users\hmm\OneDrive\Klamath_River_Renewal_MIA\GIS_Request_Tracking\GIS_Requests_Management_Plan\Corona_MPA\MPA1A_1_2020_01_1_disposal.mxd

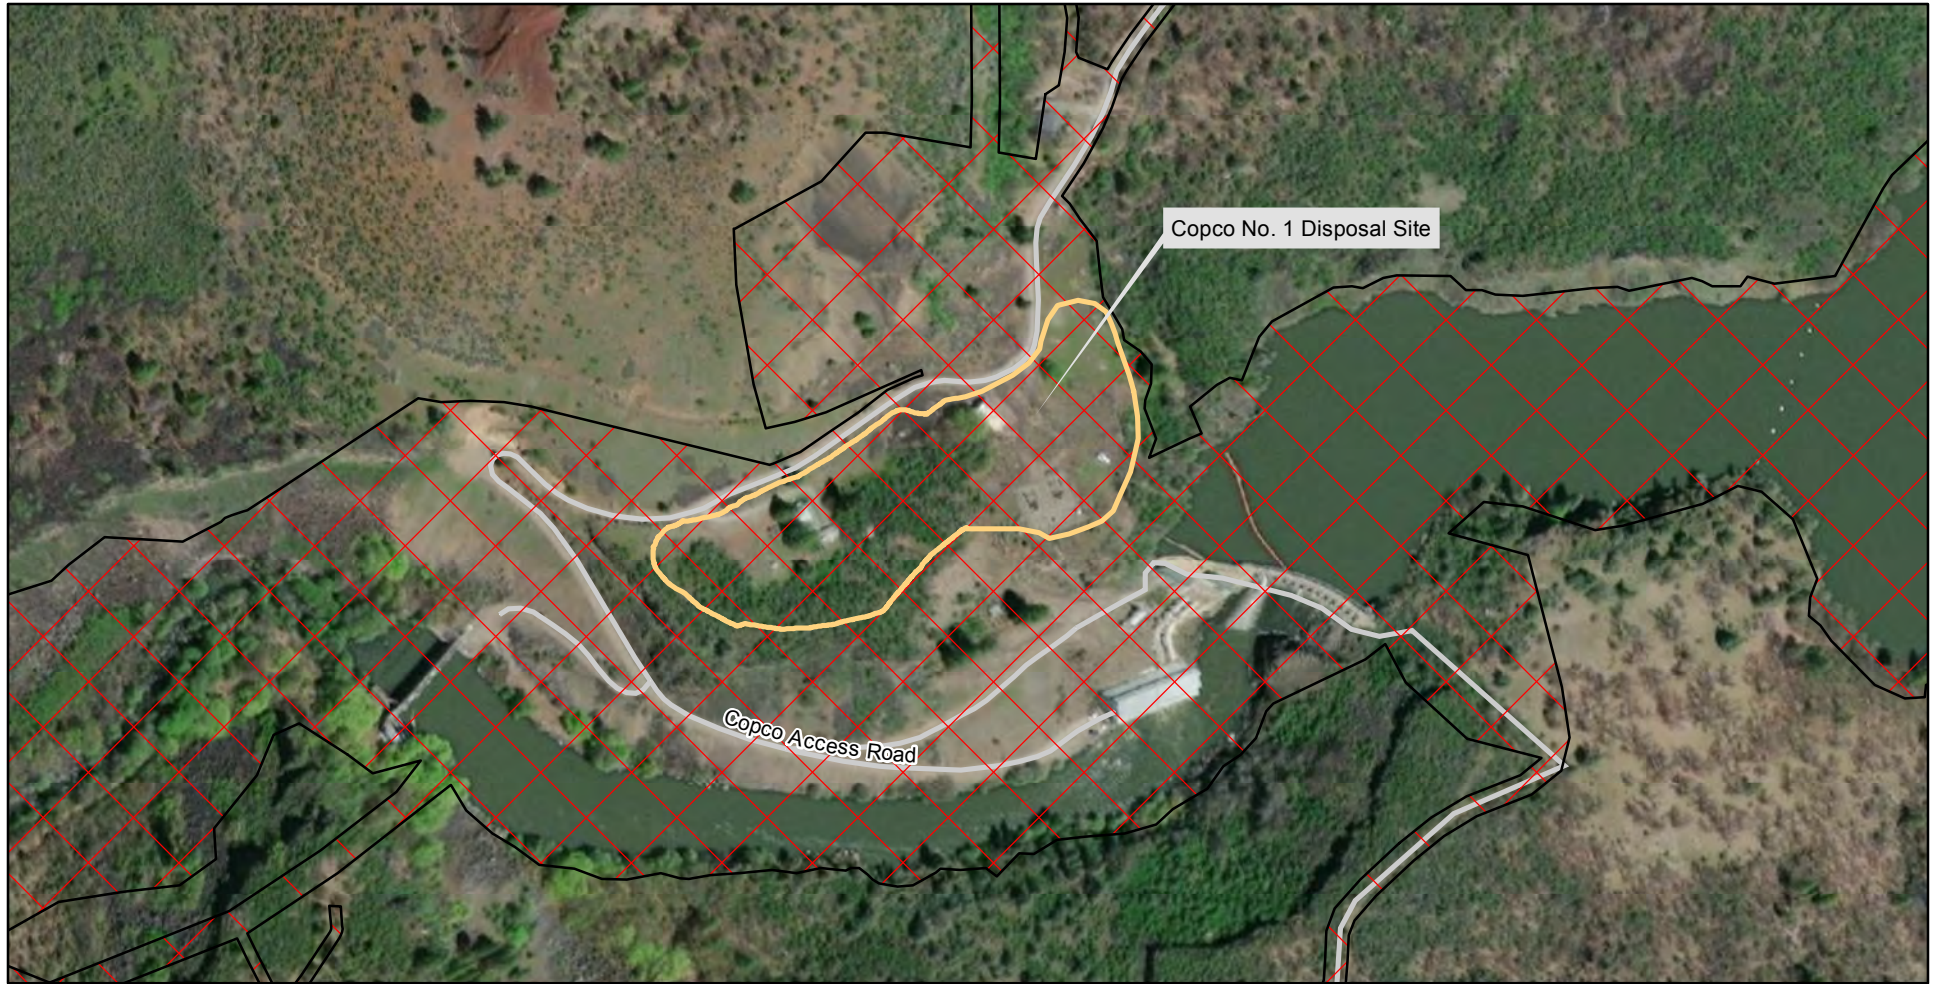




0 145 290 580
Feet

(At original document size of 8.5 x 11)
1:4,090

Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites, Limits of Work and Access Routes: Knight Piesold 100 design
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

Legend


-  Disposal Sites
-  Limits of Work
-  Roads

Lower Klamath Project
Figure A-1: Copco No. 1 Disposal Site



PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

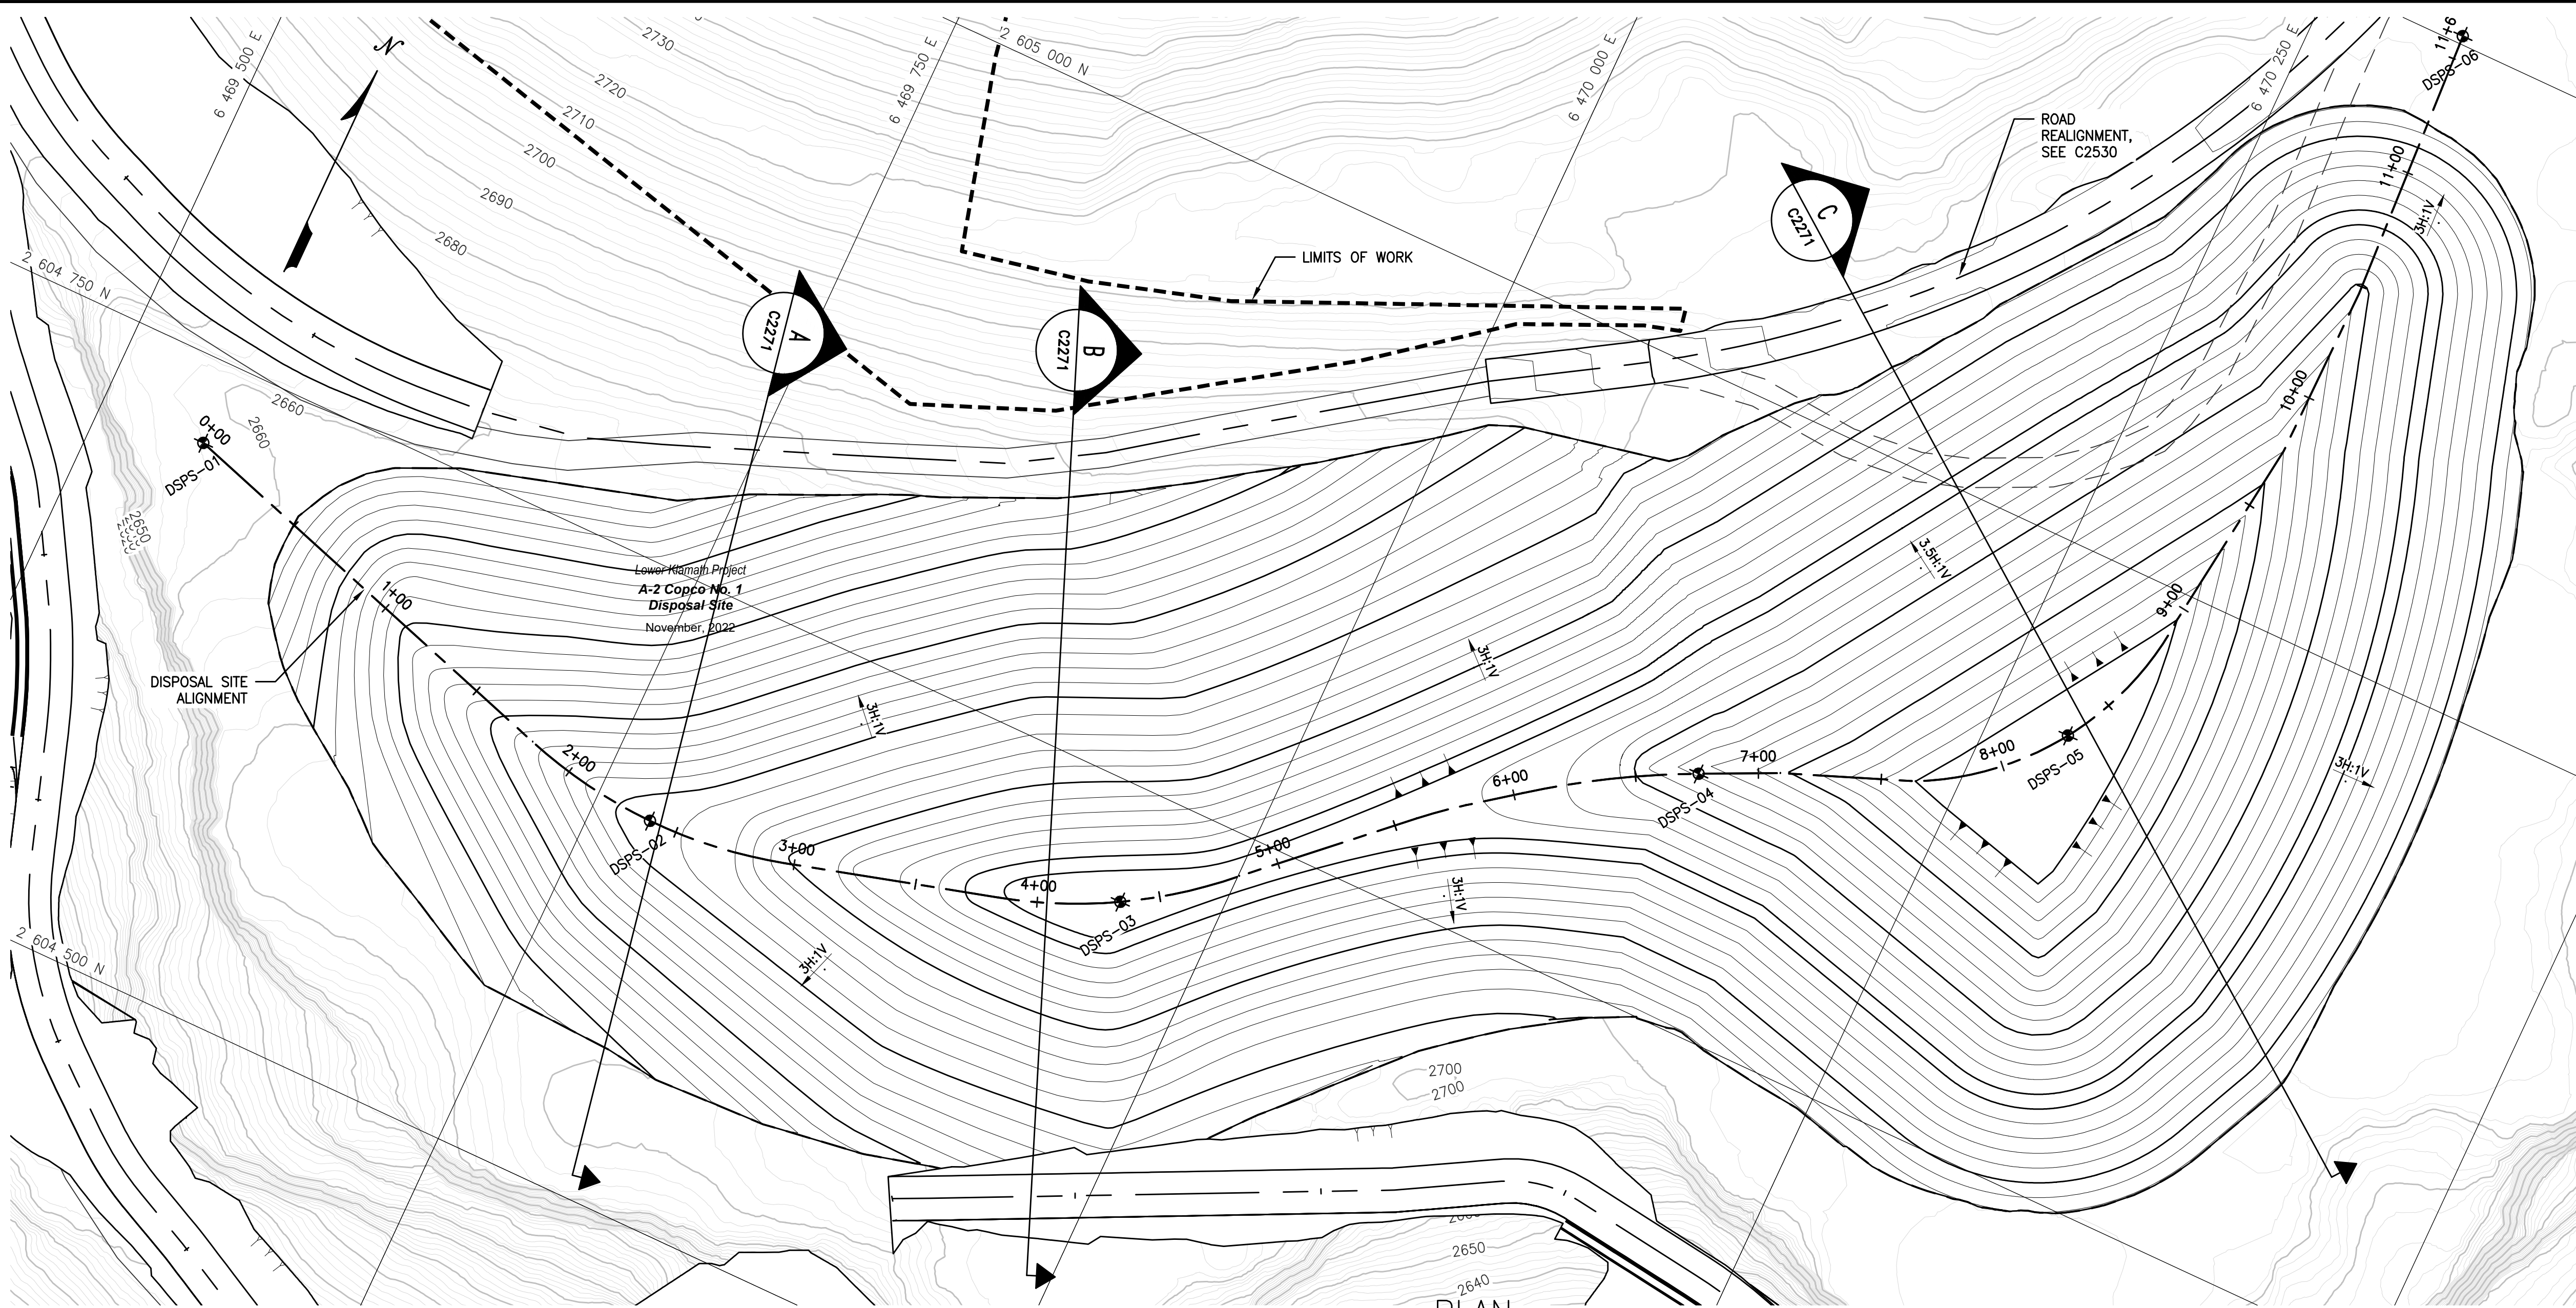


WORK POINTS TABLE		
WORK POINTS	EASTING	NORTHING
DSPS-01	6469544.319	2604716.392
DSPS-02	6469773.728	2604653.472
DSPS-03	6469961.007	2604704.121
DSPS-04	6470152.335	2604850.418
DSPS-05	6470281.984	2604927.725
DSPS-06	6470307.799	2605253.274

- NOTES:
- REFER TO GENERAL NOTES ON DRAWING G0006 FOR INFORMATION REGARDING TOPOGRAPHIC AND BATHYMETRIC DATA SOURCES.
 - DISPOSAL SITE DESIGNED FOR 189,000 cu yd.
 - CONSTRUCTION WASTE MATERIALS INCLUDING WOOD DEBRIS, STEEL AND OTHER ITEMS NOT REQUIRING SPECIAL DISPOSAL PROCEDURES MAY BE DISPOSED WITHIN THE DISPOSAL SITE.
 - RECLAMATION DETAILS ARE SHOWN ON DRAWING C2600.
 - CONTRACTOR TO SCHEDULE OVERHEAD POWER DISTRIBUTION LINE REMOVAL WITH FILLING OF DISPOSAL SITE.

LEGEND:

CONCRETE RUBBLE FILL (CR1) OR GENERAL FILL (E9)



LIMITS OF WORK

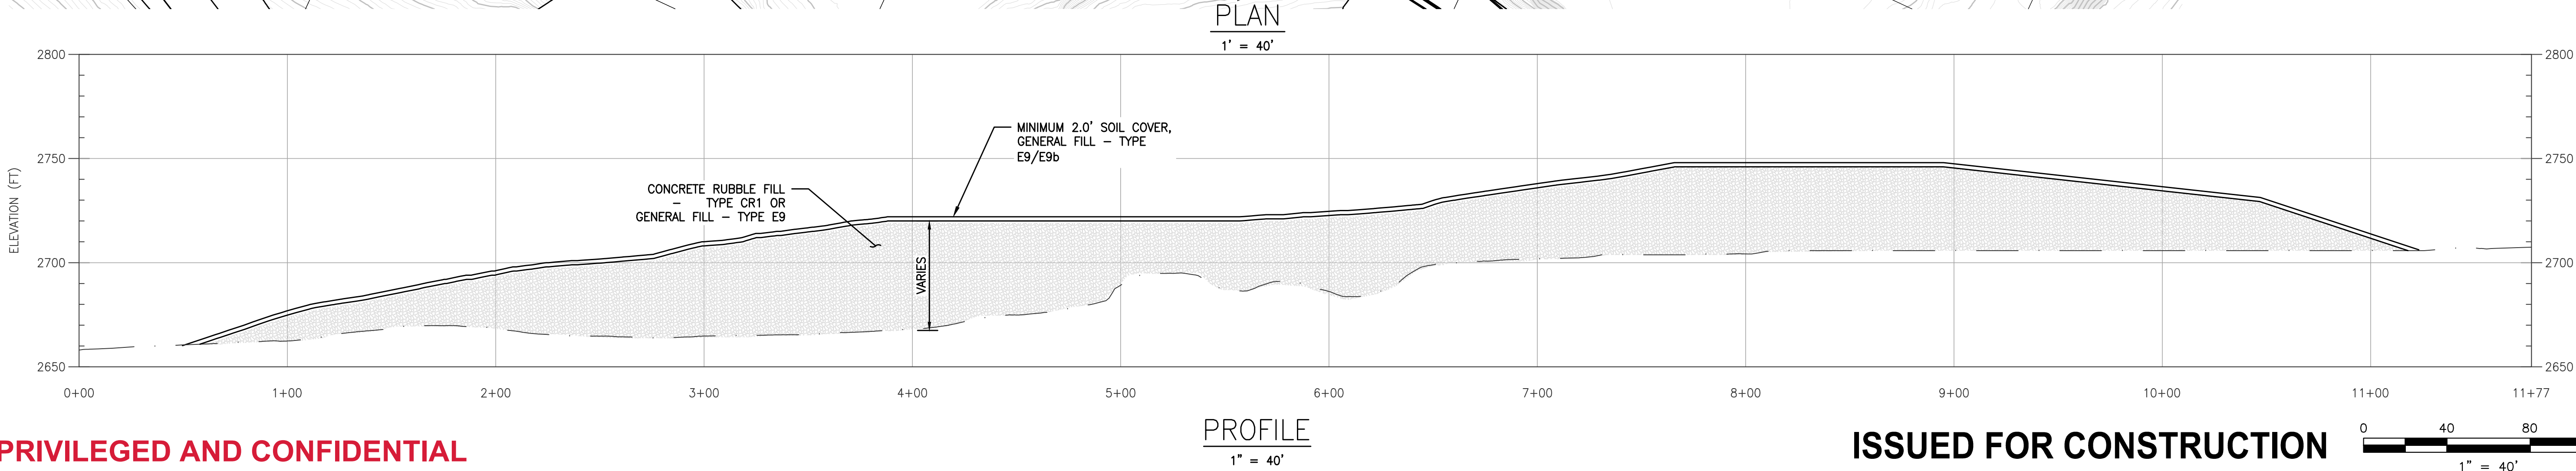

PRIVILEGED AND CONFIDENTIAL
DOCUMENT CONTAINS CEII INFORMATION - DO NOT RELEASE

				WARNING 0 1/2 1 				PREPARED BY Knight Piésold CONSULTING Kiewit		DESIGNED B. OTIS DRAWN A. TSENG REVIEWED S. YONG IN CHARGE N. BISHOP APPROVED S. MOTTRAM		PREPARED FOR KLAMATH RIVER RENEWAL CORPORATION		PROJECT KLAMATH RIVER RENEWAL PROJECT		PROJ # VA103-640/1	
														SHEET TITLE FIGURE A-2 COPCO NO. 1 DISPOSAL SITE PLAN AND PROFILE		DATE 05/27/2022	
														DWG C2270			
ISSUED FOR CONSTRUCTION				BO	SY	SRM	05/27/22										
DESCRIPTION				BY	CHK	APP	DATE										

eg:\projects\1 May 25, 2022 - 6:25am
C:\Users\B6401\OneDrive\Documents\C2270\C2270.dwg

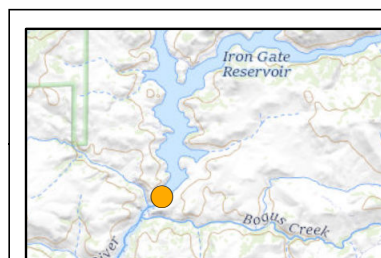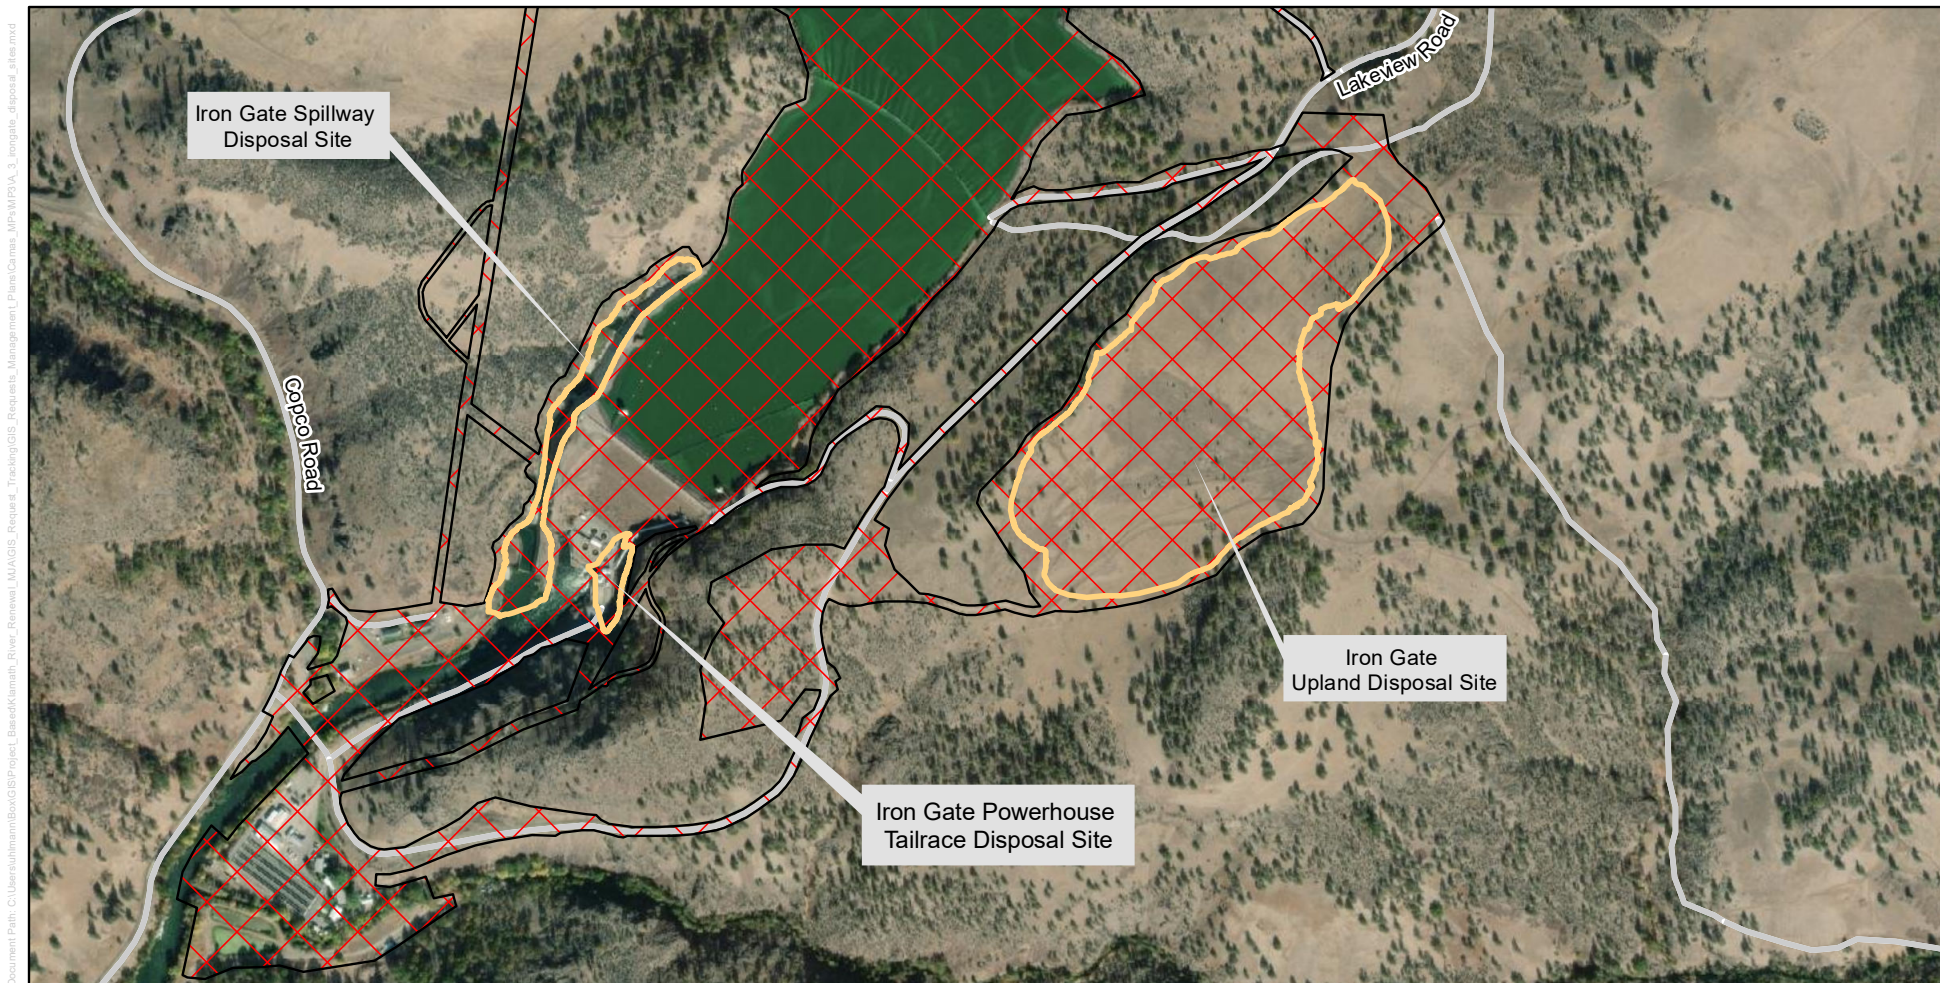

0 362.5 725 1,450
Feet

(At original document size of 8.5 x 11)
1:10,150

Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites, Limits of Work and Access Routes: Knight Piesold 100 design
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

Legend


- Disposal Sites
- Limits of Work
- Roads

Lower Klamath Project A-3: Iron Gate Disposal Site Locations



PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)


Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

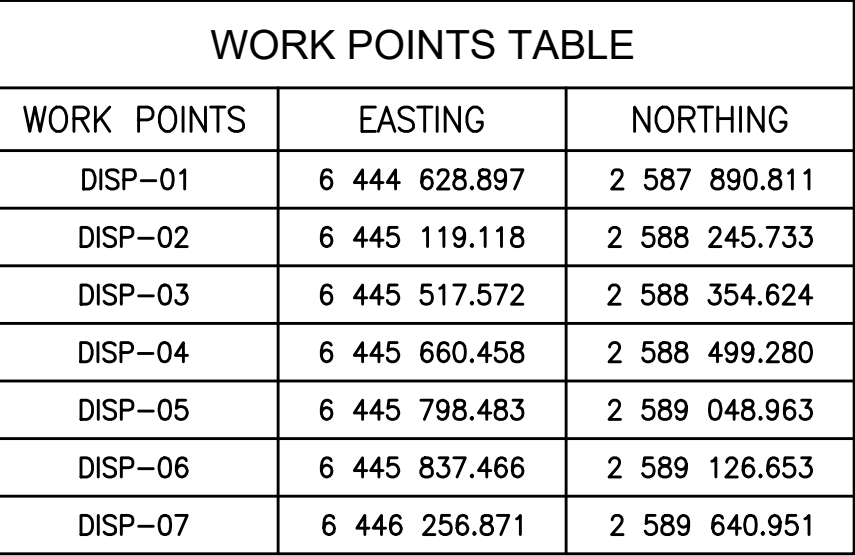

1. REFER TO GENERAL NOTES ON G0006 FOR INFORMATION REGARDING TOPOGRAPHIC AND BATHYMETRIC DATA SOURCES.
2. CONTOUR INTERVALS ARE 2 ft.
3. EXACT FOOTPRINT OF DISPOSAL AREA TO BE ADJUSTED AS NECESSARY BY THE CONTRACTOR, BUT SHALL REMAIN INSIDE THE LIMITS OF WORK WHERE FOOTPRINT IS REDUCED. FILL SLOPES SHALL NOT EXCEED THOSE SHOWN HERE WITHOUT CONSULTATION OF THE ENGINEER.
4. SEE C4600 DRAWING SERIES FOR FINAL GRADE AND EROSION CONTROL REQUIREMENTS.
5. RANDOM FILL SHALL BE CAPPED BY A MINIMUM OF 2 ft OF GENERAL FILL.
6. OPTION TO UTILIZE GENERAL FILL (E9) OR (E9b) AS COVER MATERIAL. FINAL STABILIZATION TREATMENTS DIFFER AS PER TECHNICAL SPECIFICATION 31 25 00.
7. FOR CROSS SECTIONS, SEE C4231.




GENERAL FILL (E9/E9b)

RANDOM FILL (E10)

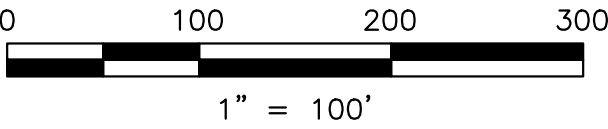

ISSUED FOR CONSTRUCTION

[illegible]

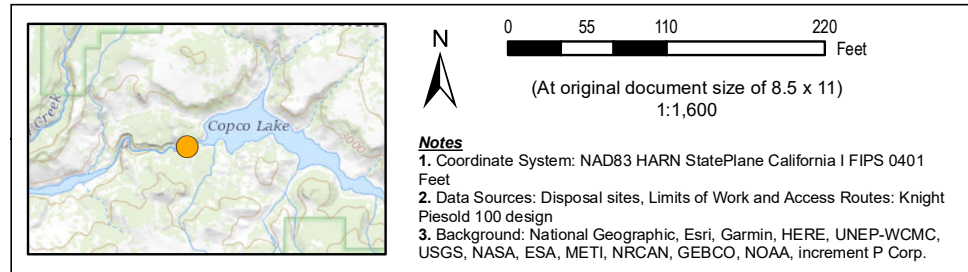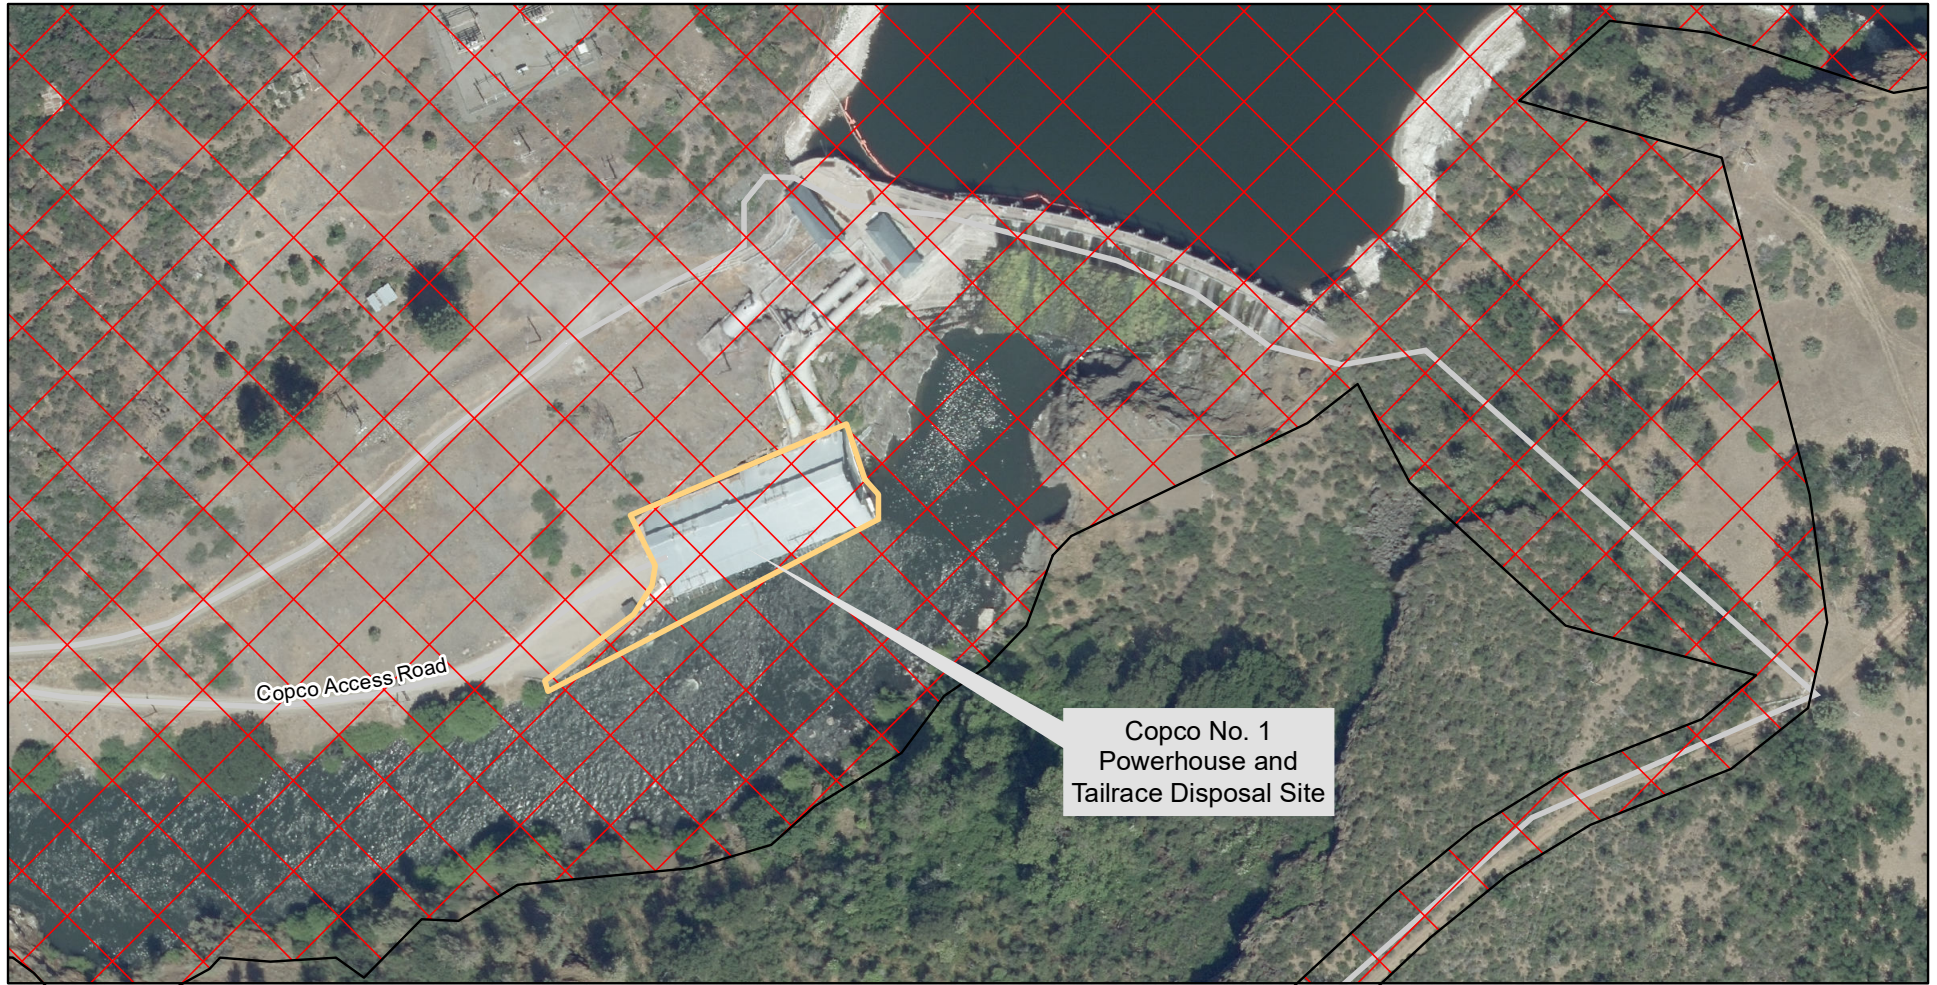


Lower Klamath Project
**A-5 Copco No. 1
Powerhouse and Tailrace
Disposal Site**




PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

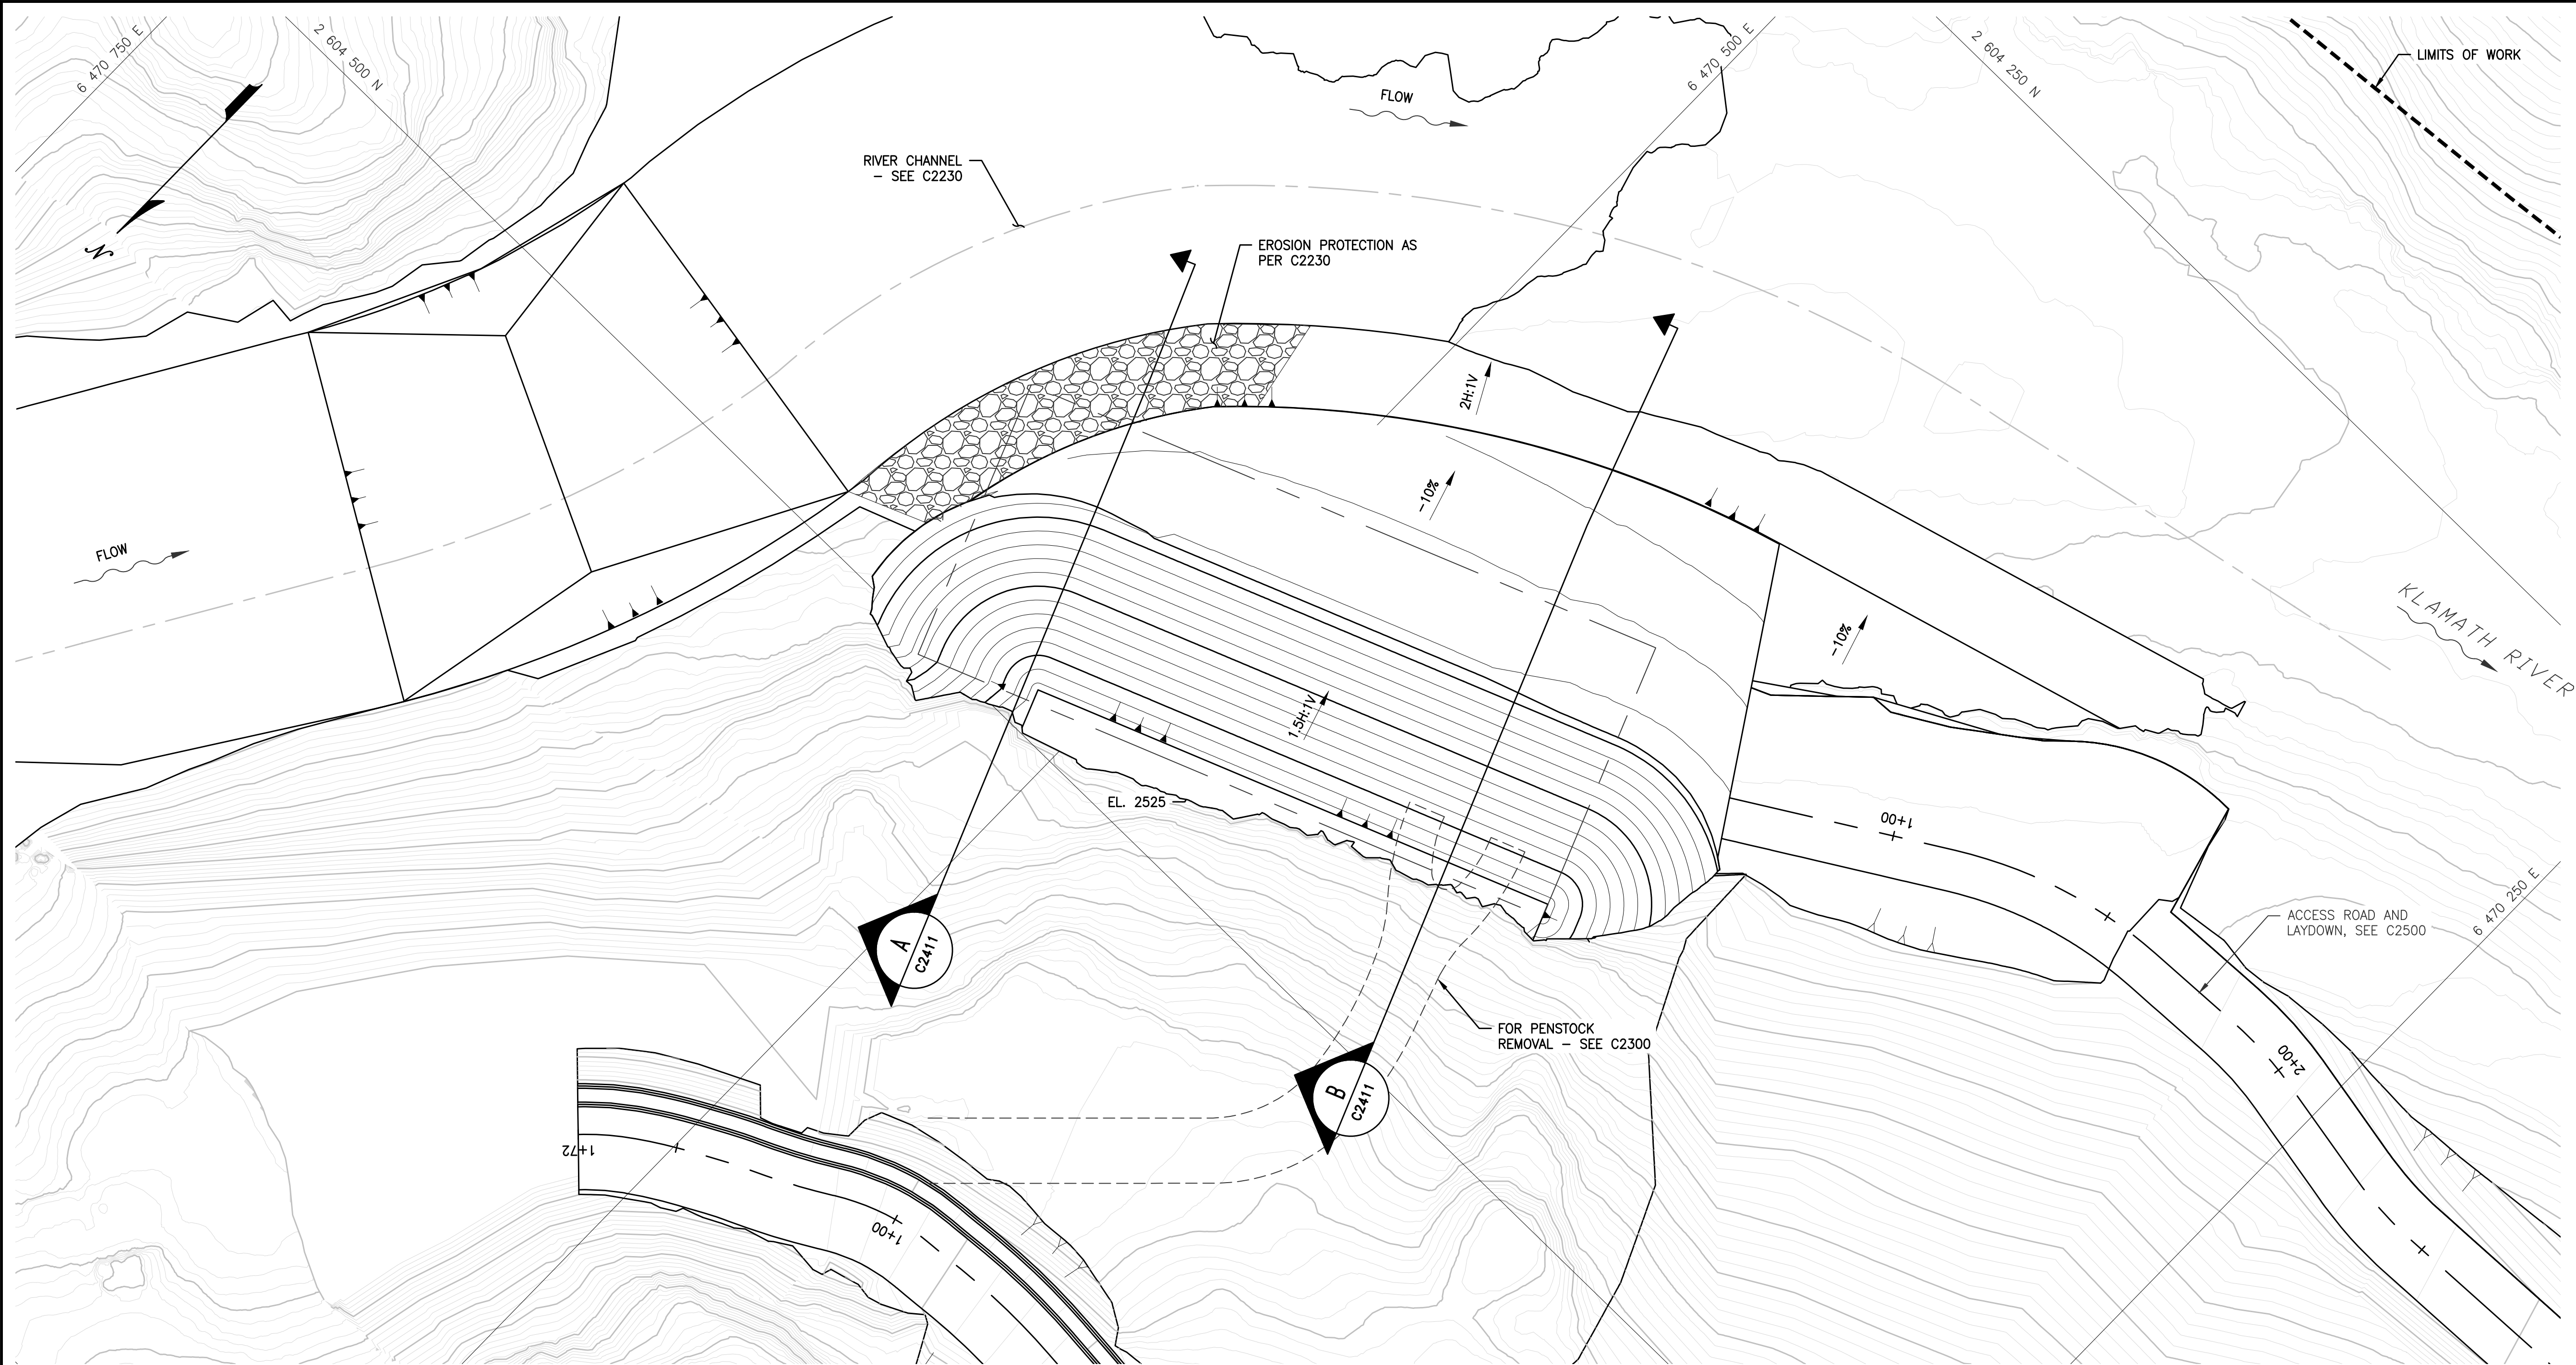

LEGEND:

LIMITS OF WORK



EROSION PROTECTION MATERIAL (E7c)

NOTES:


- REFER TO GENERAL NOTES ON DRAWING G0006 FOR INFORMATION REGARDING TOPOGRAPHIC AND BATHYMETRIC DATA SOURCES.
- FOR POWERHOUSE REMOVAL NOTES SEE DRAWING C2400.

PLAN

1" = 20'

POWERHOUSE BUTTRESS SLOPE WORK POINTS TABLE			
WORK POINTS	EASTING	NORTHING	ELEVATION
PWHS-01	6470519.111	2604493.252	2525.000
PWHS-02	6470400.877	2604446.772	2525.000

ISSUED FOR CONSTRUCTION

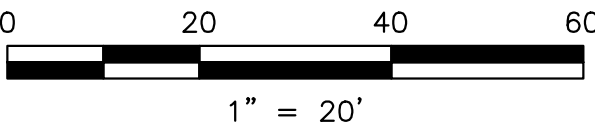

g:\projects\16-15-2022-6-35m\030664001\VA103\DWG\G0000\C2410\C2410.dwg

1	ISSUED FOR CONSTRUCTION	BO	SY	SRM	06/15/22
0	ISSUED FOR CONSTRUCTION	BO	SY	SRM	05/27/22
REV	DESCRIPTION	BY	CHK	APP	DATE



PREPARED BY

Knight Piésold CONSULTING

Kiewit

DESIGNED

B. OTIS

DRAWN

A. TSENG

REVIEWED

S. YONG

IN CHARGE

N. BISHOP

APPROVED

S. MOTTRAM

PREPARED FOR

KLAMATH RIVER RENEWAL CORPORATION

PROJECT

KLAMATH RIVER RENEWAL PROJECT

SHEET TITLE

FIGURE A-6 COPCO NO. 1 POWERHOUSE AND TAILRACE DISPOSAL SITE - PLAN

PROJ #



VA103-640/1

DATE








05/27/2022

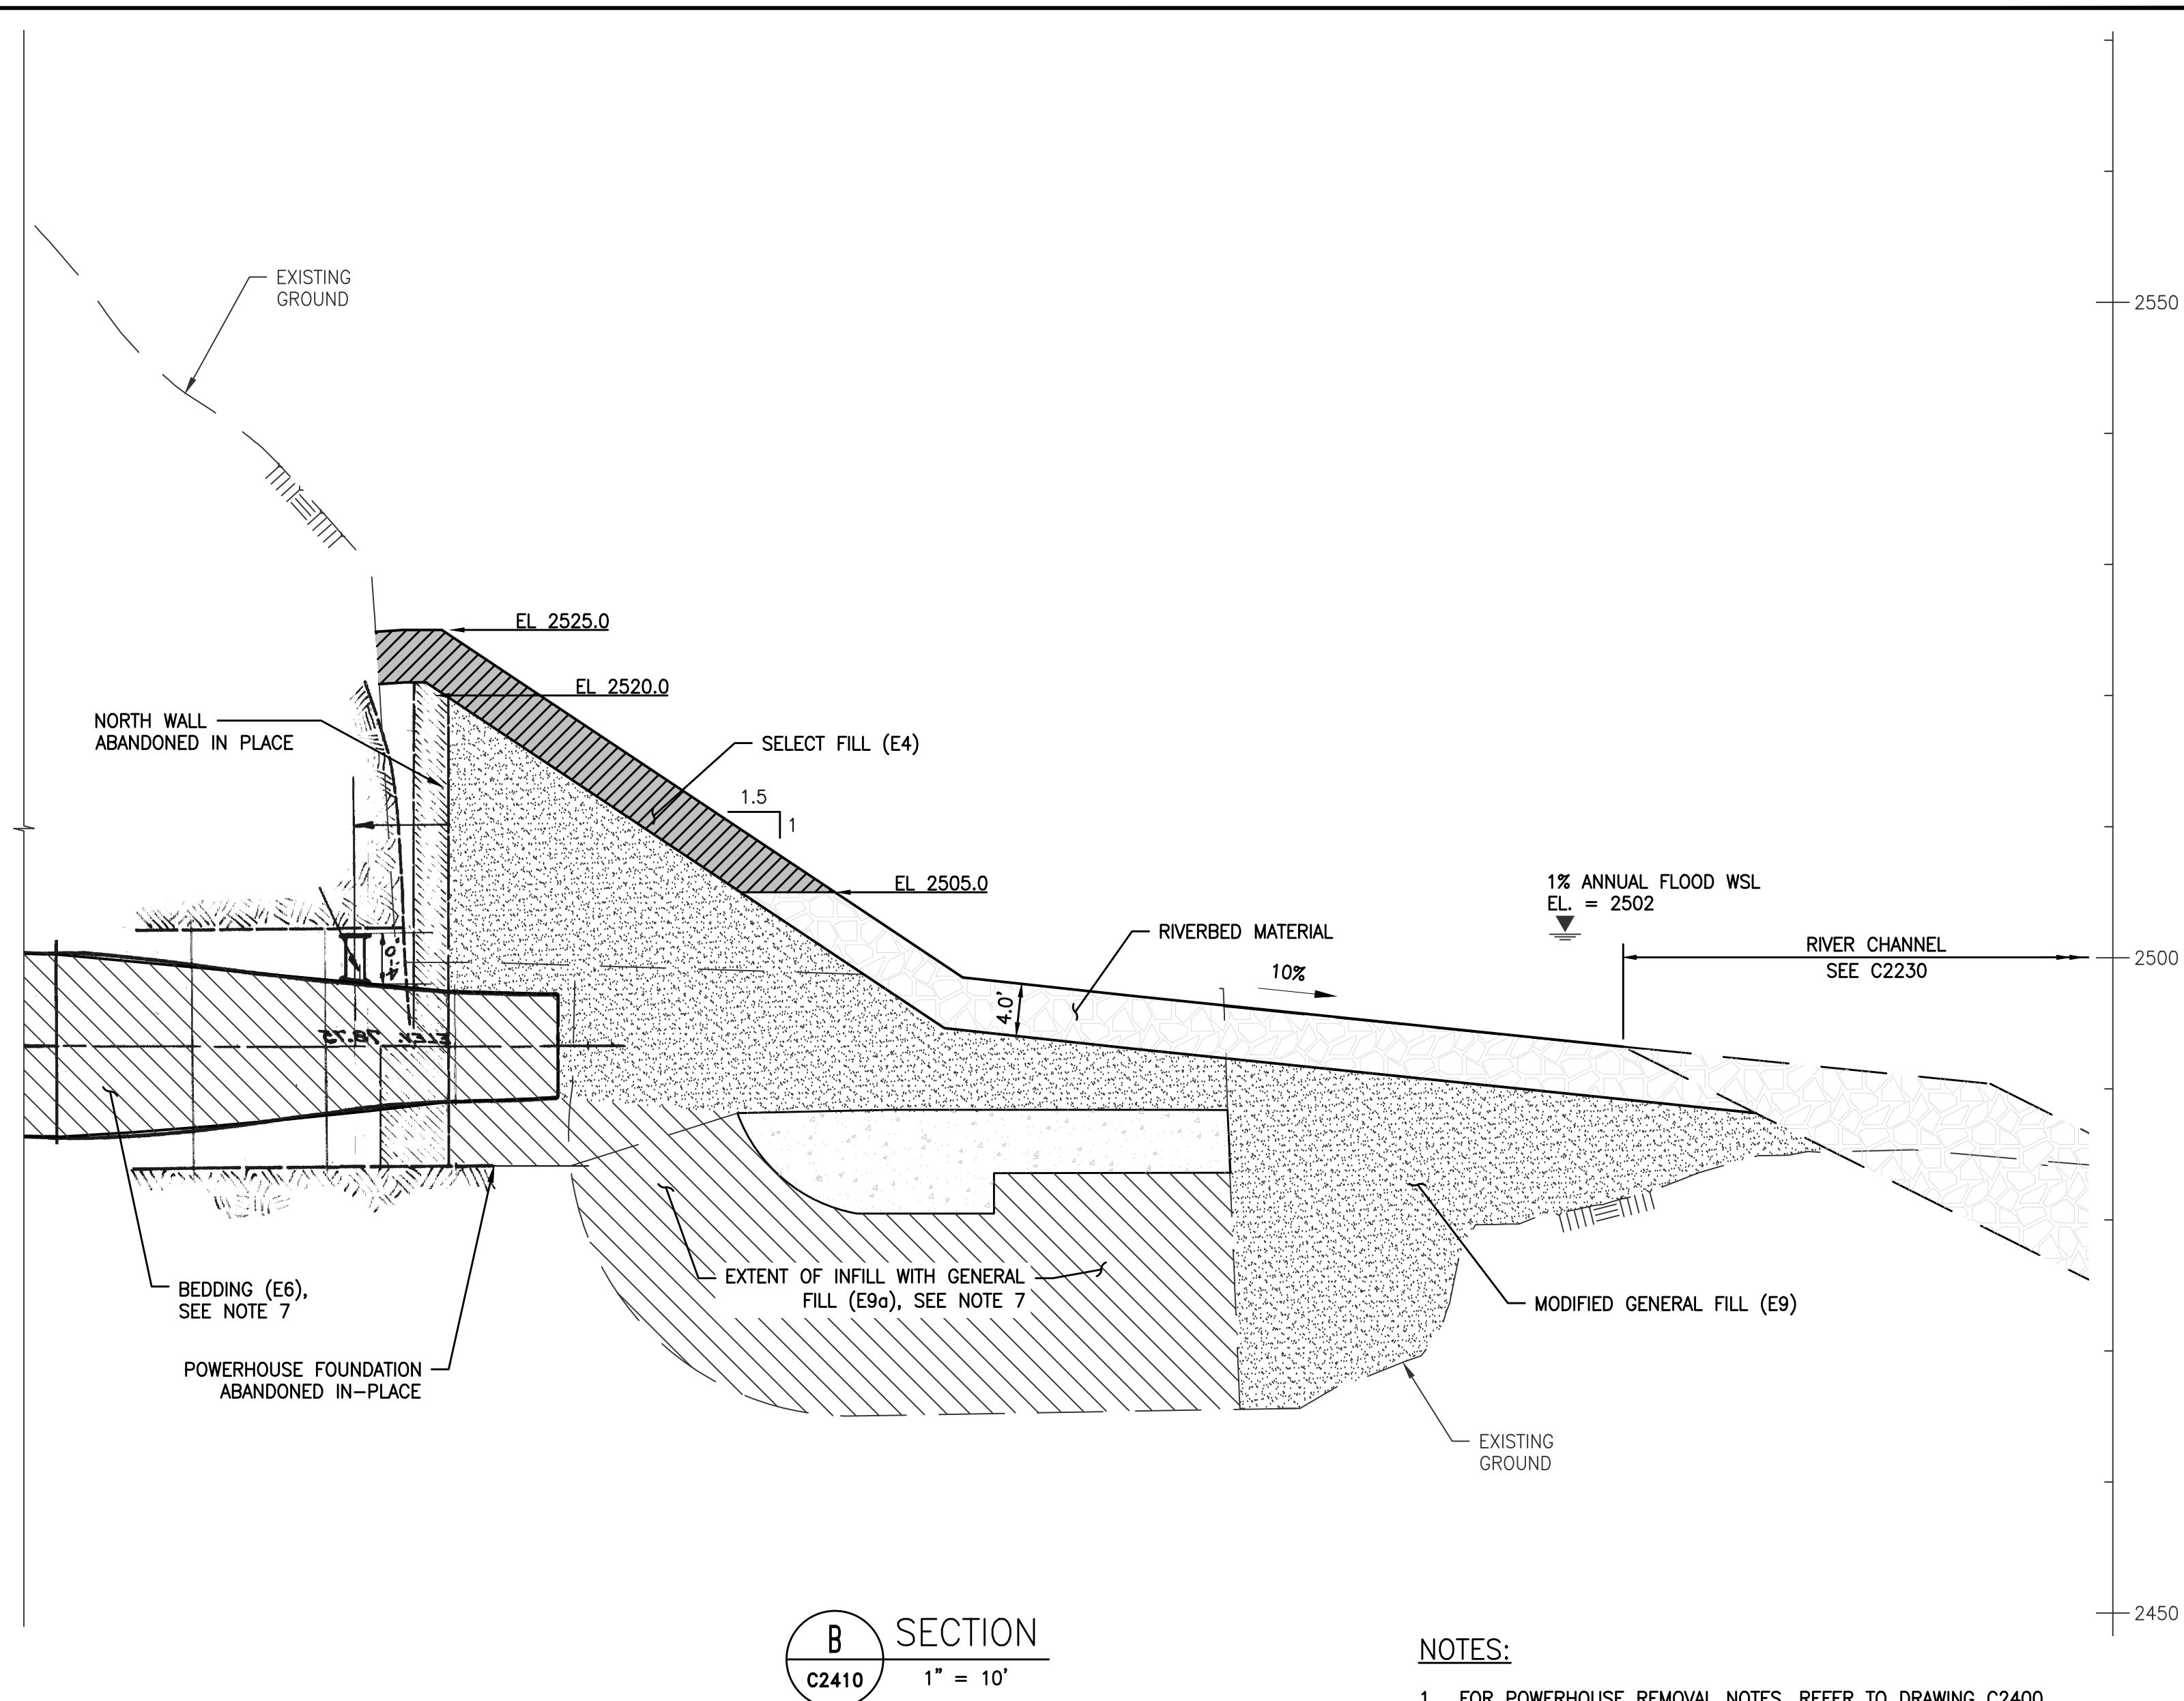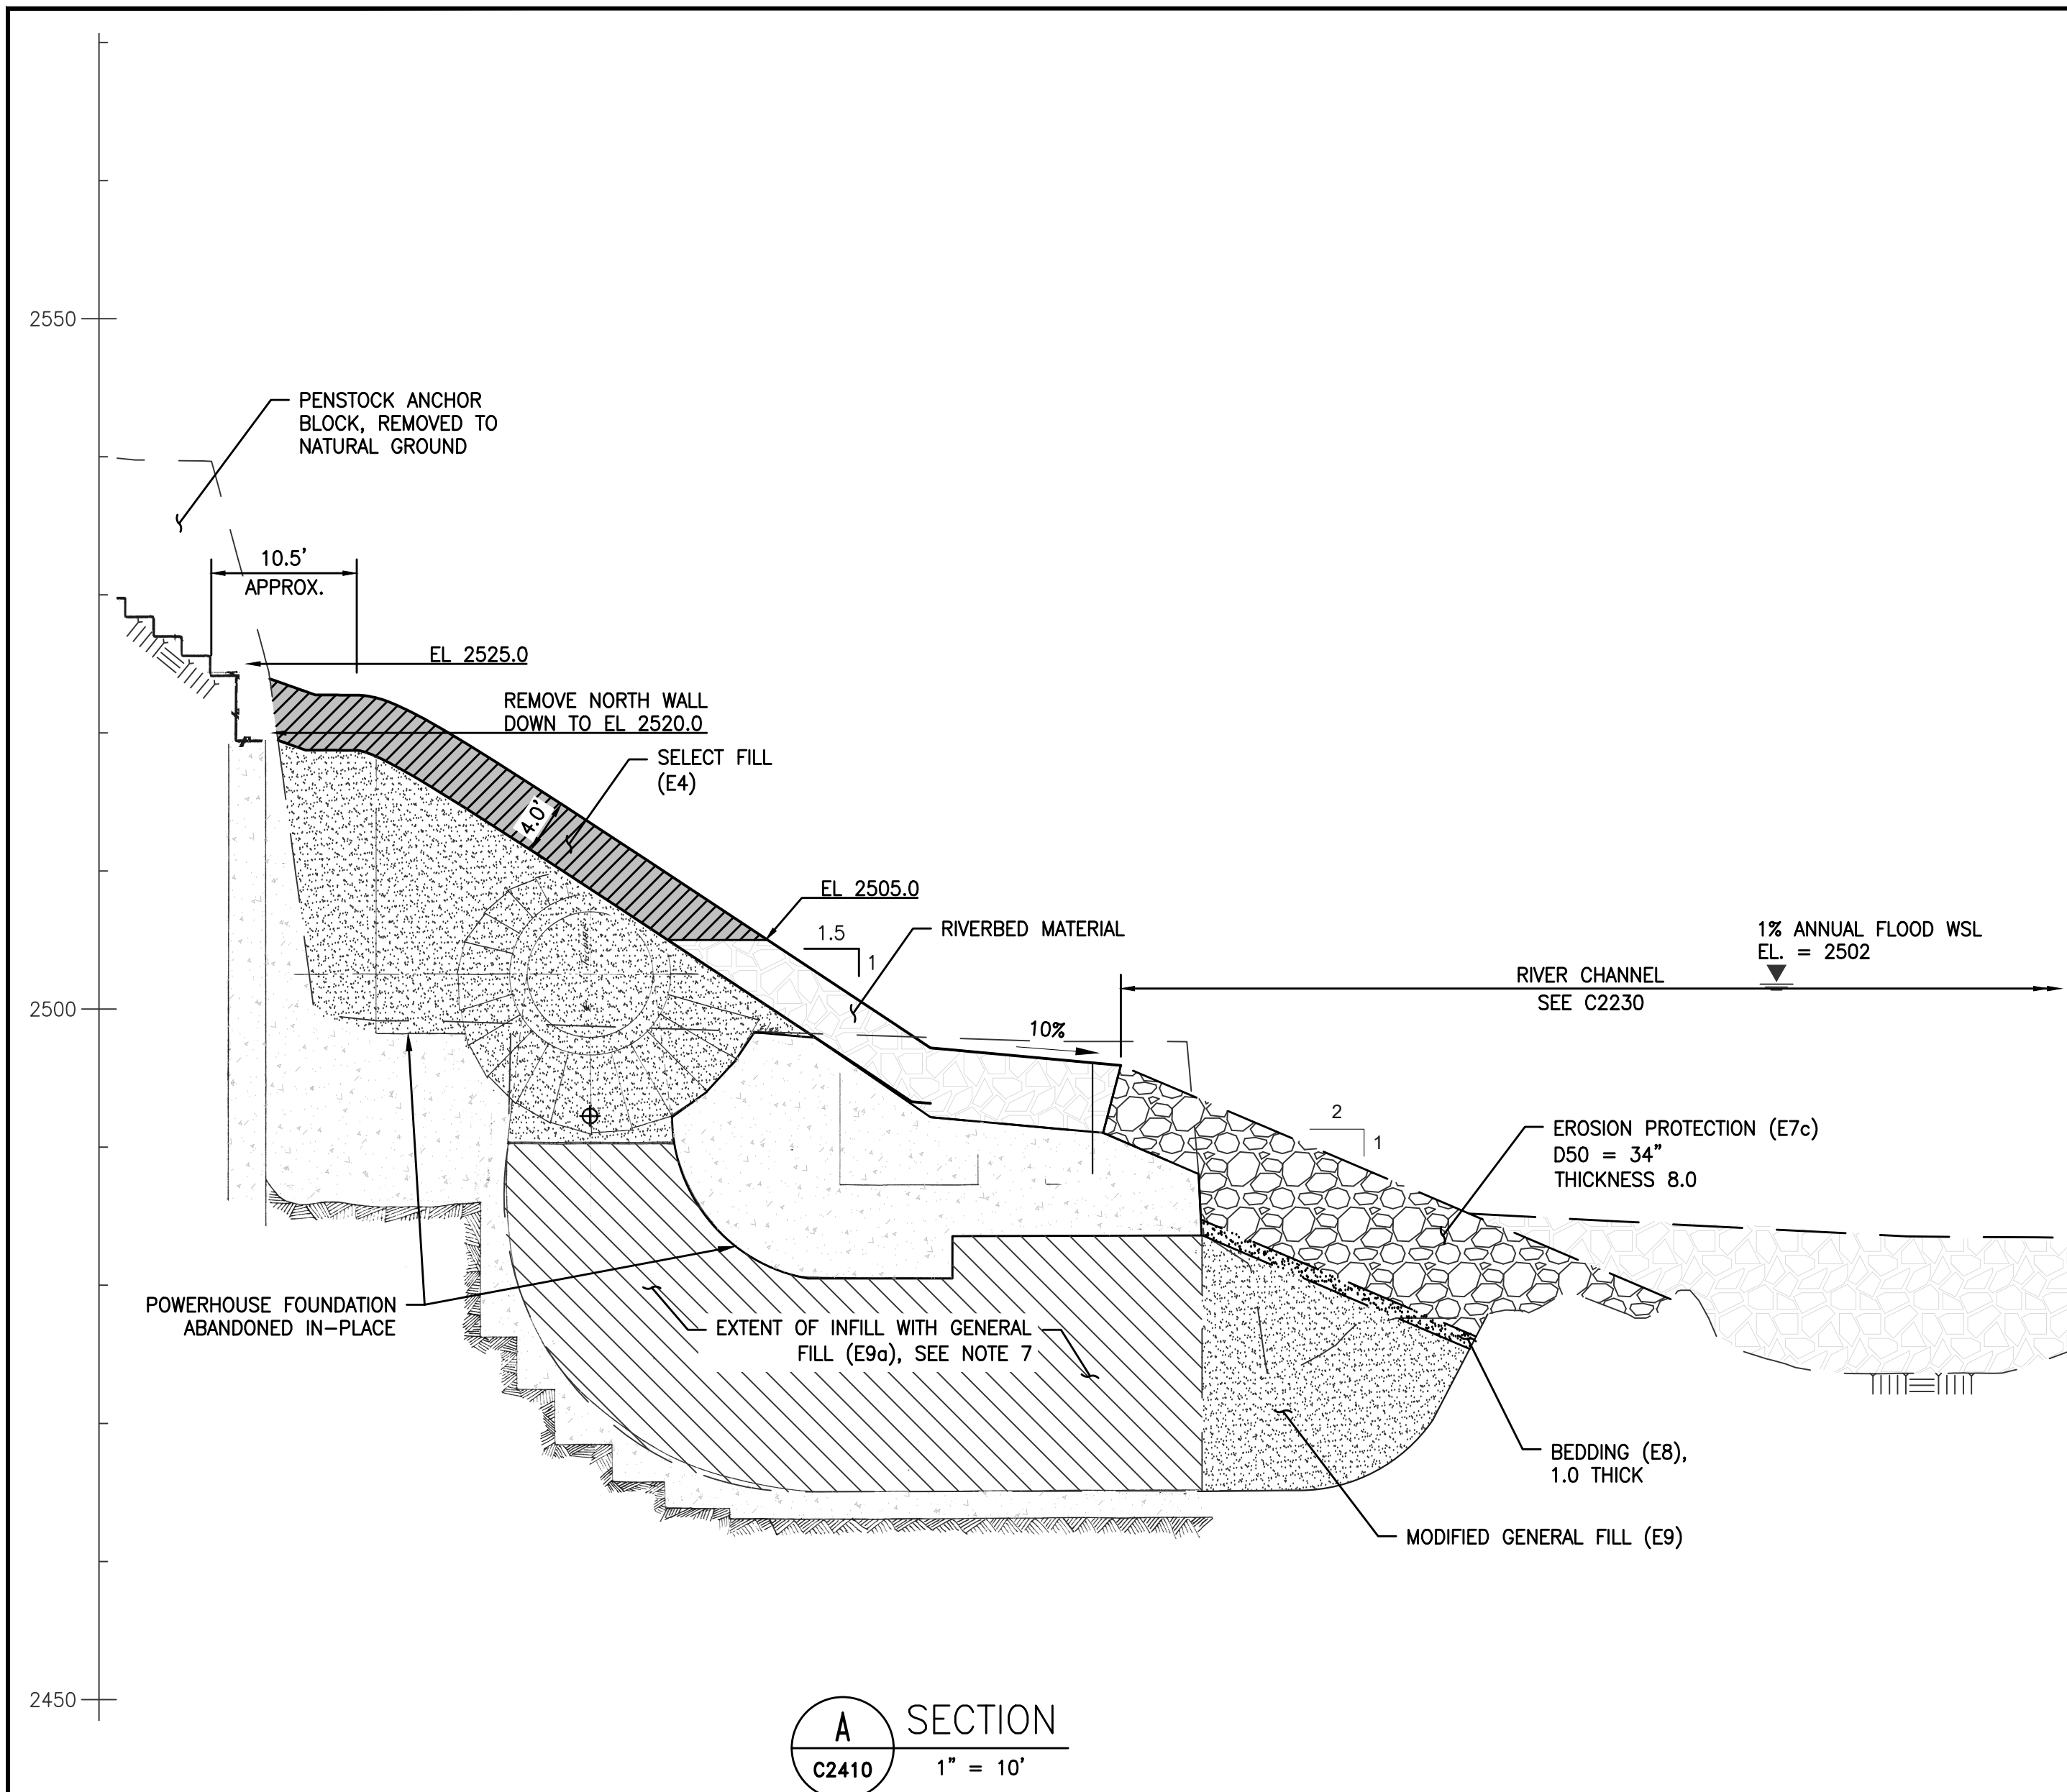DWG

C2410




LEGEND:

	SELECT FILL (E4)
	EROSION PROTECTION (E7c)
	GENERAL FILL (E9/E9a)
	BEDDING (E6)
	CONCRETE (E)
	RIVERBED MATERIAL
	VOID INFILL

NOTES:

1. FOR POWERHOUSE REMOVAL NOTES, REFER TO DRAWING C2400.
2. PENSTOCK REMOVAL NOTES, SEE DRAWING C2300.
3. FOR WORK POINTS DETAILING THE LAYOUT OF THE BUTTRESS FILL, SEE DRAWING C2410.
4. ABANDONED IN-PLACE CONCRETE AND CONCRETE RUBBLE FILL EXPOSED TO RIVER CHANNEL TO HAVE THE MATERIAL COVER SPECIFIED AS PER DRAWING C2230.
5. MODIFIED GENERAL FILL (E9) SHALL BE COMPACTED BY TRACKED MACHINERY WITH AT LEAST 6 PASSES OVER THE ENTIRE WIDTH OF THE AREA IN 3 ft HIGH HORIZONTAL LIFTS. USE OF VIBRATORY COMPACTOR MAY BE REQUIRED TO ACHIEVE SUITABLE TREATMENT.
6. IF FINE CONTENT OF THE POWERHOUSE FILL MATERIAL EXCEEDS 10 PERCENT FINES, A VERTICAL AND BLANKET FILTER ZONE IS REQUIRED ALONG THE ABANDONED POWERHOUSE NORTH WALL AND FLOOR. FILTER ZONE TO COMPRISE OF MATERIAL WITH LESS THAN 10 PERCENT FINES.
7. SEE TECHNICAL SPECIFICATION 31 23 00 FOR PLACEMENT AND COMPACTION REQUIREMENTS IN CONFINED OPENINGS AND CAVITIES.

ISSUED FOR CONSTRUCTION

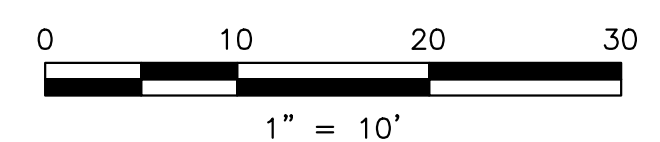[illegible]

WARNING

0 1/2 1



IF THIS BAR DOES
NOT MEASURE 1"
THEN DRAWING IS
NOT TO SCALE

PREPARED BY	
-------------	--



DESIGNED

B. OTIS
DRAWN

REVIEWED	A. TSENG
REVIEWED	C. YONG

IN CHARGE	
-----------	--

APPROVED

PREPARED FOR	
--------------	--



PROJECT

KLAMATH RIVER RENEWAL PROJECT

SHEET TITLE

FIGURE A-6a COPCO NO.1 POWERHOUSE
AND TAILRACE DISPOSAL SITE - PROFILE

PROJ #	
--------	--



VA103-640/1

DATE _____

05/27/2022

	DWG
--	-----

C2411

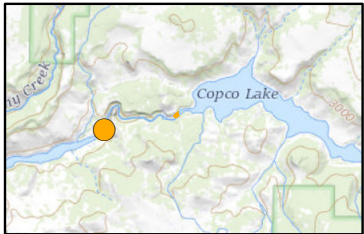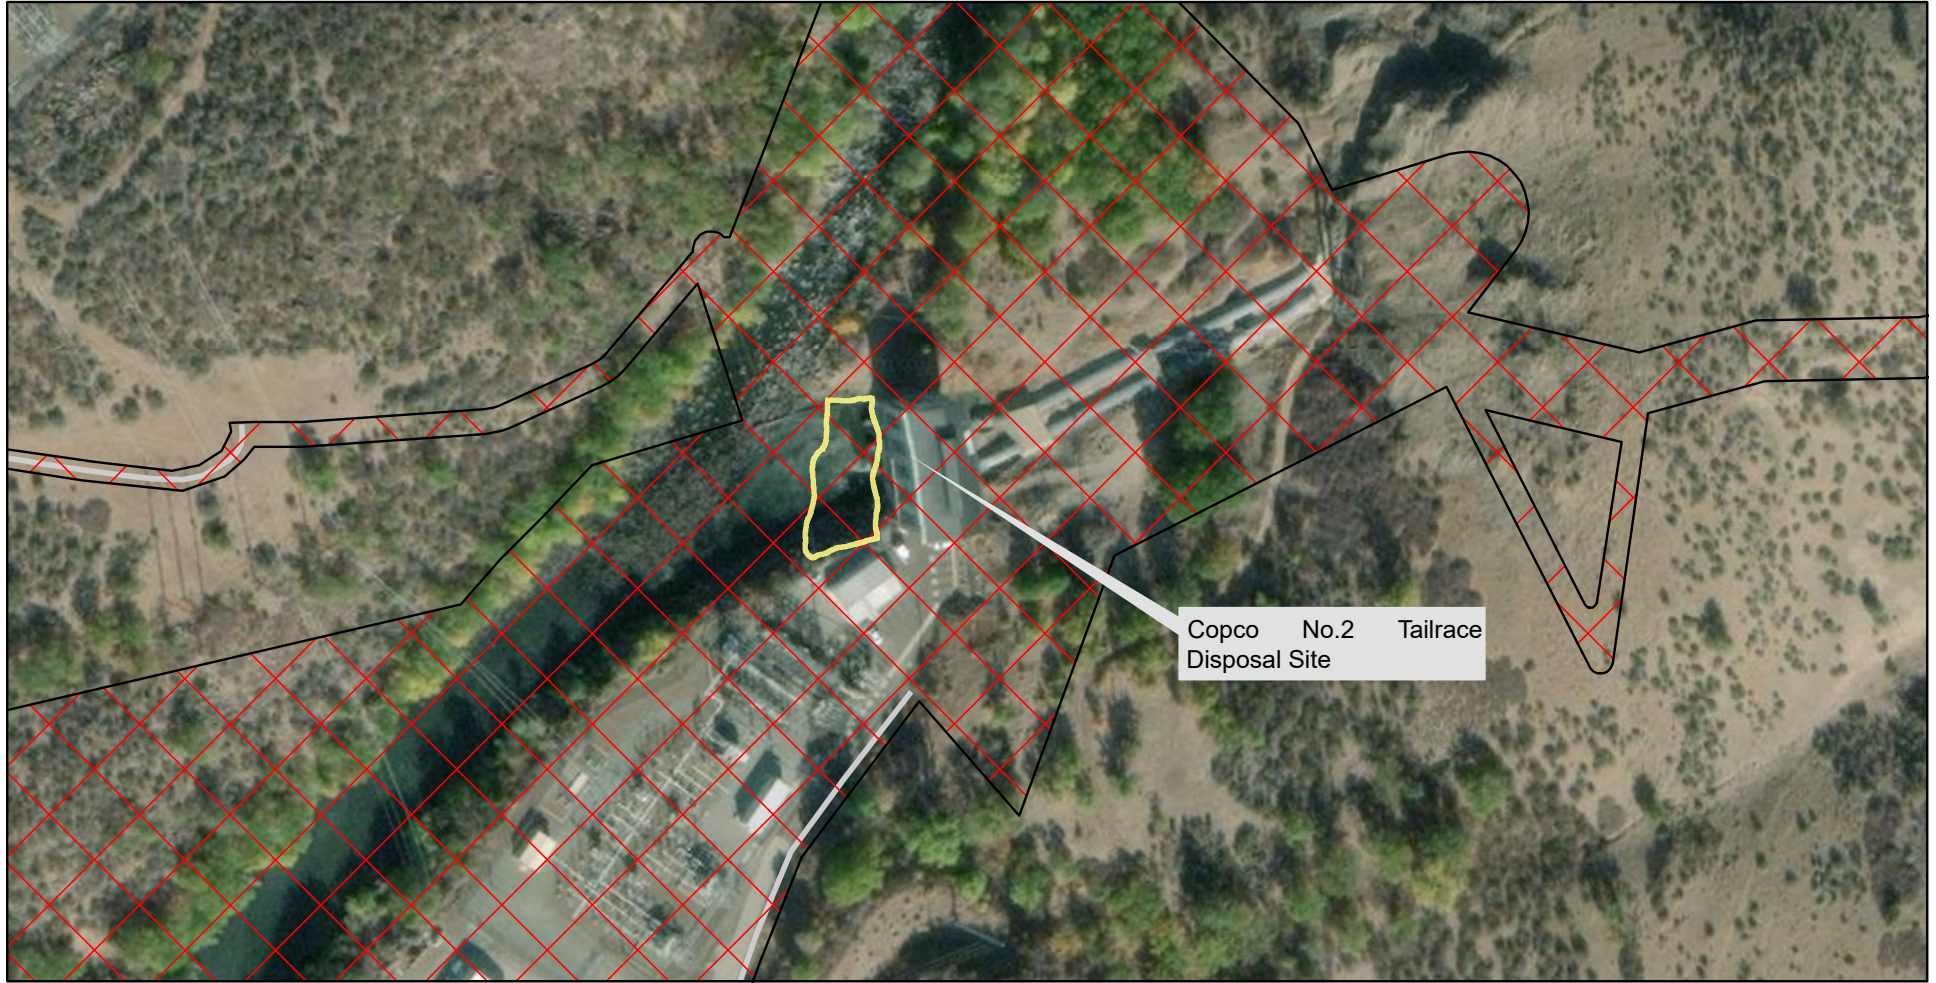

0 65 130 260 Feet
(At original document size of 8.5 x 11)
1:1,890

Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites, Limits of Work and Access Routes: Knight Piesold 100 design
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

Legend

- Disposal Sites
- Limits of Work
- Roads


Lower Klamath Project
A-7 Copco No. 2 Tailrace Disposal Site



PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

g:\projects\16-71_2022\16-71.dwg
05/27/2022 11:54:11 AM
C:\Users\jgibson\OneDrive\Documents\16-71\16-71.dwg

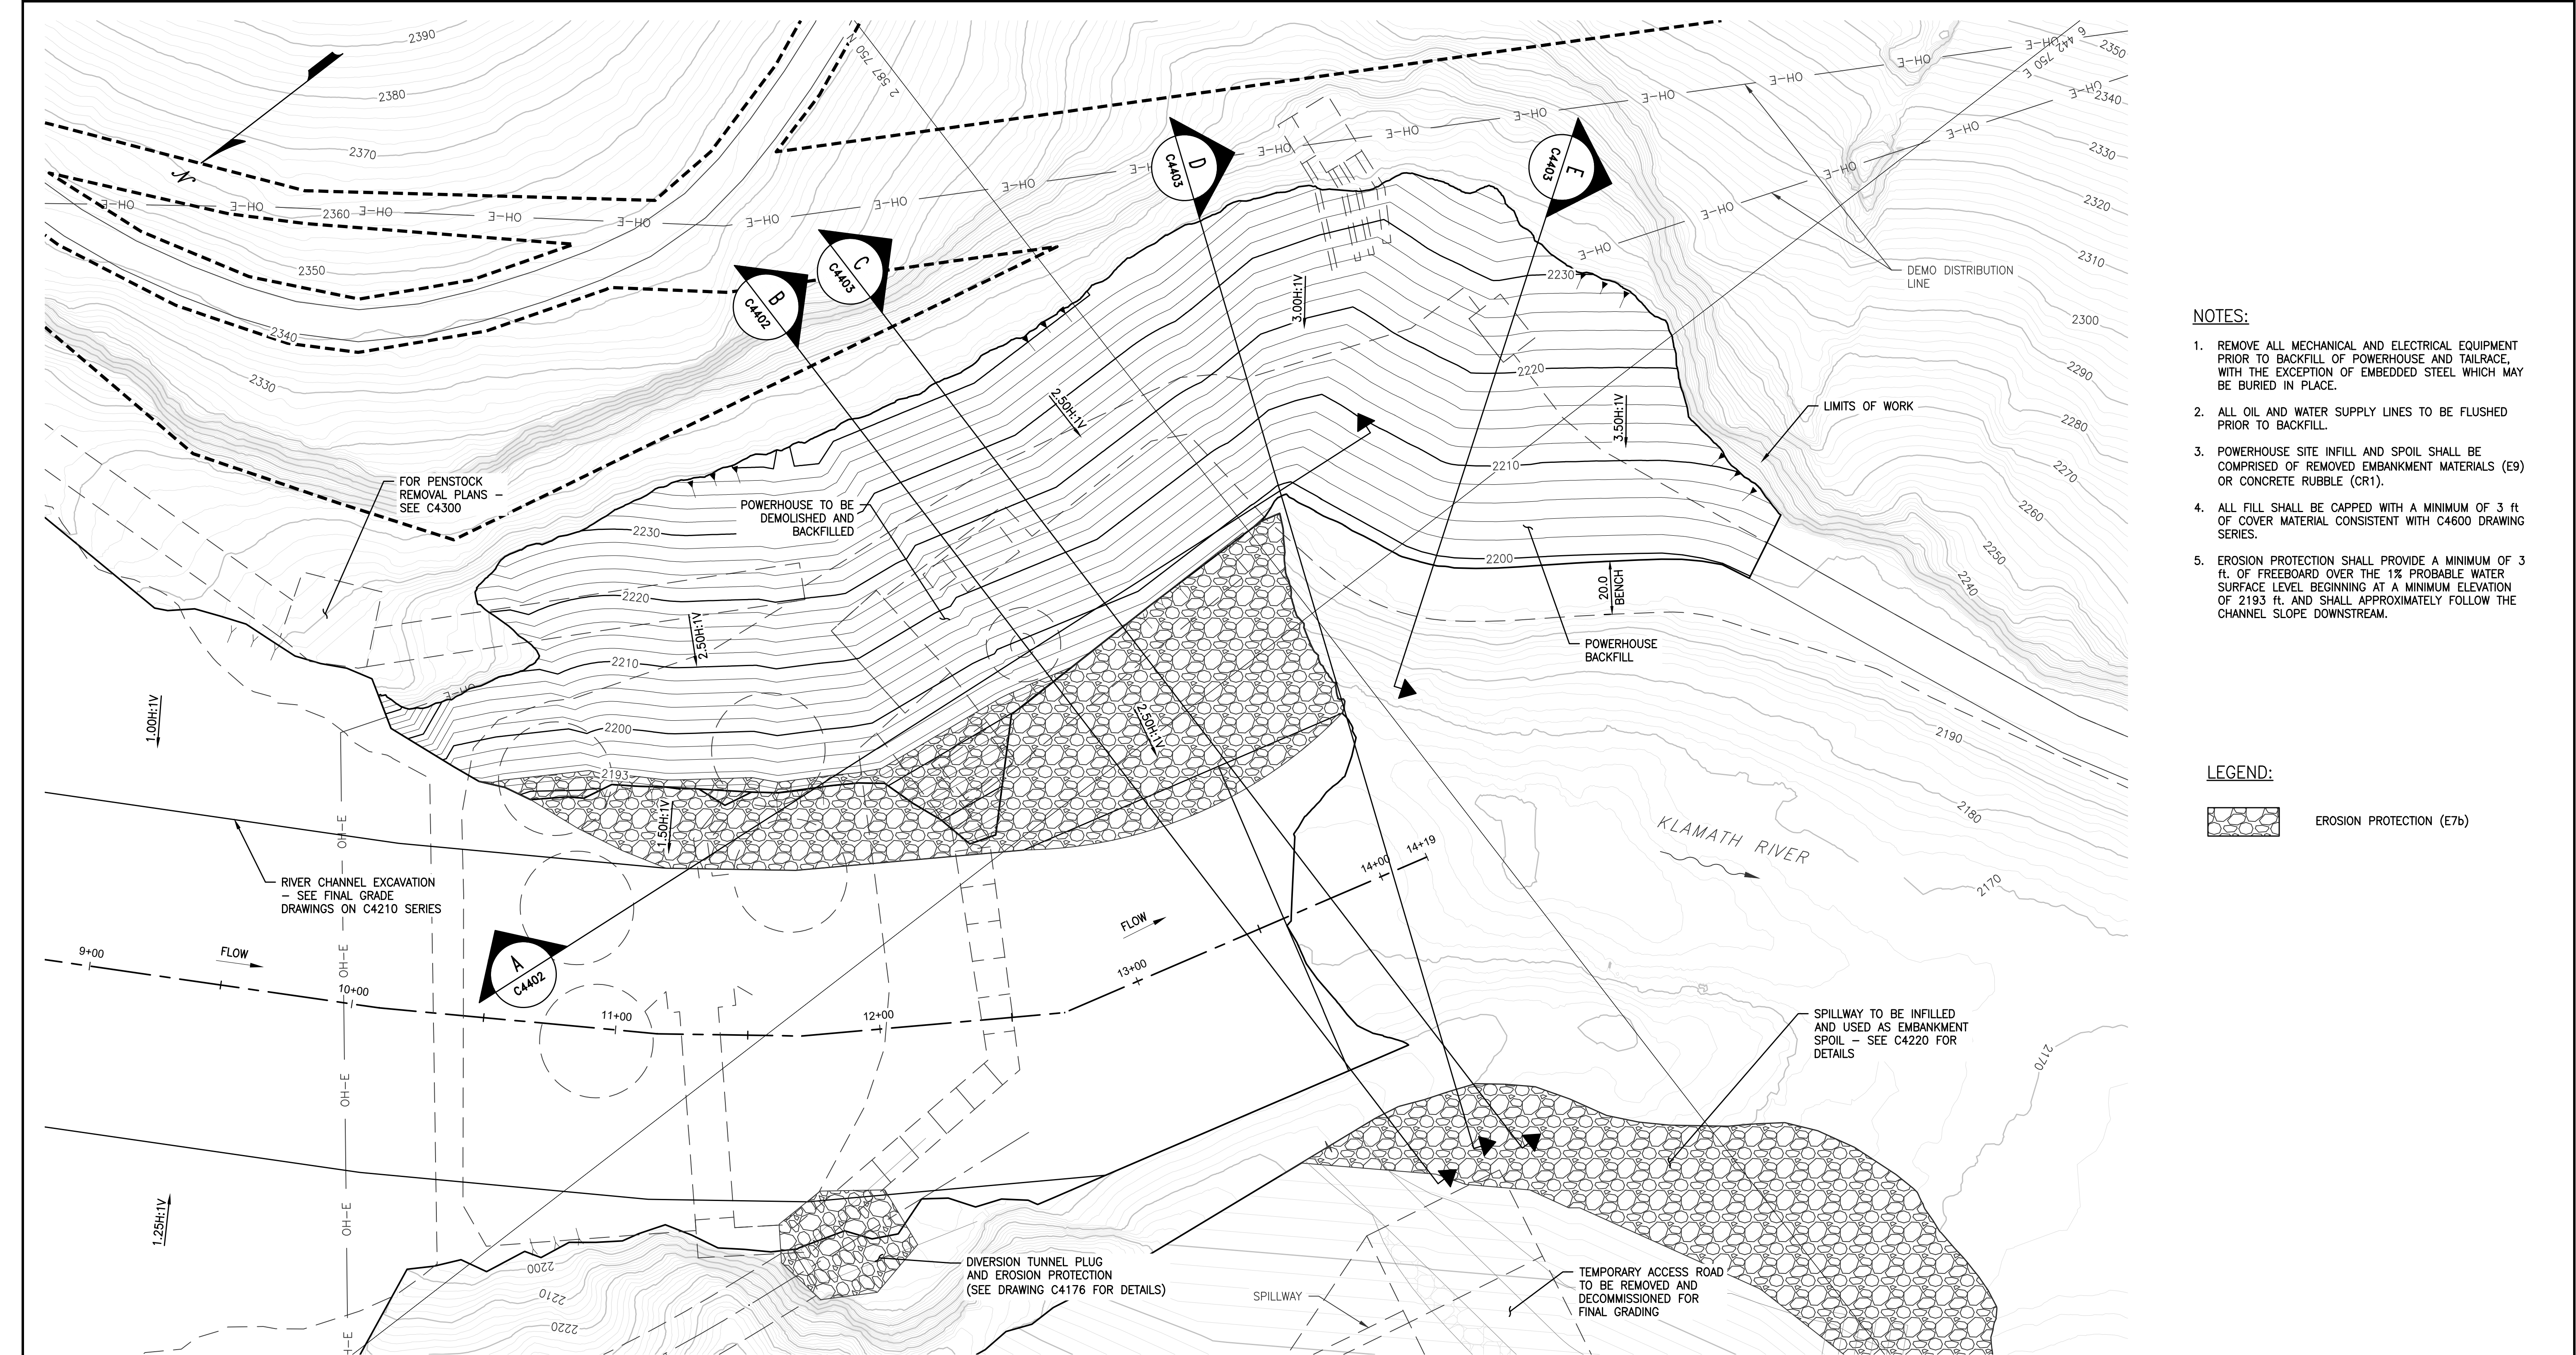


POWERHOUSE SITE PLAN - FINAL GRADE
1" = 30'

- NOTES:
1. REMOVE ALL MECHANICAL AND ELECTRICAL EQUIPMENT PRIOR TO BACKFILL OF POWERHOUSE AND TAILRACE, WITH THE EXCEPTION OF EMBEDDED STEEL WHICH MAY BE BURIED IN PLACE.
 2. ALL OIL AND WATER SUPPLY LINES TO BE FLUSHED PRIOR TO BACKFILL.
 3. POWERHOUSE SITE INFILL AND SPOIL SHALL BE COMPRISED OF REMOVED EMBANKMENT MATERIALS (E9) OR CONCRETE RUBBLE (CR1).
 4. ALL FILL SHALL BE CAPPED WITH A MINIMUM OF 3 ft OF COVER MATERIAL CONSISTENT WITH C4600 DRAWING SERIES.
 5. EROSION PROTECTION SHALL PROVIDE A MINIMUM OF 3 ft. OF FREEBOARD OVER THE 1% PROBABLE WATER SURFACE LEVEL BEGINNING AT A MINIMUM ELEVATION OF 2193 ft. AND SHALL APPROXIMATELY FOLLOW THE CHANNEL SLOPE DOWNSTREAM.

LEGEND:

EROSION PROTECTION (E7b)

ISSUED FOR CONSTRUCTION


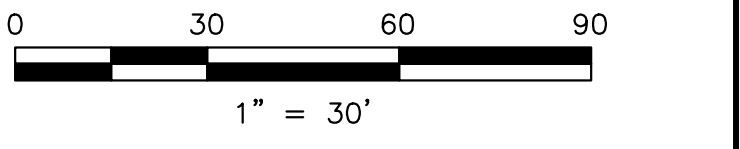


1 ISSUED FOR CONSTRUCTION		KTW	SY	SRM	06/22/22
0 ISSUED FOR CONSTRUCTION		KTW	SY	SRM	05/27/22
REV	DESCRIPTION	BY	CHK	APP	DATE


WARNING 0 1/2 1 IF THIS BAR DOES NOT MEASURE 1" THEN DRAWING IS NOT TO SCALE	
--	--




PREPARED BY Knight Piésold CONSULTING Kiewit	DESIGNED K. WECHSELBERGER DRAWN A. TSENG REVIEWED S. YONG IN CHARGE N. BISHOP APPROVED S. MOTTRAM	PREPARED FOR KLAMATH RIVER RENEWAL CORPORATION
--	--	--

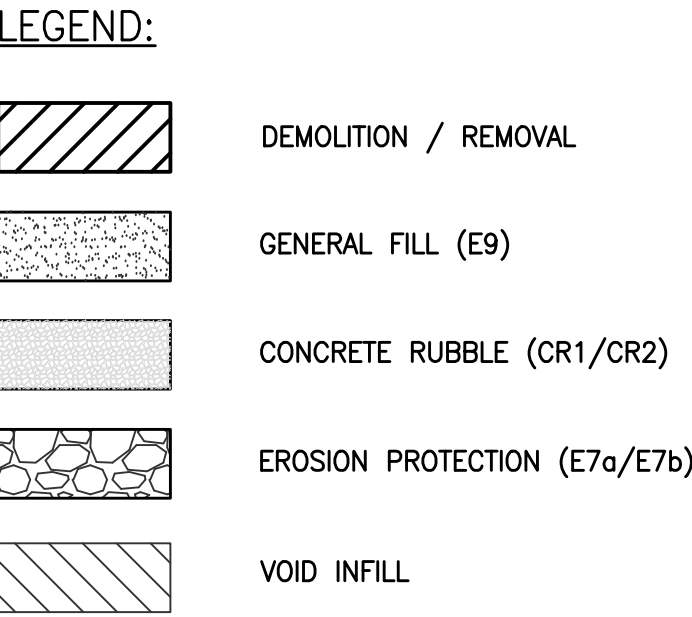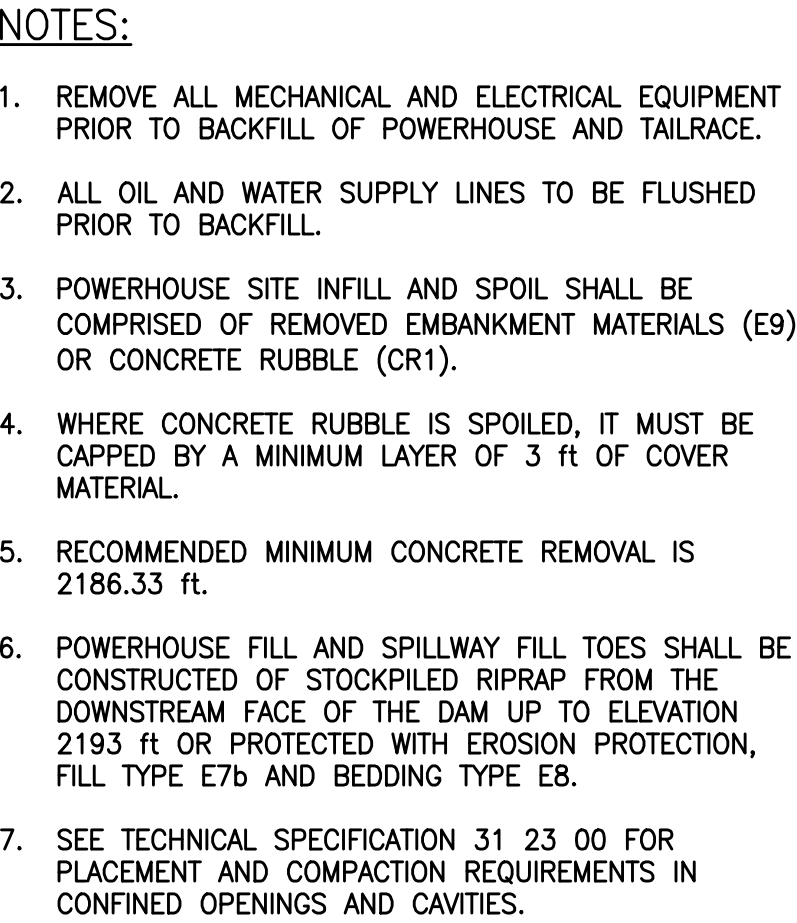PROJECT KLAMATH RIVER RENEWAL PROJECT	PROJ # VA103-640/1
SHEET TITLE FIGURE 8a IRON GATE POWERHOUSE DISPOSAL SITE - PLAN	DATE 05/27/2022
DWG C4401	

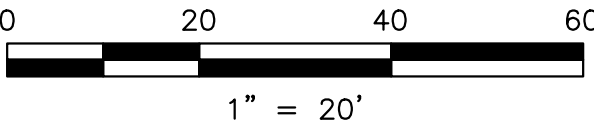

ISSUED FOR CONSTRUCTION



<div><div><div>WARNING</div><div>01/21</div><div></div></div><div>IF THIS BAR DOES NOT MEASURE 1" THEN DRAWING IS NOT TO SCALE</div></div>										<div><div>PREPARED BY</div><div><div></div><div>Knight Piesold CONSULTING</div></div><div><div></div><div>Kiewit</div></div></div>										<div><div>DESIGNED</div><div>K. WECHSELBERGER</div><div>DRAWN</div><div>A. TSENG</div><div>REVIEWED</div><div>S. YONG</div><div>IN CHARGE</div><div>N. BISHOP</div><div>APPROVED</div><div>S. MOTTRAM</div></div>										<div><div>PREPARED FOR</div><div></div><div>KLAMATH RIVER RENEWAL CORPORATION</div></div>										<div><div>PROJECT</div><div>KLAMATH RIVER RENEWAL PROJECT</div></div>										<div><div>PROJ.#</div><div>VA103-640/1</div></div>	
<div><div>1</div><div>ISSUED FOR CONSTRUCTION</div><div>KTW</div><div>SY</div><div>SRM</div><div>06/22/22</div></div>										<div><div>0</div><div>ISSUED FOR CONSTRUCTION</div><div>KTW</div><div>SY</div><div>SRM</div><div>05/27/22</div></div>										<div><div>SHEET TITLE</div><div>FIGURE 8b - IRON GATE FACILITY POWERHOUSE DISPOSAL SITE - PROFILE</div></div>										<div><div>DATE</div><div>05/27/2022</div></div>																					
<div><div>REV</div><div>DESCRIPTION</div><div>BY</div><div>CHK</div><div>APP</div><div>DATE</div></div>																				<div><div>DWG</div><div>C4402</div></div>																															

Appendix C

Oregon Waste Disposal and Hazardous Materials Management Plan



**Lower Klamath Project
FERC Project No. 14803**

**Oregon Waste Disposal
and Hazardous Materials
Management Plan**

**Klamath River Renewal Corporation
2001 Addison Street, Suite 317
Berkeley, CA 94704**

**Prepared by:
Camas LLC
680 G Street, Suite C
Jacksonville, OR 97530**

December 2022

This page intentionally left blank.

Table of Contents

1.0	Introduction.....	1
1.1	Purpose of Waste Disposal and Management Plan	1
1.2	Relationship to Other Management Plans	1
2.0	Non-Hazardous Waste	1
2.1	Quantity and Type of Anticipated Non-Hazardous Waste	1
2.2	Material Descriptions	2
3.0	Disposal Sites.....	3
3.1	Upland Disposal Sites	3
3.2	Powerhouse and Tailrace Disposal Site	6
3.3	Erosion and Sediment Control and Final Stabilization.....	8
4.0	Hazardous Waste Types	8
4.1	RCRA Hazardous Waste	8
4.2	RCRA Characteristic Hazardous Wastes	8
4.3	RCRA Listed Hazardous Wastes	9
4.4	Non-RCRA Hazardous Waste	9
4.4.1	Asbestos.....	9
4.4.2	Lead.....	10
4.5	Universal Waste	10
4.6	Used Oil	10
4.7	Oregon State Only Hazardous Waste	10
4.8	Waste Characterization.....	11
5.0	Previous Environmental Evaluations.....	11
5.1	Phase I Environmental Site Assessments	11
5.2	Hazardous Waste Surveys and Inventory	13
5.2.1	Surveys.....	13
5.2.2	Hazardous Materials Inventory	14
6.0	Hazardous Waste and Material Management	14
6.1	Hazardous Waste Generator	14
6.2	Training Requirements.....	14
6.3	Personnel Safety.....	14

6.4	Storage.....	14
6.4.1	Hazardous Waste Storage	15
6.4.2	Universal Waste Storage	15
6.4.3	Used Oil.....	15
6.5	Transportation	15
6.5.1	Hazardous Waste and Materials	15
6.5.2	Universal Hazardous Waste and Materials.....	15
6.5.3	Used Oil.....	15
6.6	Containment.....	16
6.6.1	Hazardous Waste and Material Containment	16
7.0	Spill Clean Up, Notification and Reporting Procedures	16
8.0	Deleterious Waste	16
9.0	References	17

List of Tables

Table 2-1. Non-Hazardous Waste Disposal.....	2
Table 2-2. Material Descriptions	2
Table 3-1. Upland Disposal Sites.....	4
Table 3-2. Powerhouse and Tailrace Disposal Site	7

Appendices

Appendix A	Figures
Appendix B	J.C. Boyle Hazardous Materials Survey Report
Appendix C	J.C. Boyle Hazardous Materials Inventory

1.0 Introduction

The Oregon Waste Disposal and Hazardous Materials Management Plan is a sub-plan of the Waste Disposal and Hazardous Materials Management Plan to be implemented as part of the Proposed Action for the Lower Klamath Project.

1.1 Purpose of Waste Disposal and Management Plan

The Oregon Waste Disposal and Hazardous Materials Management Plan describes the measures the Renewal Corporation (directly or through its contractor) will implement to manage hazardous and non-hazardous waste and materials resulting from the Proposed Action for portions located in Oregon. Specifically, the Oregon Waste Disposal and Hazardous Materials Management Plan addresses hazardous waste and hazardous material transportation, storage, spill prevention, and release reporting. The Renewal Corporation proposes to handle, store, transport, treat and dispose of hazardous waste and hazardous material in accordance with applicable federal, state, and local law.

In addition, the Oregon Waste Disposal and Hazardous Materials Management Plan states the measures the Renewal Corporation will implement to decommission existing septic tanks in accordance with the Oregon Administrative Rule (OAR) 340-071.

1.2 Relationship to Other Management Plans

The Oregon Waste Disposal and Hazardous Materials Management Plan is supported by elements of the Oregon Erosion and Sediment Control Plan and Construction Management Plan (Use and Occupancy Plan for Bureau of Land Management Lands) for effective implementation. So as not to duplicate information, elements from the Oregon Erosion and Sediment Control Plan and Construction Management Plan (Use and Occupancy Plan for Bureau of Land Management Lands) are not repeated herein but are, where appropriate, referred to in this Oregon Waste Disposal and Hazardous Materials Management Plan.

2.0 Non-Hazardous Waste

2.1 Quantity and Type of Anticipated Non-Hazardous Waste

The precise quantities and types of non-hazardous wastes generated by the Proposed Action will be determined in connection with waste characterization activities at the time of generation. Generally accepted waste characterization procedures will also be observed by the Renewal Corporation (directly or through its contractor) with respect to non-hazardous wastes.

Non-hazardous waste will be stored, managed, and disposed of in accordance with all local, state, and federal applicable laws.

Anticipated non-hazardous waste to be generated during the decommissioning of the J.C. Boyle Development is presented in Table 2-1. Specifically, the approximate bulk quantity, type of non-

hazardous waste, and the proposed disposal locations (on-site and off-site) are presented below and based on the Knight Piésold 100% Design Report (Knight Piésold 2022a). A description of these materials is presented in Section 2.2 (Knight Piésold 2022b).

Table 2-1. Non-Hazardous Waste Disposal

TYPE	QUANTITY	ANTICIPATED DISPOSAL LOCATION
Earthen Material	130,800 CY	Disposed of on-site: <ul style="list-style-type: none"> • Left Bank Disposal Site • Scour Hole Disposal Site • Powerhouse and Tailrace Disposal Site • Power Canal
Concrete Rubble ¹	51,900 CY	Disposed of on-site: <ul style="list-style-type: none"> • Scour Hole Disposal Site • Powerhouse and Tailrace Disposal Site
Building Waste ²	2,700 CY	Disposed of off-site: <ul style="list-style-type: none"> • Recycler or Permitted Landfill, pending selected contractor
Rebar	4,100 tons	Disposed of off-site: <ul style="list-style-type: none"> • Recycler
Mechanical and Electrical Materials	2,500 tons	Disposed of off-site: <ul style="list-style-type: none"> • Permitted Landfill, pending selected contractor
Transmission Lines	2.8 miles	Disposed of off-site: <ul style="list-style-type: none"> • Permitted Landfill, pending selected contractor

Notes:

1. Subject to confirmation by waste characterization at the time of generation, it is anticipated that concrete rubble removed during decommissioning will constitute Inert waste.
2. Building waste, which is anticipated to be non-hazardous solid waste subject to confirmation by waste characterization, includes but is not limited to steel penstocks, generator equipment, gates, valves, lighting, HVAC etc.

2.2 Material Descriptions

Table 2-2 includes materials that will either be placed within on-site disposal sites, used as a capping material, or for erosion and sediment control purposes. In addition, the source of the materials is included in the table.

Table 2-2. Material Descriptions

TYPE	DESCRIPTION	DEFINITION
E	Earthfill (Earthen Material)	Natural earth materials excavated from the surrounding area.

TYPE	DESCRIPTION	DEFINITION
E4	Select Fill	Cobbles, Gravel, and Sand, particles ranging from 4 in. to the #200 Sieve (0.0030 in.), low to no fines content, sourced off-site.
E9	General Fill (Earthen Material)	Boulders, Cobbles, Gravel, Sand and Fines, particles ranging from 20 in. to silt and clay, up to 30% fines content, sourced from project excavations or nearby borrow areas within limits of work.
E9a	General Fill (Earthen Material)	Boulders, Cobbles, Gravel, Sand and Fines, particles ranging from 20 in. to silt and clay, up to 40% fines content, sourced from project excavations or nearby borrow areas within limits of work.
E9b	General Fill (Earthen Material)	Boulders, Cobbles, Gravel and Sand, particles ranging from 20 in. to the #200 sieve (0.0030 in), low to no fines content, sourced from project excavations or nearby borrows area within limits of work.
E10	Random Fill (Earthen Material)	Overburden, Rocks or Organics, no gradation requirements, sourced from project excavations.
CR1	Concrete Rubble ^{1,2}	Particles ranging from 36 in. to the #200 Sieve (0.0030 in.), with up to 30% fines content, steel reinforcement to remain concrete, sourced from demolition of onsite concrete structures.
CR2	Concrete Rubble ^{1,2}	Particles ranging from 24 in. to the #200 Sieve (0.0030 in.), with up to 30% fines content, steel reinforcement to remain concrete, sourced from demolition of onsite concrete structures.

Notes:

1. Hazardous materials and substances will be removed prior to burying concrete rubble in a disposal site.
2. If access to rebar is safe, rebar protruding out of concrete will be cut flush and recycled off-site. Rebar and steel embedded in concrete will remain in its encased condition and buried.

3.0 Disposal Sites

3.1 Upland Disposal Sites

General Fill (Earthen Material) and Concrete Rubble will be disposed of at four on-site upland disposal sites (Upland Disposal Sites). Details pertaining to the location, construction, size, disposal materials, and associated figures for each disposal site are presented in Table 3-1. The Renewal Corporation will divert non-earthen material from being placed into the disposal sites. Disposal site locations were selected where drainage patterns can be preserved, such that onsite disposal would not create a threat to water quality. Appendix A, Figures includes two figures: general site location and a plan and profile of the disposal sites.

Table 3-1. Upland Disposal Sites

LOCATION	CONSTRUCTION	SIZE/INFILL CAPACITY	DISPOSAL MATERIALS	FIGURES
SCOUR HOLE DISPOSAL SITE¹				
<ul style="list-style-type: none"> Located between J.C. Boyle canal spillway and the Klamath River. The location is approximately between 3,579 and 3,771 MSL, which is approximately 30 feet above the anticipated Klamath River active stream channel. 	<ul style="list-style-type: none"> Located above anticipated post-drawdown OHWM. Rock material eroded from scour hole to be left in place. Place disposal materials within scour hole. 1.7H:1V slope range. Cap with minimum 6-foot cover of General Fill (E9 or E9b). Grade and slope for drainage to surrounding topography. Final erosion and sediment control stabilization (see Section 3.3). 	<ul style="list-style-type: none"> Disposal area is approx. 1.8 acres Infill capacity is approx. 45,000 CY 	<ul style="list-style-type: none"> Concrete Rubble (CR1/CR2) General Fill (E9/E9a/E9b) 	<ul style="list-style-type: none"> Appendix A Figure A-3– J.C. Boyle Disposal Site – Scour Hole Appendix A: Figure A-4a: J.C. Boyle Disposal Site – Scour Hole Plan Appendix A: Figure A-4b: J.C. Boyle Disposal Site – Scour Hole Profile
LEFT BANK DISPOSAL SITE				
<ul style="list-style-type: none"> Located on the left bank upstream of the dam. The location is approximately between 3,768 and 3,798 MSL, which is approximately 60 feet 	<ul style="list-style-type: none"> Located above anticipated post-drawdown OHWM. Remove residual reservoir sediment from bank. Place disposal materials on slope. Slope varies. 	<ul style="list-style-type: none"> Disposal area is approx. 10.8 acres Infill capacity is approx. 122,000 CY 	<ul style="list-style-type: none"> Random Fill (E10) General Fill(E9/E9b) 	<ul style="list-style-type: none"> Appendix A Figure A-5– J.C. Boyle Disposal Site – Left Bank

¹ The Scour Hole Disposal Site is located on Bureau of Land Management-owned land.

LOCATION	CONSTRUCTION	SIZE/INFILL CAPACITY	DISPOSAL MATERIALS	FIGURES
above the anticipated Klamath River active stream channel.	<ul style="list-style-type: none"> • Cap with minimum 6-foot cover of General Fill (E9/E9b). • Grade and slope for drainage to surrounding topography. • Final erosion and sediment control stabilization (see Section 3.3). 			<ul style="list-style-type: none"> • Appendix A: Figure A-6a: J.C. Boyle Disposal Site - Left Bank Disposal Plan • Appendix A: Figure A-6b: J.C. Boyle Disposal Site – Left Bank Profile

3.2 Powerhouse and Tailrace Disposal Site

General Fill and Concrete Rubble will be disposed of in existing structures (i.e., powerhouse and tailrace). Details pertaining to the location, construction, size, disposal materials, location in relation to the anticipated post-drawdown Ordinary High-Water Mark (OHWM) and associated figures for the disposal site is presented in Table 3-2. The disposal site is detailed in two figures; one figure depicts general site location, and the second figure presents a plan and profile of the disposal site. Figures are presented in Appendix A.

Table 3-2. Powerhouse and Tailrace Disposal Site

LOCATION	CONSTRUCTION	SIZE/INFILL CAPACITY	DISPOSAL MATERIALS	FIGURES
POWERHOUSE AND TAILRACE DISPOSAL SITE²				
<ul style="list-style-type: none"> Located adjacent to the J.C. Boyle Powerhouse Road and the Klamath River. 	<ul style="list-style-type: none"> Located partially below anticipated post-drawdown OHWM. Remove interior electrical, mechanical, and miscellaneous fixtures not imbedded in concrete from powerhouse prior to backfill. Place disposal materials within former tailrace and portion of powerhouse. Cap with a minimum of 2-foot cover of General Fill (E9/E9b). Cap with a minimum of 2-foot cover of Select Fill (E4) on the downward slope of the toe for erosion protection. 	<ul style="list-style-type: none"> Disposal area is approx. 0.3 acres Infill capacity is approx. 6,000 CY 	<ul style="list-style-type: none"> Concrete Rubble (CR2) General Fill (E9/E9b) 	<ul style="list-style-type: none"> Appendix A: Figure A-7– J.C. Boyle Disposal Site – Powerhouse and Tailrace Appendix A: Figure A-8a– J.C. Boyle Disposal Site – Powerhouse and Tailrace Plan Appendix A: Figure A-8b– J.C. Boyle Disposal Site – Powerhouse and Tailrace Profile

² The Powerhouse and Tailrace Disposal Site is located on Bureau of Land Management-owned land.

3.3 Erosion and Sediment Control and Final Stabilization

Erosion and sediment control methods and final stabilization of the disposal sites will be conducted in accordance with the Oregon Erosion and Sediment Control Plan and Construction Management Plan (Use and Occupancy Plan for Bureau of Land Management Lands). Please refer to these management plans for additional details.

4.0 Hazardous Waste Types

Specific procedures are required to handle, store, transport, treat, and dispose of hazardous waste to maintain compliance with federal, state, and local regulations. The following section categorizes various waste types consistent with applicable laws and specifies what constitutes a waste of that type.

4.1 RCRA Hazardous Waste

Hazardous waste is federally regulated by environmental agencies including the Environmental Protection Agency (EPA). A waste is considered Resource Conservation and Recovery Act (RCRA) hazardous waste if:

1. It is not excluded or exempt from classification as a waste or a hazardous waste; and
2. It meets hazardous waste classification criteria including:
 - a. It exhibits any hazardous characteristic under applicable laws (ignitability, corrosivity, reactivity, or toxicity);
 - b. It is a “listed waste” appearing on one of four lists prepared and maintained by environmental agencies including EPA (the F, K, P and U lists); or
 - c. It is a mixture of a waste and one or more hazardous wastes. However, the mixtures of solid wastes and hazardous wastes listed in subpart D are not hazardous wastes (except by application of paragraph (a)(2) (i) or (ii) of 40 CFR 261.3) if the generator can demonstrate that the mixture consists of wastewater, the discharge of which is subject to regulation under either Section 402 or Section 307(b) of the Clean Water Act (including wastewater at facilities which have eliminated the discharge of wastewater).

4.2 RCRA Characteristic Hazardous Wastes

A RCRA Characteristic hazardous waste is a solid waste that exhibits at least one of the four EPA-assigned hazardous waste characteristics and definitions presented below:

Flammability/Ignitability

A solid waste is ignitable if it has any of the following properties: (1) it is a liquid and has a flash point below 140 °F, (2) it is not a liquid and can cause fire through friction, absorption of moisture or spontaneous chemical changes and when ignited it burns so vigorously that it creates a hazard, (3) it is an ignitable compressed gas, or (4) it is an oxidizer.

Corrosivity

A solid waste is corrosive if it has any of the following properties: (1) it is aqueous and has a pH less than or equal to 2 or greater than or equal to 12.5, or (2) is a liquid and corrodes steel at a rate greater than 0.25 inches a year.

Reactivity

A solid waste is reactive if it has any of the following properties: (1) it is normally unstable and readily undergoes violent change without detonating, (2) it reacts violently with water, (3) it forms explosive mixtures with water, (4) when mixed with water it generates toxic gases, vapors, or fumes, (5) it is a cyanide or sulfide bearing waste, which when exposed to pH conditions between 2 and 12.5, can generate toxic gases, vapors, or fumes, (6) capable of detonation or explosive reaction if subjected to a strong initiating source or if heated under confinement, or (7) it is readily capable of detonation or explosive reaction at standard temperature.

Toxicity

A solid waste exhibits the characteristic of toxicity if it is equal to or exceeds the Toxicity Characteristic Leaching Procedure (TCLP) limit listed in 40 CFR 261.24 Table I – Maximum Concentration of Contaminants for the Toxicity Characteristic.

4.3 RCRA Listed Hazardous Wastes

A RCRA Listed hazardous waste is a solid waste the EPA has determined to be hazardous waste. There are three categories of listed wastes:

1. Chemical products which are regulated as hazardous wastes when they are discarded commercial chemical products, off-specification species, container residues, and spill residues thereof (P-listed and U-listed waste codes).
2. Specific wastes from specific types of industrial processes (K-listed waste code).
3. Wastes from non-specific types of industrial processes (F-listed waste code).

4.4 Non-RCRA Hazardous Waste

4.4.1 Asbestos

Disturbance of any asbestos containing material (ACM) or asbestos containing waste material could generate airborne asbestos fibers and would be regulated by the Oregon Department of Environmental Quality (DEQ). DEQ worker health and safety regulations apply during any disturbance of ACM or asbestos containing waste material by a person while in the employ of another. Disturbance of any asbestos containing material (ACM) or asbestos containing waste material will be conducted by an Oregon-Licensed asbestos abatement contractor in accordance with OAR 340-248-0110(1).

4.4.2 Lead

Following determination of RCRA levels of lead (D008 is >5.0 mg/l), disturbance of lead containing products or surfaces (which does not include remediating a lead hazard or action specifically designed to remove lead-based paint (LBP) to reduce or eliminate a known hazard), would be considered lead-related construction work.

4.5 Universal Waste

Universal wastes are hazardous wastes that are common to the workplace and pose a lower risk to people and the environment than other hazardous wastes. Types of waste streams regulated as universal wastes include the following:

- Batteries
- Pesticides
- Mercury-containing equipment
- Mercury-containing lamps (fluorescent light tubes and high-intensity discharge or HID lamps)

4.6 Used Oil

The DEQ defines used oil as any oil that has been refined from crude or synthetic oil and used as one of the following: lubricant, electrical insulation oil, hydraulic fluid, heat transfer oil, brake fluid, refrigeration oil, grease, and machine cutting oil. Used oil can be recycled to make new lubricants or used as an industrial fuel under established safeguards. When properly recycled, it is excluded from hazardous waste regulation.

Used oil does not include the following: used oil mixed with hazardous waste except as allowed in 40 CFR 279.10(b), petroleum and synthetic-based products used as solvent, antifreeze, wastewaters from which the oil has been removed, and oil-contaminated media or debris. Other materials that contain or are contaminated with used oil may also be subject to regulation as “used oil”.

4.7 Oregon State Only Hazardous Waste

If no other federally listed RCRA codes apply, the DEQ recognizes RCRA listed wastes as hazardous, with a few exceptions that fall into the acutely hazardous category. Oregon adds to the federally listed hazardous wastes:

- Any residue, including manufacturing process wastes and unused chemicals, that has either: a 3 percent or greater concentration of any substance or mixture of substances listed in 40 CFR 261.33(e), or a 10 percent or greater concentration of any substance or mixture of substances listed in 40 CFR 261.33(f).
- Any residue or contaminated soil, water or other debris resulting from the cleanup of a spill into or on any land or water, of either: a residue identified in OAR 340-101-0033(2)(a)(A) or a residue identified in subsection OAR 340-101-0033 (2)(a)(B).

- X001 for Waste Pesticide residue, except for those that are managed as universal wastes; or whose constituents are listed in 40 CFR 261.24 (a) but are below the prescribed regulatory levels.

4.8 Waste Characterization

To determine the manner in which waste is required to be handled, stored, treated, transported or disposed, the waste generator must perform waste characterization in accordance with applicable laws. Generally accepted methods of waste characterization in Oregon (40 CFR 262.11) include the following:

1. Testing or sampling the waste according to approved methods (Sampling & Analysis); or
2. Applying knowledge of the hazardous properties of the waste considering the materials or the processes used and the characteristics (Process Knowledge).

5.0 Previous Environmental Evaluations

5.1 Phase I Environmental Site Assessments

Phase I Environmental Site Assessments (ESA) have been conducted for the Proposed Action to identify the presence, nature, and quantities of hazardous waste prior to commencement of dam removal. These ESAs are summarized below.

Phase I Environmental Site Assessment

J.C. Boyle Dam, Copco No. 1 Dam, Copco No. 2 Dam, Iron Gate Dam, Iron Gate Fish Hatchery

Prepared by AECOM, for the Renewal Corporation
November 2018

The 2018 ESA included an assessment of the J.C. Boyle, Copco No. 1, Copco No. 2, Iron Gate, and Iron Gate Fish Hatchery Developments. The summary provides below includes the information pertaining to the J.C. Boyle Development from the 2018 ESA and does not include the undeveloped lands surrounding the J.C. Boyle Development. The objectives of this report were to identify Recognized Environmental Conditions (RECs) that may exist at the J.C. Boyle Development. The 2018 ESA did not identify the presence of RECs associated with the J.C. Boyle Development. Although RECs were not identified as part of the ESA, additional findings included the following:

- An environmental regulatory database report identified an underground storage tank (UST) at the “J C BOYLE POWER PLANT”. The report noted that this listing was an unmappable location due to poor or inadequate address information. No further information was available with regards to the specific location of the UST or whether it has been removed.
- One 500-gallon diesel and one-1,000-gallon gasoline above-ground storage tank (AST) and associated dispenser pumps are located adjacent to the Hazardous Material

Storage Shed. Both ASTs are double walled, are properly labeled and are underneath a permanent “cover”, on top of concrete pads and appear to be in good condition with no observable signs of leakage. A metal grate was noted within the concrete fueling pad in front of the ASTs that drains to an oil-water separator. Although scattered snow and ice cover the areas surrounding the ASTs, no observable signs of staining, petroleum odors or distressed vegetation were noted.

According to PacifiCorp’s 2019 SPCC Plan, there are no USTs located at the J.C. Boyle Development. Any gasoline in the AST will be excluded from the manifest, the generator category, and management as hazardous waste when managed under 40 CFR 261.2(c)(2)(ii)

Draft Phase I Environmental Site Assessment

Parcel B Lands

Prepared by AECOM, for the Renewal Corporation
January 2020

The subject of the 2020 ESA includes an assessment of the undeveloped land, known as Parcel B lands surrounding the J.C. Boyle Development. The objectives of this report were to identify RECs that may exist on the Parcel B lands surrounding the J.C. Boyle Development. Two RECS were identified as part of the Phase I ESA and are included below.

Dispersed Recreation Area – 2

A burn pit and stressed vegetation were identified on the north banks of the northeast side of the J.C. Boyle Reservoir, approximately 2,200 feet east of Spencer Creek. The burn pit is approximately 10 feet by 10 feet and contains ash, charred wood, broken glass, and other debris. The burning of these materials may generate contaminants that can leach into the soil and groundwater beneath the pit. A Phase II ESA soil and groundwater assessment is proposed to assess potential impacts.

Debris Piles

Three debris piles containing chopped wood, trees, household materials and appliances, potentially treated wood beams and metal scraps were observed approximately 600 feet west of Topsy Grade Road and 1,000 feet south of the J.C. Boyle Reservoir. Since the nature of this debris is unknown, a Phase II soil and groundwater assessment is proposed to assess potential impacts.

Following further review of the RECs identified in the Draft 2018 Phase I ESA, it was determined the Debris Piles did not warrant an additional soil and groundwater assessment. The Dispersed Recreation Area-2 was determined to be further evaluated. This evaluation is included below in the November 2021 Oregon Site Investigation Work Plan (OR SIWP).

Lower Klamath Hydroelectric Project Oregon Site Investigation Work Plan

Prepared by Jacobs, for PacifiCorp
November 2021

The 2021 OR SIWP was prepared to address the Dispersed Recreation Area-2 REC identified in the Draft January 2020 Phase I ESA – Parcel B Lands. A sampling plan was developed for this REC. Soil samples will be collected within and adjacent to the fire ring and from outside the visually impacted area (Figure 3-1) and analyzed for Title 22 metals, volatile organic compounds, semi-volatile organic compounds, dioxins, and furans.

The SIWP indicated potential contamination will likely be confined to shallow soil. Samples will be collected at 6-inch intervals every foot beginning at the surface to approximately 3.5 feet below the ground surface (bgs) at each sample location. The boring in the center of the fire ring will be advanced to a depth of 6 feet bgs for the collection of soil samples at the following intervals: 0.0-0.5 foot, 1.0-1.5 feet, 3.0-3.5 feet, and 5.5-6.0 feet bgs. Borings will be extended if visual observations or field instruments indicate COPCs are deeper. Two additional soil samples will be collected below the impacted soil. If groundwater is encountered in any of the borings, groundwater samples will be collected.

Implementation of the Oregon SIWP is being completed as part of the land transfer.

5.2 Hazardous Waste Surveys and Inventory

5.2.1 Surveys

The Renewal Corporation conducted surveys to identify and quantify hazardous waste with potential to be generated from demolition of dams and associated structures that will be managed and disposed of as part of the Proposed Action.

Hazardous Building Material Surveys (HBMSs)

J.C. Boyle Development

Prepared by AECOM, for the Renewal Corporation
April 2019

A HBMS was conducted in April 2019 at the J.C. Boyle Development. The purpose of the HBMS survey was to provide information regarding the presence of lead-based paint (LBP) containing coatings, polychlorinated biphenyls (PCB)-containing light ballasts, PCB-containing caulking, and mercury-containing sources, and the presence, location, and quantity of ACMs, for the purposes of decommissioning planning. Additional hazardous materials identified as part of this survey are presented as part of the October 2020 surveys presented below.

Hazardous Materials Survey Report (HMS)

J.C. Boyle Development

Prepared by Entek Consulting Group, Inc. for NV5
October 2020

A HMS was conducted in October 2020 at the J.C. Boyle Development. The purpose of this survey was to conduct a supplementary investigation to the April 2019 HBMS for hazardous materials. The October 2020 survey results include the April 2019 survey results. Since the HMS report is a compilation of the surveys conducted in 2019 and 2020, this report is included as Appendix B.

5.2.2 Hazardous Materials Inventory

The hazardous wastes identified as part of the surveys are presented in the following tables within Appendix C.

- Table C-1.: Universal Waste Inventory
- Table C-2.: Non-RCRA Hazardous Waste Inventory
- Table C-3.: Characteristic Hazardous Waste Inventory

6.0 Hazardous Waste and Material Management

6.1 Hazardous Waste Generator

As a likely generator or co-generator of hazardous waste, the Renewal Corporation (directly or through its contractor) will conduct waste characterization for solid waste streams associated with the Proposed Action at the time of generation in compliance with generally accepted waste characterization procedures under applicable laws. The Renewal Corporation (directly or through its contractor) will manage all wastes characterized as hazardous waste produced as part of the Proposed Action in accordance with applicable federal and state law.

6.2 Training Requirements

Personnel will be trained to handle hazardous waste and materials in compliance with applicable federal and state laws. The Health and Safety Plan states additional personnel training requirements relevant to the handling of hazardous waste and hazardous materials.

6.3 Personnel Safety

Please reference the Health and Safety Plan for guidelines on personnel health and safety when handling hazardous waste and materials. The Renewal Corporation has also developed an Emergency Response Plan if accidents involving personnel occur.

6.4 Storage

Hazardous waste and materials will be stored in compliance with applicable laws and managed to prevent spills or releases of hazardous substances and to prevent the mixing of incompatible waste streams until they can be properly disposed of in accordance with local, state, and federal regulations. Storage locations will be selected prior to implementing the Proposed Action.

6.4.1 Hazardous Waste Storage

Hazardous waste will be stored prior to off-site transport and disposal in compliance with applicable laws and regulations, including rules governing waste generator pre-transport requirements and hazardous waste accumulation timelines.

6.4.2 Universal Waste Storage

The Renewal Corporation will store batteries, pesticides, mercury-containing equipment, and mercury-containing lamps (fluorescent light tubes and high-intensity discharge or HID lamps) in accordance with applicable universal waste storage regulations.

6.4.3 Used Oil

Used oil will be stored in accordance with applicable standards for management of used oil.

6.5 Transportation

Hazardous waste and materials will be transported in accordance with all local, state, and federal regulations.

6.5.1 Hazardous Waste and Materials

Hazardous waste and materials will be transported by a licensed hazardous waste transporter in accordance with applicable laws. Before being transported, waste and materials will be packaged, labeled, and marked in accordance with application requirements of governmental agencies. Hazardous waste transporters will obtain a completed and signed Uniform Hazardous Waste Manifest. Hazardous waste and materials will be contained in appropriate containers when transported.

6.5.2 Universal Hazardous Waste and Materials

Universal waste and materials will be transported to an off-site authorized universal waste collection site or to a universal waste destination facility, which will be determined at the time of disposal. An off-site collection site is a location where the waste may be shipped for consolidation before shipment to a universal waste destination facility.

Universal waste shall be transferred to a destination facility that treats, recycles, or disposes of universal waste and will meet applicable state and federal transportation requirements for packaging, labeling, placarding, and preparing shipping documentation.

6.5.3 Used Oil

Used oil generators shipping more than 55 gallons of used oil at a time will use a DEQ registered used oil transporter. The transporter will deliver used oil collected from the generator to:

- Another used oil transporter who also has obtained a DEQ/EPA identification number

- A used oil processing/re-refining facility that has obtained a DEQ/EPA identification number
- An off-specification used oil burning facility that has obtained a DEQ/EPA identification number
- An on-specification used oil burning facility

6.6 Containment

Containment of hazardous wastes will be managed in accordance with applicable local, state, and federal regulations.

6.6.1 Hazardous Waste and Material Containment

As discussed above, hazardous waste and materials will be stored in compliance with applicable laws and regulations, including rules governing waste generator pre-transport requirements and hazardous waste accumulation timelines.

Storage locations for hazardous waste and materials to be used in connection with the Proposed Action will include secondary containment units so that if a leak occurs, it will be contained and not allowed to enter the surrounding environment. If there is a fuel storage on-site, the containment will have a minimum volume of 120 percent of the volume of the largest container stored in that area. Secondary containment will be maintained, clean, and free of standing water.

Hazardous waste and materials will be stored and protected from rain and runoff to avoid contamination of soil or transfer to a water source. Along with utilizing the correct storage container, the Renewal Corporation will label, tag, or mark each substance with overall signage including the name of the substance, the hazard warning (e.g., corrosive, toxic, etc.), and the manufacturer's contact information. Hazardous waste and materials will be contained in an appropriate container when transported.

7.0 Spill Clean Up, Notification and Reporting Procedures

As discussed herein, the Project will take customary steps to avoid unauthorized spills, releases, or discharges of hazardous substances. In the event of a spill or release of hazardous waste materials into the environment, the Renewal Corporation may initiate testing to determine the level of response and abatement required. Monitoring of the spill site will continue until full abatement has been reached and if necessary, the details of the spill event and actions taken in response to the spill will be reported to the appropriate agencies and/or authorities. For additional measures relevant to spill events, reporting procedures, and notification process please refer to the Oregon Spill Prevention, Control and Countermeasure Plan.

8.0 Deleterious Waste

The Renewal Corporation will not place biologically harmful material including but not limited to petroleum products, chemicals, cement cured less than 24 hours, welding slag and grindings,

concrete saw cutting by-products, sandblasted materials, chipped paint, tires, wire, steel posts, and asphalt where such materials could enter waters of the state, including wetlands. To ensure these protections occur the Renewal Corporation will do the following:

- Cure concrete, cement, or grout for at least 24 hours prior to any contact with flowing waters.
- Use only clean fill, free of waste and polluted substances.
- Employ all practicable controls to prevent discharges of spills of deleterious materials to surface or ground water.
- Maintain at the project construction site, and deploy as necessary, an adequate supply of materials needed to contain deleterious materials during a weather event.
- Remove foreign materials, refuse, and waste from the project area.
- Always employ general good housekeeping practices.

9.0 References

Electronic Code of Federal Regulations (eCFR) Title 29, Part 1910. Hazardous Waste Operations and Emergency Response. *Accessed October 10, 2020.*

Electronic Code of Federal Regulations (eCFR) Title 40, Part 260. Hazardous Waste Management System: General. *Accessed October 10, 2020.*

Electronic Code of Federal Regulations (eCFR) Title 40, Part 261. Identification and Listing of Hazardous Waste. *Accessed October 10, 2020.*

Electronic Code of Federal Regulations (eCFR) Title 40, Part 262. Standards Applicable to Generators of Hazardous Waste. *Accessed October 10, 2020.*

Electronic Code of Federal Regulations (eCFR) Title 40, Part 264. Standards for Owners and Operators of Hazardous Waste Treatment, Storage, and Disposal Facilities. *Accessed October 10, 2020.*

Electronic Code of Federal Regulations (eCFR) Title 40, Part 273. Standards for Universal Waste Management. *Accessed October 10, 2020.*

Electronic Code of Federal Regulations (eCFR) Title 40, Part 279. Standards for the Management of Used Oil. *Accessed October 10, 2020.*

Electronic Code of Federal Regulations (eCFR) Title 40, Part 302. Designation, Reportable Quantities, and Notification. *Accessed October 10, 2020.*

Electronic Code of Federal Regulations (eCFR) Title 49, Part 172. Hazardous materials table, special provisions, hazardous materials communications, emergency response information, training requirements, and security plans. *Accessed October 10, 2020.*

Electronic United States Code (eUSC) Title 42, Chapter 103, Subchapter 1, Section 9601. Comprehensive Environmental Response, Compensation, and Liability Act.

Klamath River Restoration Corporation (KRRRC). 2020. Klamath River Renewal Project 100% Design Report.

Klamath River Renewal Corporation (KRRRC). 2018. Definite Plan for the Lower Klamath Project. June.

Knight Piésold. 2022a. Design Report. Prepared for Klamath River Renewal Project. June.

Knight Piésold. 2022b. Technical Specifications. Prepared for Klamath River Renewal Project. June.

Oregon Administrative Rules (eOAR) Chapter 340, Division 113: Universal Waste Management. *Accessed online December 10, 2020.*


Oregon Administrative Rules (eOAR) Chapter 340, Division 111: Used Oil Management. *Accessed online December 10, 2020.*

Oregon Administrative Rules (eOAR) Chapter 340, Division 101: Identification and Listing of Hazardous Waste. *Accessed online December 10, 2020.*

Oregon Department of Environmental Quality (ODEQ). 2018. Clean Water Act Section 401 Certification for the Klamath River Renewal Corporation License Surrender and Removal of the Lower Klamath Project (FERC No. 14803) Klamath County, Oregon. September.

Appendix A

Figures

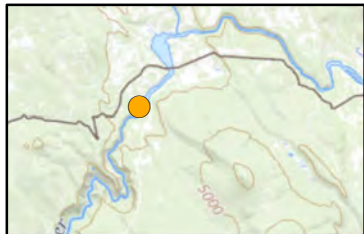

0 115 230 460 Feet
(At original document size of 8.5 x 11)
1:3,290

Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal Sites, Limits of Work and Access Routes; Knight Piesold 100 design
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

Legend

- Disposal Sites
- Limits of Work 100
- Roads


Lower Klamath Project
**Figure A-1: J.C. Boyle
Disposal Site
Barrow Site**



PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

Document Path: C:\Users\kfoal\Box\GIS\Project_Tracking\GIS_Requests_Management_ParaCameras_MPA\WP3\Job_disposal_site_barrow_site_plan.mxd

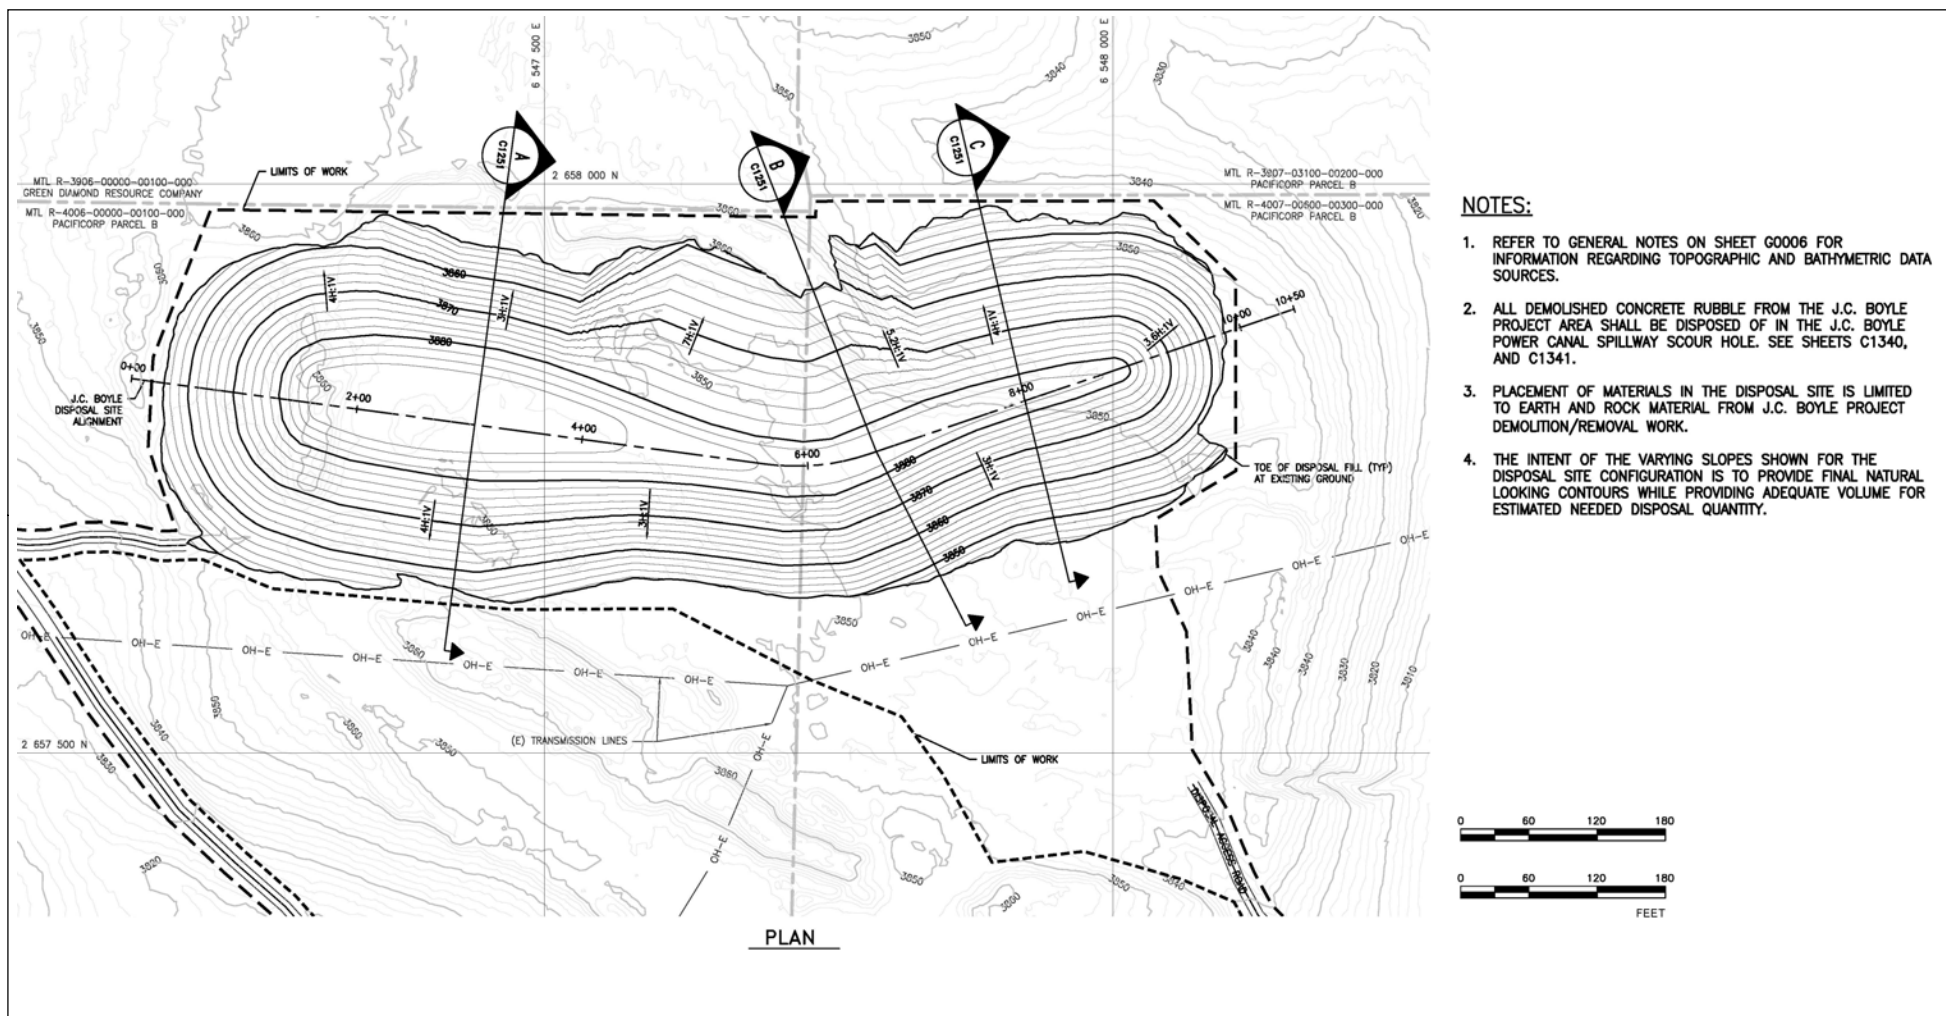

Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites: and access routes: Knight Piesold 30 design;
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.






Lower Klamath Project

Figure A-2a: J.C. Boyle Disposal Site Barrow Site - Plan



**PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)**

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

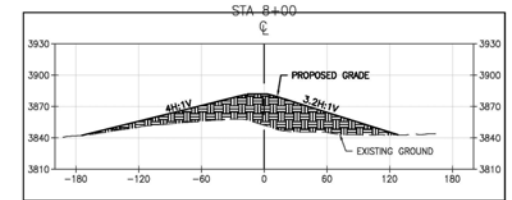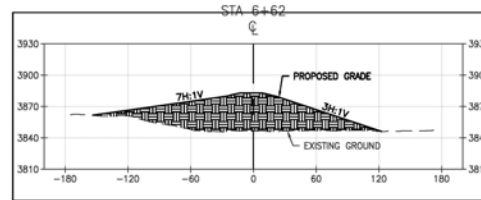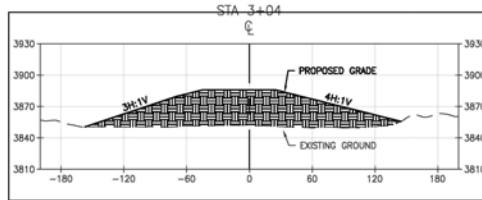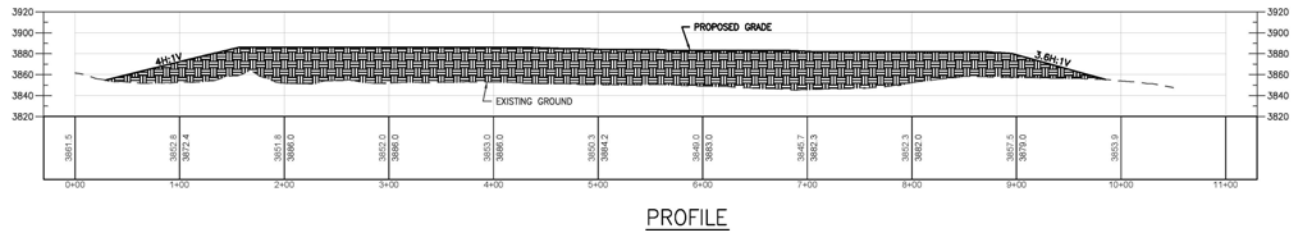

NOTE:

1. ALL DEMOLISHED CONCRETE RUBBLE FROM THE J.C. BOYLE PROJECT AREA SHALL BE DISPOSED OF IN THE J.C. BOYLE POWER CANAL SPILLWAY SCOUR HOLE. SEE SHEETS C1340, AND C1341.
2. PLACEMENT OF MATERIALS IN THE DISPOSAL SITE IS LIMITED TO EARTH AND ROCK MATERIAL FROM J.C. BOYLE PROJECT DEMOLITION/REMOVAL WORK.
3. THE INTENT OF THE VARYING SLOPES SHOWN FOR THE DISPOSAL SITE CONFIGURATION IS TO PROVIDE FINAL NATURAL LOOKING CONTOURS WHILE PROVIDING ADEQUATE VOLUME FOR ESTIMATED NEEDED DISPOSAL QUANTITY.



Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Disposal sites: and access routes: Knight Piesold 30 design;
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

LEGEND:





EARTH FILL (PROPOSED)

Lower Klamath Project
Figure 2b: J.C. Boyle Disposal
Site Barrow Site - Profile






PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

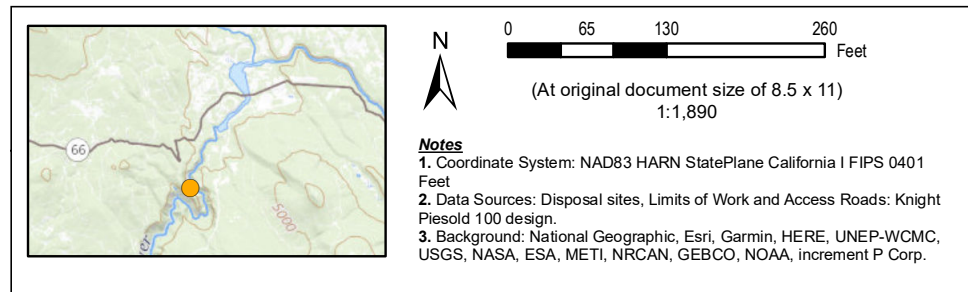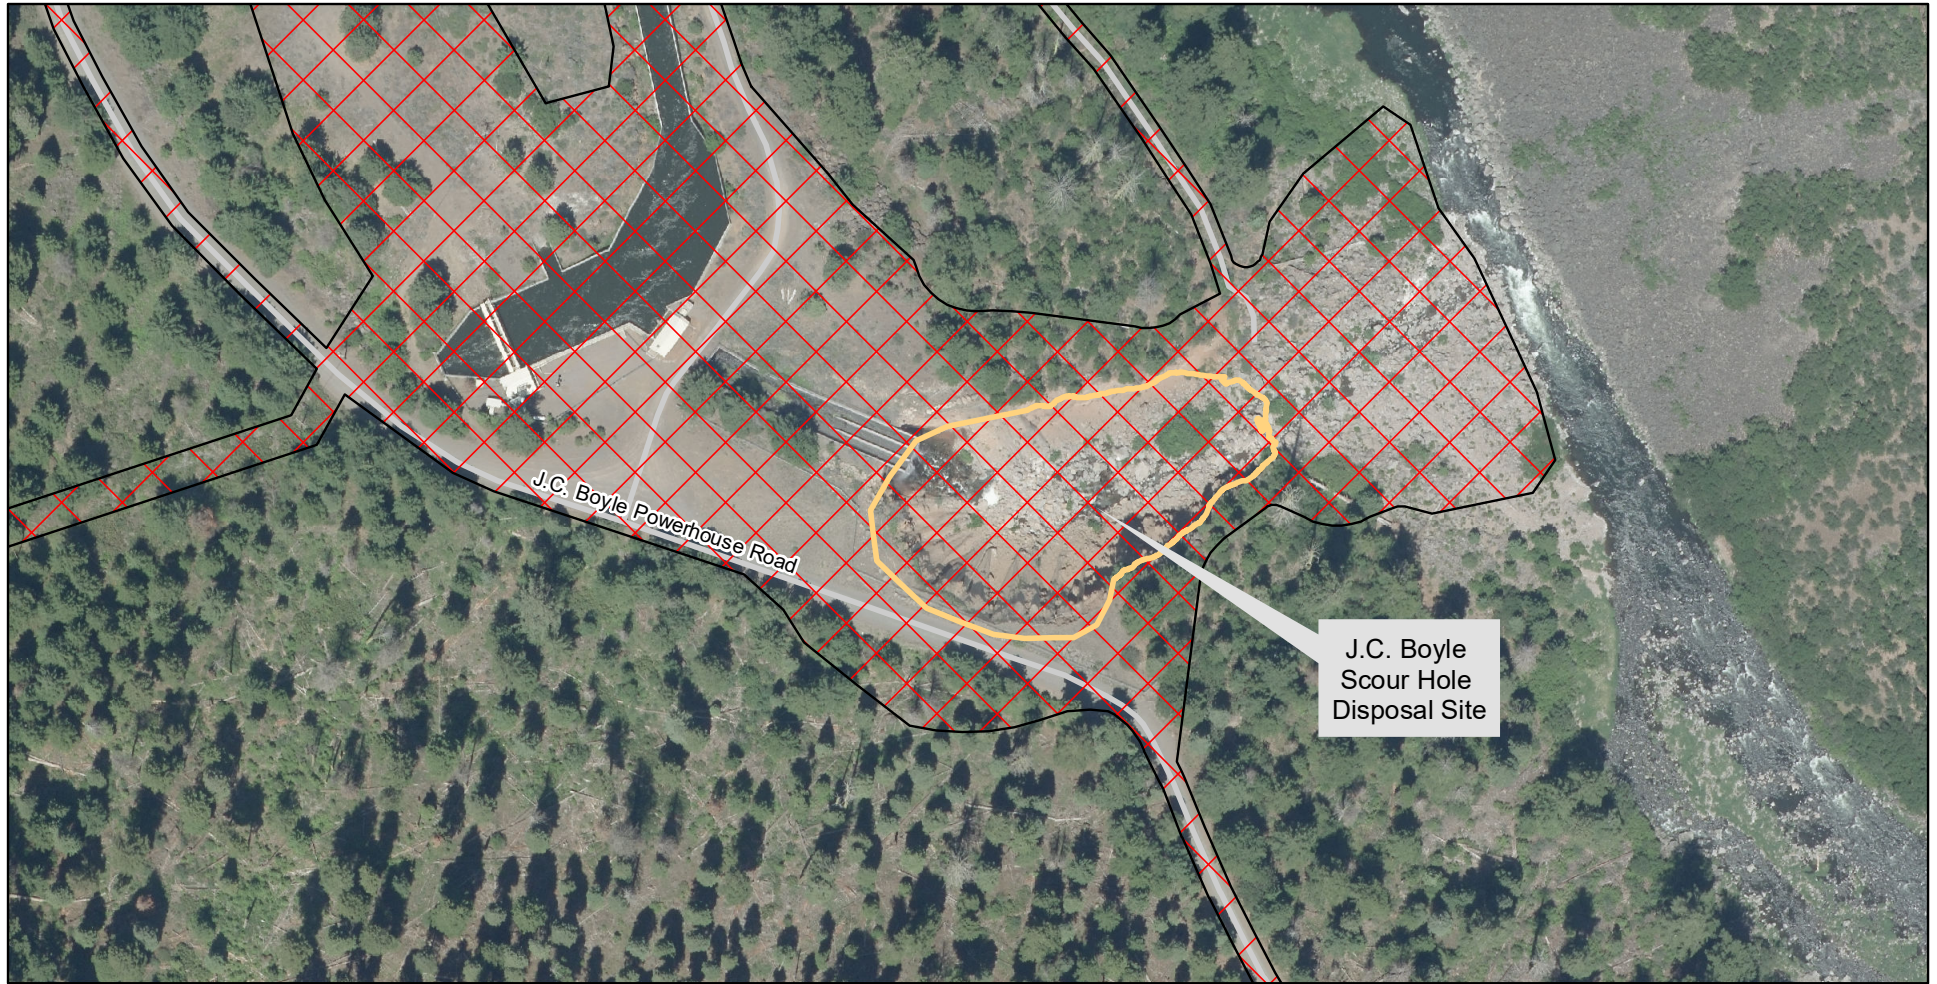

Legend


-  Disposal Sites
-  Limits of Work
-  Roads

Lower Klamath Project
**Figure A-3: J.C. Boyle Disposal Site
Scour Hole**



**PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)**

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

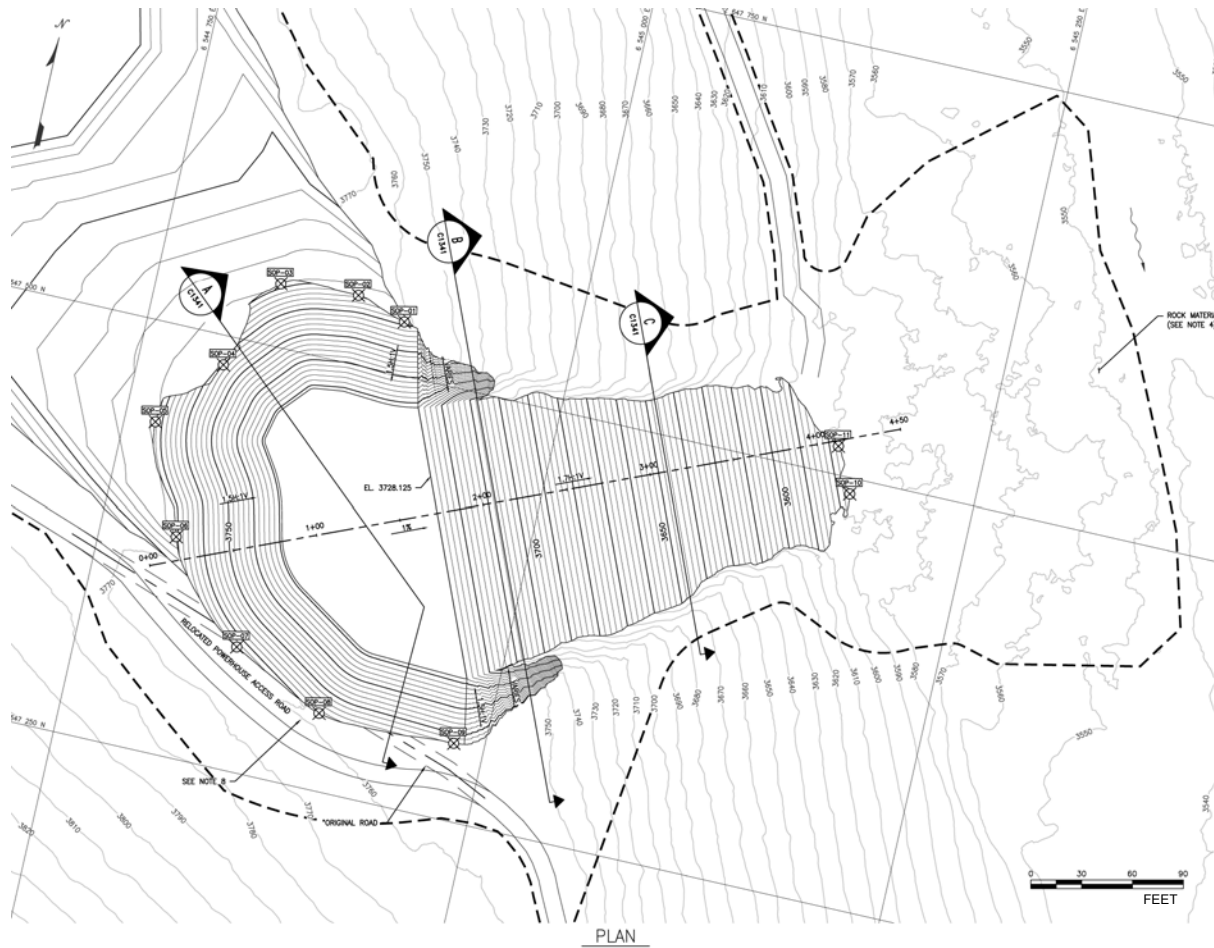

NOTES:

1. REFER TO GENERAL NOTES ON DRAWING G0006 FOR INFORMATION REGARDING TOPOGRAPHIC AND BATHYMETRIC DATA SOURCES.
2. CONTRACTOR TO ADJUST SITE SLOPES AND GRADES FOR SAFETY AS NECESSARY.
3. EXCAVATED MATERIAL FROM FOREBAY GRADING TO BE USED AS COVER MATERIAL FOR SCOUR HOLE FILL.
4. ROCK MATERIAL ERODED FROM SCOUR HOLE TO BE LEFT IN PLACE.
5. SCOUR HOLE FILL LIMITED TO CONCRETE RUBBLE (CR1/CR2) AND GENERAL FILL (E9/E9a/E9b) MATERIALS. MATERIAL THAT DOES NOT MEET THESE REQUIREMENTS TO BE PLACED AT THE LEFT BANK DISPOSAL SITE.
6. ALL CONCRETE TO BE BURIED WITH A MINIMUM 6 ft OF COVER MATERIALS.
7. MAXIMUM POTENTIAL FILL SHOWN ON DRAWING TO BE GRADED TO DRAIN.
8. BOULDERS TO BE PLACED BETWEEN POWERHOUSE ROAD REALIGNMENT AND SCOUR HOLE FILL. DETAILS SHOWN ON DRAWING C1511.
9. ELEVATION CONTOURS OF SCOUR HOLE FILL DENOTE FINAL GRADE.



Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites: Knight Piesold 100 design; Access routes: Knight Piesold 100 design.
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

LEGEND:


— — — LIMITS OF WORK

Lower Klamath Project
**Figure A-4a: J.C. Boyle Disposal Site
Scour Hole - Plan**



PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

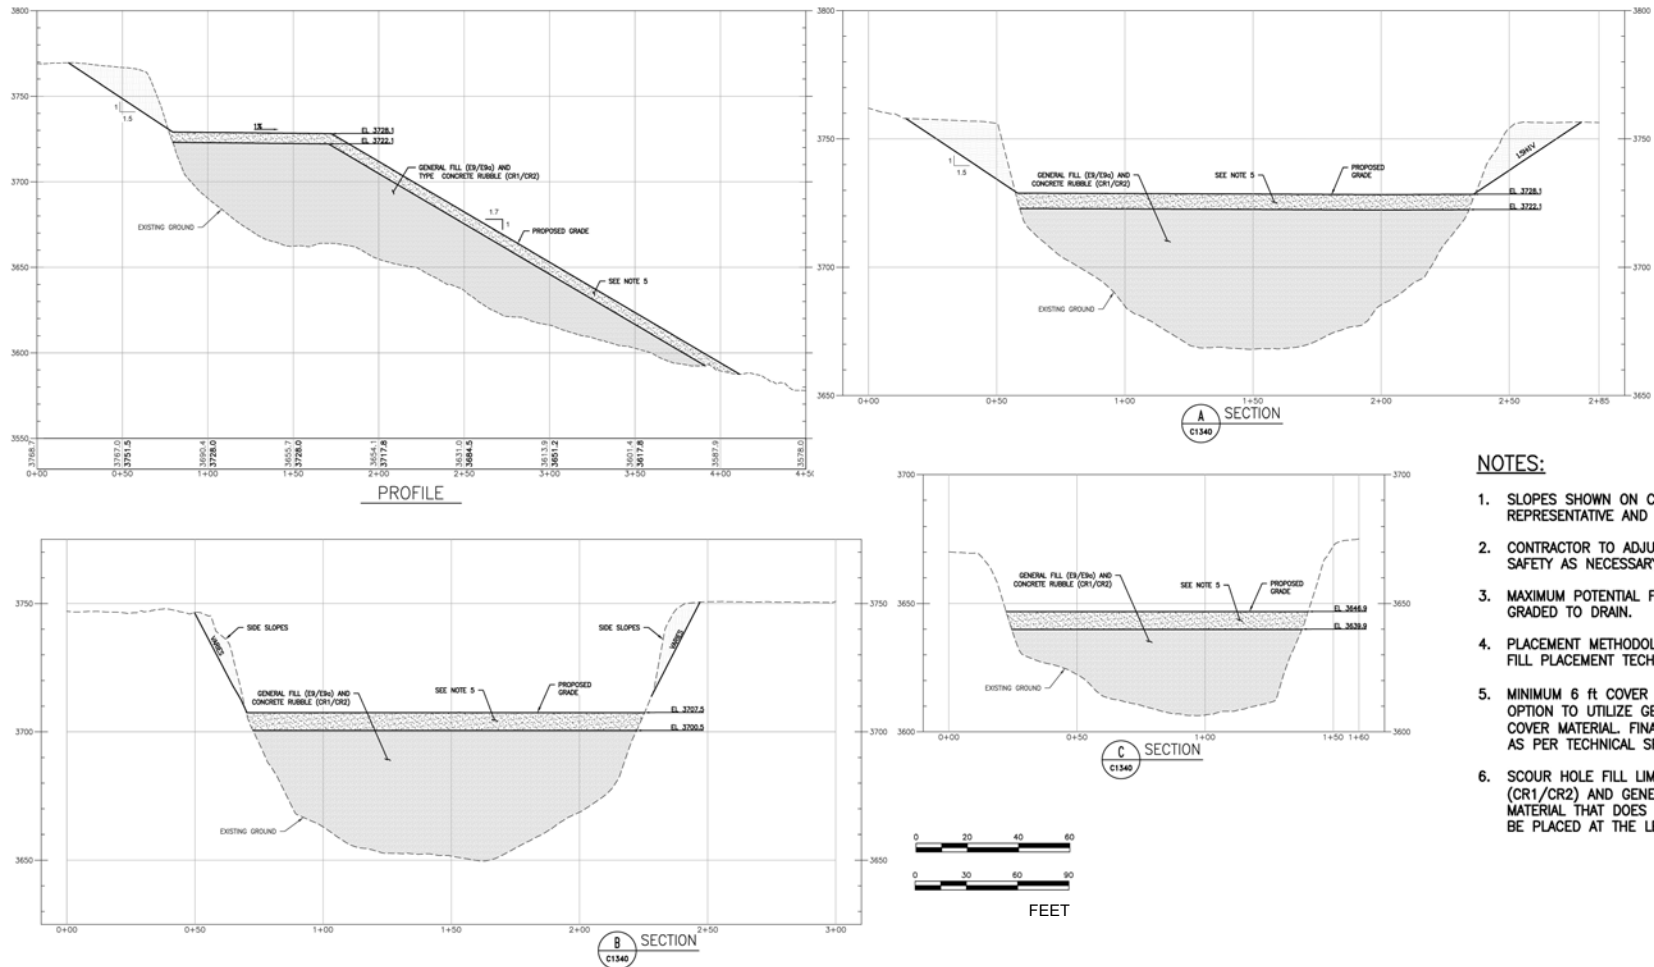

NOTES:

1. SLOPES SHOWN ON CROSS-SECTIONS ARE REPRESENTATIVE AND WILL VARY IN CERTAIN AREAS.
2. CONTRACTOR TO ADJUST SIDE SLOPES AND GRADES FOR SAFETY AS NECESSARY.
3. MAXIMUM POTENTIAL FILL SHOWN ON DRAWING TO BE GRADED TO DRAIN.
4. PLACEMENT METHODOLOGY DESCRIBED IN EXCAVATION AND FILL PLACEMENT TECHNICAL SPECIFICATION.
5. MINIMUM 6 ft COVER MATERIAL GENERAL FILL (E9/E9b). OPTION TO UTILIZE GENERAL FILL (E9) OR (E9b) AS COVER MATERIAL. FINAL STABILIZATION TREATMENTS DIFFER AS PER TECHNICAL SPECIFICATION 31 25 00.
6. SCOUR HOLE FILL LIMITED TO CONCRETE RUBBLE (CR1/CR2) AND GENERAL FILL (E9/E9a/E9b) MATERIALS. MATERIAL THAT DOES NOT MEET THESE REQUIREMENTS TO BE PLACED AT THE LEFT BANK DISPOSAL SITE.

LEGEND:

- (E) EARTHFILL
- CONCRETE RUBBLE (CR1/CR2)
- GENERAL FILL (E9/E9a/E9b)



Lower Klamath Project
Figure A-4b: J.C. Boyle Disposal Site
Scour Hole Profile

PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)




Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

Notes

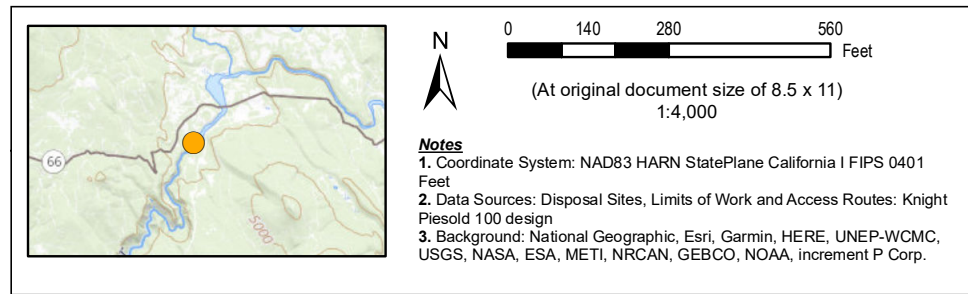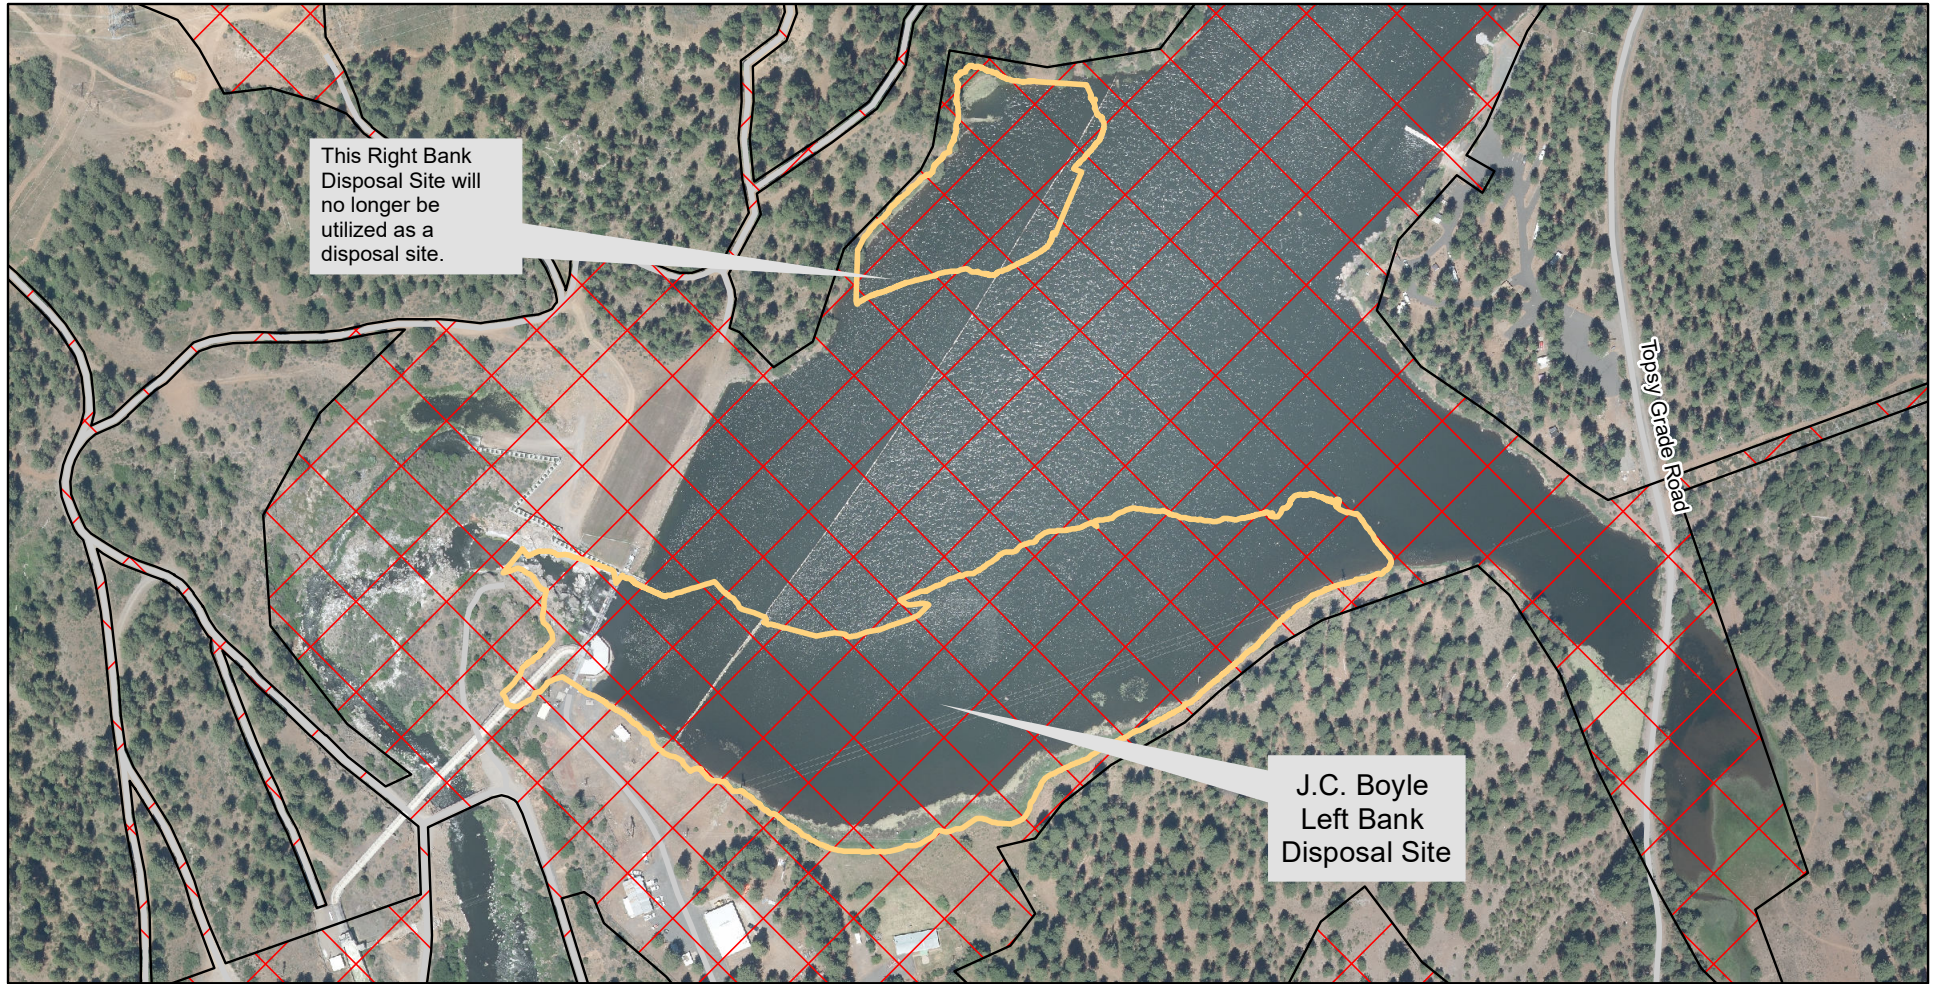1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites: Knight Piesold 100 design; Access routes: Knight Piesold 100 design.
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.



Legend



-  Disposal Sites
-  Limits of Work
-  Roads

Lower Klamath Project
Figure A-5 J.C. Boyle Left Disposal Site



NOT FOR CONSTRUCTION


Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

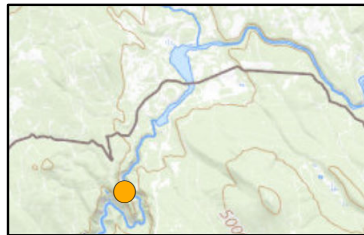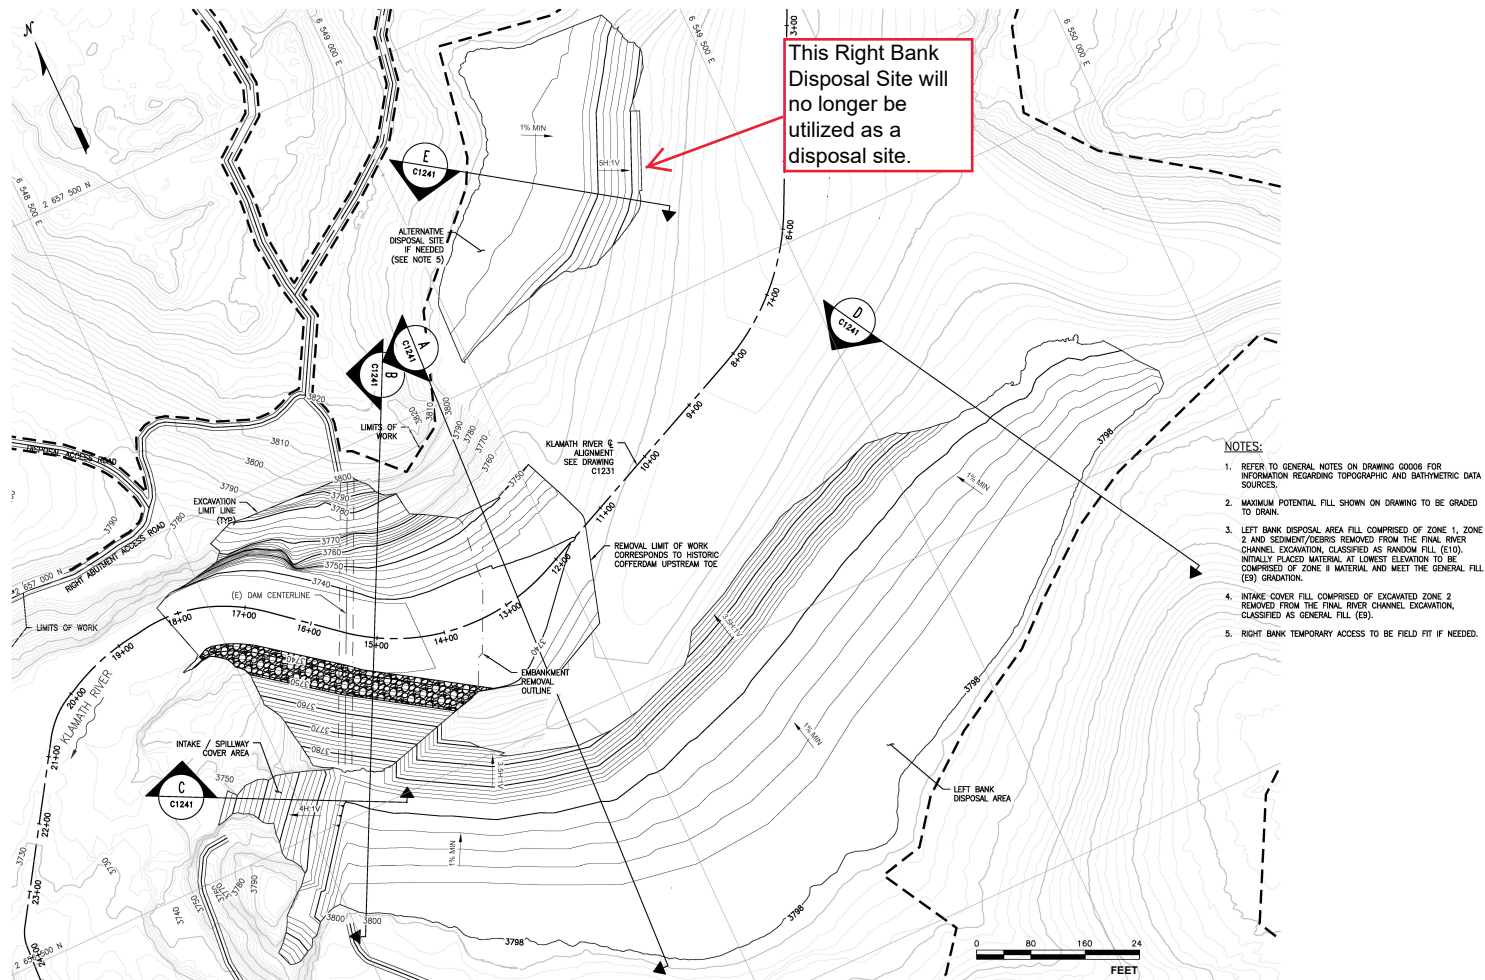

Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites: Knight Piesold 100 design; Access routes: Knight Piesold 100 design.
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

LEGEND:


- LIMITS OF WORK
-  EROSION PROTECTION (E7b)

Lower Klamath Project
Figure A-7: J.C. Boyle Left Bank Disposal Site - Plan




(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

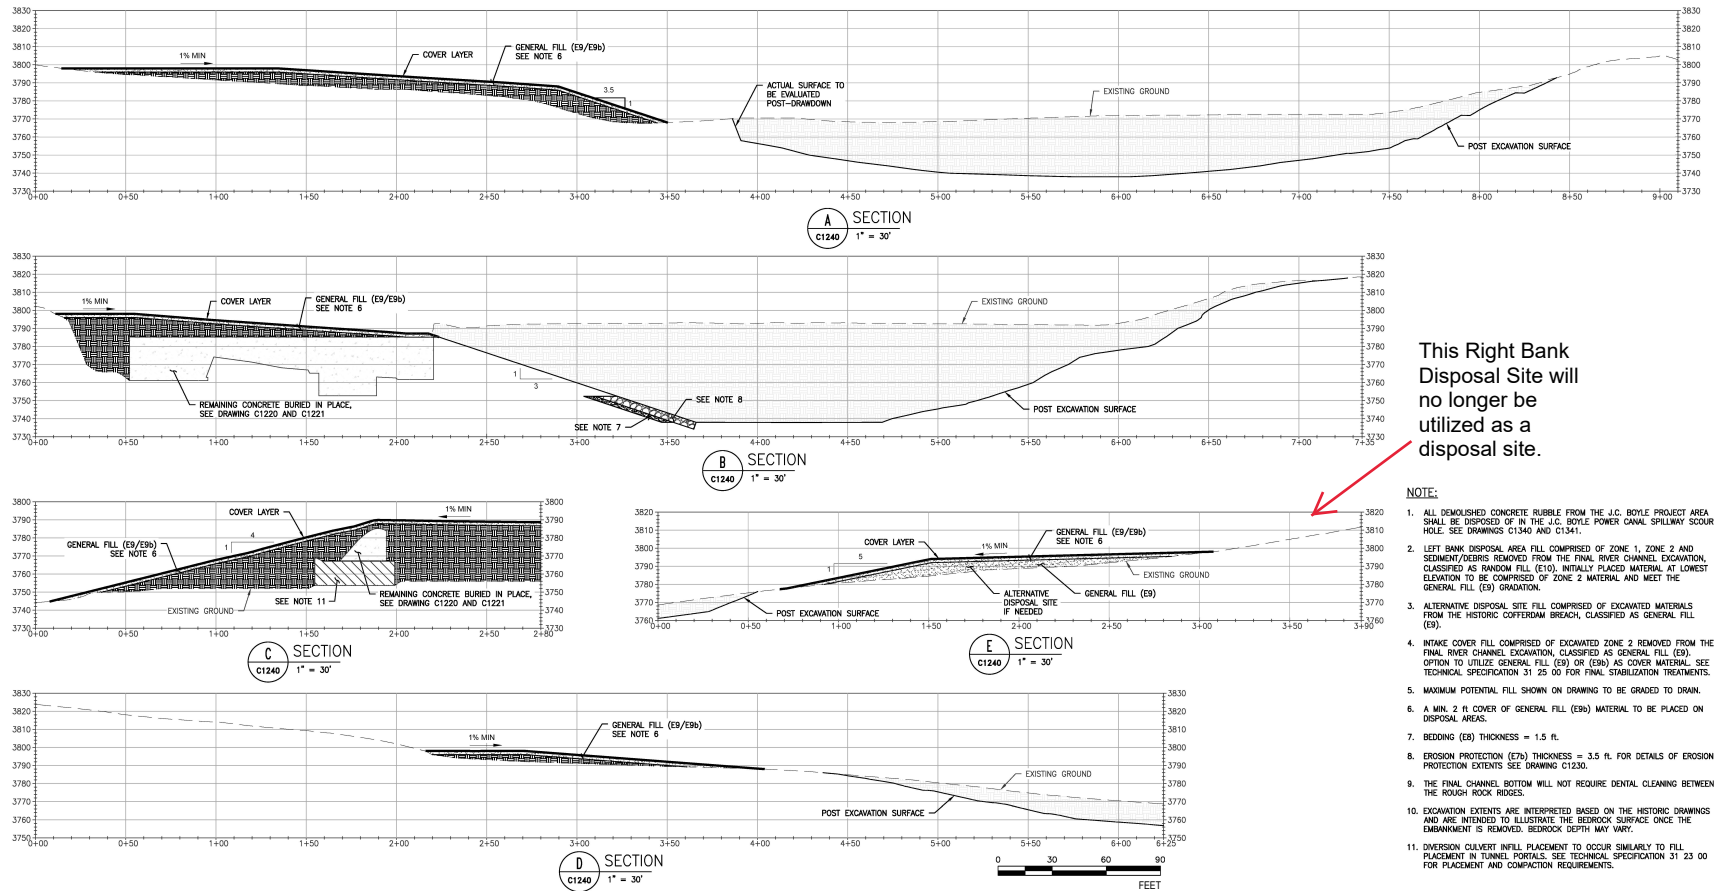

This Right Bank Disposal Site will no longer be utilized as a disposal site.

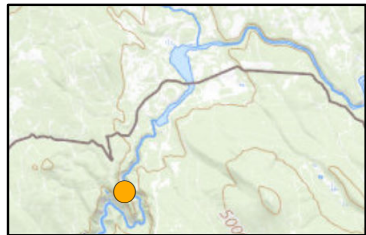

Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites: Knight Piesold 100 design; Access routes: Knight Piesold 100 design.
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

LEGEND:


- (E) EARTHFILL
- BEDDING (E8)
- EROSION PROTECTION (E7b)
- GENERAL FILL (E9/E9b)
- RANDOM FILL (E10)
- VOID INFILL

Lower Klamath Project
Figure A-7: J.C. Boyle Left Bank Disposal Site - Profile



(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

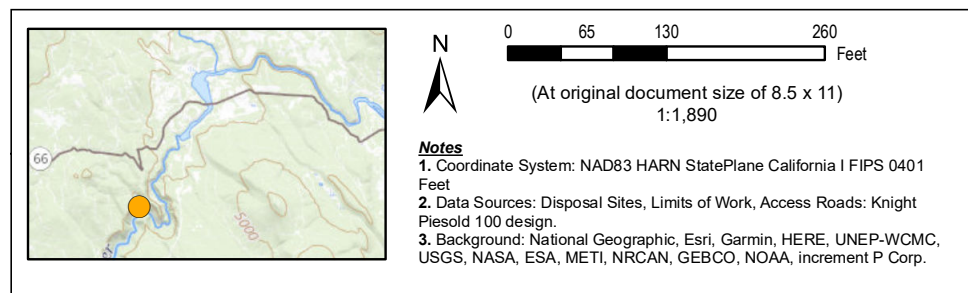

Legend

- Disposal Sites
- Limits of Work
- Roads

Lower Klamath Project
**Figure A-7: J.C. Boyle Disposal Site
 Powerhouse and Tailrace**



**PRELIMINARY DESIGN
 (NOT FOR CONSTRUCTION)**

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

1. REFER TO GENERAL NOTES ON DRAWING G0006 FOR INFORMATION REGARDING TOPOGRAPHIC AND BATHYMETRIC DATA SOURCES.
2. THE INTENT OF THE POWERHOUSE TAILRACE AREA REGRADING, AFTER POWERHOUSE AND ANCILLARY FACILITIES DEMOLITION AND REMOVAL, IS TO FILL THE TAILRACE CHANNEL WITH ADJACENT PAD AREA EXCAVATED ALLUVIAL MATERIALS. THE OBJECTIVE IS TO BALANCE THE CUT AND FILL VOLUMES.
3. COVER REMAINING CONCRETE AND CONCRETE RUBBLE WITH A MINIMUM OF 2 ft AS SHOWN ON DRAWING C1411.
4. PLACE GENERAL FILL (E9b) MATERIAL ON FILL SLOPE. GRANULAR MATERIAL PREVIOUSLY EXCAVATED FROM RIGHT BANK TAILRACE AS SHOWN ON DRAWING C1400.

PLAN

Lower Klamath Project

**Figure A-8a: J.C. Boyle Disposal Site
Powerhouse and Tailrace Plan**



**PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)**

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.







Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites: Knight Piesold 100 design; Access routes: Knight Piesold 100 design.
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

LEGEND:

- LIMITS OF WORK
 [shaded box] ASPHALT

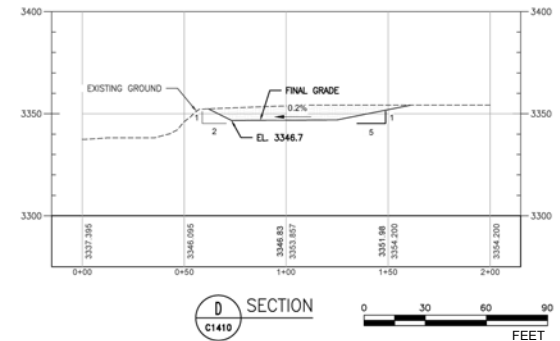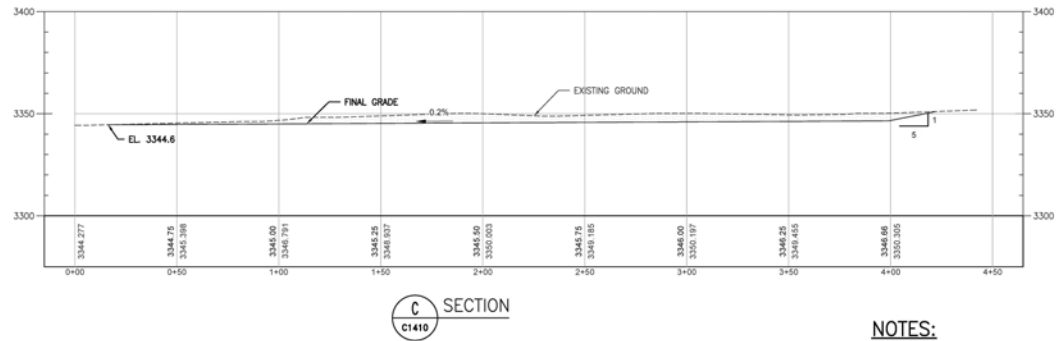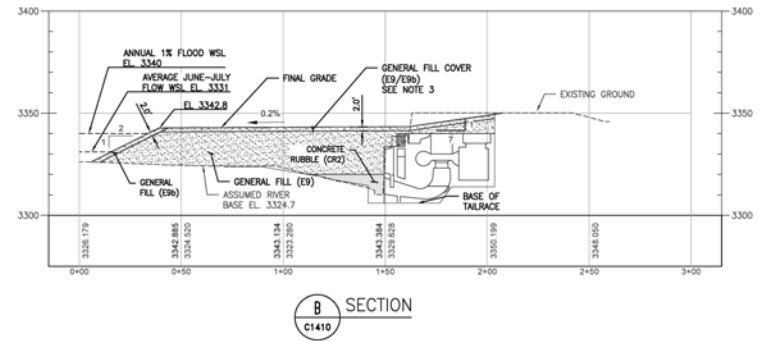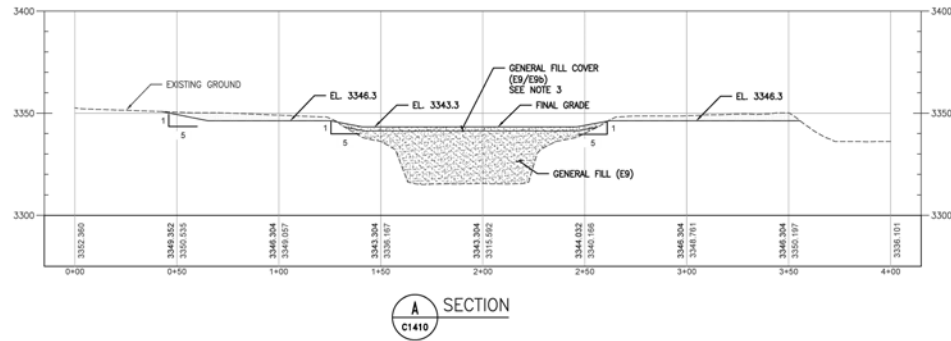

NOTES:

1. THE INTENT OF THE POWERHOUSE TAILRACE AREA REGRAIDING, AFTER POWERHOUSE AND ANCILLARY FACILITIES DEMOLITION AND REMOVAL, IS TO FILL THE TAILRACE CHANNEL WITH ADJACENT PAD AREA EXCAVATE ALLUVIAL MATERIALS. THE OBJECTIVE IS TO BALANCE THE CUT AND FILL VOLUMES.
2. DRAINAGE DETAILS INCLUDED ON DRAWING C1624.
3. OPTION TO UTILIZE GENERAL FILL (E9) OR (E9b) AS COVER MATERIAL. FINAL STABILIZATION TREATMENTS DIFFER AS PER TECHNICAL SPECIFICATION 31 25 00.



Notes

1. Coordinate System: NAD83 HARN StatePlane California I FIPS 0401 Feet
2. Data Sources: Disposal sites: Knight Piesold 100 design; Access routes: Knight Piesold 100 design.
3. Background: National Geographic, Esri, Garmin, HERE, UNEP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, increment P Corp.

LEGEND:

- (E) EARTHFILL
- GENERAL FILL (E9/E9b)
- CONCRETE RUBBLE (CR2)

Lower Klamath Project
Figure A-8b: J.C. Boyle Disposal Site
Powerhouse and Tailrace Profile



PRELIMINARY DESIGN
(NOT FOR CONSTRUCTION)

Disclaimer: This document has been prepared based on information provided by others as cited in the Notes section. McMillen Jacobs Associates has not verified the accuracy and/or completeness of this information and shall not be responsible for any errors or omissions which may be incorporated herein as a result. McMillen Jacobs Associates assumes no responsibility for data supplied in electronic format, and the recipient accepts full responsibility for verifying the accuracy and completeness of the data.

Appendix B

J.C. Boyle Hazardous Waste Survey Report



**ENTEK
CONSULTING GROUP, INC.**

4200 Rocklin Road, Suite 7, Rocklin, CA 95677 Phone (916) 632-6800 Fax (916) 632-6812 www.entekgroup.com

**HAZARDOUS MATERIALS SURVEY
FINAL REPORT**

CLIENT

**NV5
48 Bellarmine Court, Ste. 40
Chico, CA 95928**

CONTACT

**Heidi Cummings, PG, QSD
Senior Geologist**

SURVEY ADDRESS

JC Boyle Development

BUILDINGS SURVEYED

**Multiple Structures at JC Boyle Development
Klamath River Renewal Project**

PREPARED BY

**Andy Roed
CAC #16-5695 & CDPH I/A 29001
Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677**

Entek Project #20-5562

November 4, 2020

TABLE OF CONTENTS

Executive Summary	3
Introduction	4
Building Description	4
Asbestos Inspection and Sample Collection Protocols	7
Asbestos Bulk Sample Results	8
Asbestos Regulatory Requirements	12
Lead Inspection and Sampling	13
Lead Sampling Results	13
Lead Regulatory Compliance	15
Fluorescent Light Tubes and Polychlorinated Biphenyls (PCBs)	15
Thermostats With Mercury Switches	17
Freon and Fluorocarbons	17
Smoke Detectors Which May Contain a Radioactive Element	17
Limitations	17

Appendices

- A. Asbestos Related Documents
- B. Lead Related Documents
- C. Sample Location Maps
- D. Backup Documentation
- E. Historical Documents

Executive Summary

Entek Consulting Group, Inc. (Entek) was contracted to conduct a supplementary investigation for hazardous materials specific to areas at the JC Boyle Development as designated by NV5 and Kiewit Infrastructure West Co. (Kiewit) as part of the Klamath River Renewal Project. Based on documentation provided to Entek, AECOM Technical Services, Inc. (AECOM) conducted a hazardous materials survey in April of 2019. Entek utilized AECOM's survey and the sample results to minimize the number of samples and time required to complete the survey. This report combines AECOM's final report as well as Entek's supplemental sampling into one report. AECOM's report is also attached to this report for your records. The investigation included an assessment of the following:

- Asbestos Materials
- Lead in Paint, Coatings, Ceramic Products and other Construction Components
- Fluorescent Light Tubes
- Light Ballasts
- Polychlorinated Biphenyls (PCB)
- Mercury Containing Thermostats and Switches
- Smoke Detectors with Radioactive Americium 241
- Exit Signs with Radioactive Gas Tritium
- Freon

Entek did not specifically inspect for mercury containing fluorescent light tubes or light ballast which may contain polychlorinated biphenyls (PCBs), thermostats which may contain mercury switches, equipment or systems which may contain Freon or other fluorocarbons, or smoke detectors which may contain a radioactive element. However, information pertaining to these materials is included in this report for your use and reference, since these light systems are present on the project.

The purpose of the inspection was to comply with the US EPA NESHAP requirements and the California Air Resource Board which has jurisdiction for this project site to determine if asbestos containing materials are present which may be impacted during an upcoming demolition project.

The United States Environmental Protection Agency, National Emission Standards for Hazardous Air Pollutants (US EPA NESHAP), 40 CFR Part 61 - Nov. 20, 1990, requires an owner or operator of a demolition or renovation project to thoroughly inspect the affected facility or part of the facility where the demolition or renovation operation will occur for the presence of asbestos-containing materials (ACM) prior to the commencement of that project.

This inspection was requested by Ms. Heidi Cummings, Senior Geologist with NV5. The attached drawings show approximate sample locations. Materials are classified in the tables of this report as Regulated Asbestos Containing Material (RACM), Category I (CAT-I) or Category II (CAT-II) ACM, or Asbestos Containing Construction Material (ACCM). The report must be read in its entirety prior to making any interpretations, or conclusions pertaining to the information. Any conclusions made by the reader about the information provided in the body of this report which are contradictory or not included in

this report are the responsibility of the reader.

Introduction

This report presents results of a supplemental asbestos and lead survey performed by Entek which included the interior and exterior of select structures as outlined in the building descriptions below. These buildings are located at the JC Boyle Development. Fluorescent lights were observed at this project site; therefore, this report also includes references to regulations pertaining to handling practices and waste disposal of PCB light ballasts and mercury containing light tubes and thermostats which may be impacted during this project.

The inspection was conducted by Mr. Andy Roed and Mr. Richard Perrelli on September 17, 2020. Mr. Roed and Mr. Perrelli are Cal/OSHA Certified Asbestos Consultants (CAC) and State of California Department of Public Health (CDPH) certified Lead Inspector/Assessors.

This report was prepared for Ms. Heidi Cummings, Senior Geologist with NV5.

Building Description

The following structures were not accessible by Entek and/or AECOM during either survey. The company in parenthesis was unable to access the structure due to safety or instructed to not enter structure by the building owner.

- Residence 1(Entek)
- Residence 2 (Entek/AECOM)
- Structure above Stop log gates on metal support beams (Entek/AECOM)

Canal Headgate (JCCH)

The Canal Headgate is connected to the Intake Structure by a 14' steel pipeline.

Communication Building (JCCB)

The Communication Building is located south of the dam. It is an approximately 360 square feet paneled building with a slab-on-grade concrete foundation. The exterior siding and roofing consists of pre-fabricated steel. The interior consists of pre-fabricated metal wall siding and unfinished concrete flooring. The building contains a work station, electrical panels and two 32 units battery bank in secondary containment systems.

Emergency Spill Equipment Shed (JCES)

The Emergency Spill Equipment Shed is adjacent to the Powerhouse, is approximately 100 square feet, and is a single-story concrete slab on grade shed with engineered wood siding and asphaltic shingle roofing. The interior of the shed is unfinished wood. The structure is currently being used as storage for emergency spill purposes.

Fire Protection Building (JCFP)

The Fire Protection Building is located east of the diversion dam along the west bank of the reservoir. It is an approximately 600 square foot cinder block building with a slab-on-grade concrete floor and wooden ceiling. The structure houses water piping, compressed air tanks and electrical cabinets. The interior finishes consist of concrete flooring, CMU siding, and exposed metal ceiling.

Fish Ladder (JCFL)

The Fish Ladder is north of the Intake Structure. It is constructed of concrete.

Gate Control Center Building (JCGC)

The Fire Protection Building is located east of the diversion dam along the west bank of the reservoir. It is an approximately 600 square foot cinder block building with a slab-on-grade concrete floor and wooden ceiling. The structure houses water piping, compressed air tanks and electrical cabinets. The interior finishes consist of concrete flooring, CMU siding, and exposed metal ceiling.

Groundwater Pumphouse (JCGWPH)

The Groundwater Pumphouse is a prefabricated shed located southeast of the outdoor storage area. It is approximately 100 square feet. The exterior consists of metal siding and roofing. The interior of the building consists of unfinished wood throughout.

HazMat Shed and Above Ground Storage Tanks (JCHM)

The HazMat Shed and Above Ground Storage Tanks are located about 50 feet east of the Office and Warehouse building. The HazMat Shed is approximately 240 square feet. The HazMat Shed exterior consists of pre-fabricated metal siding with a slab-on-grade concrete foundation. The interior of the storage shed consists of unfinished metal siding and ceiling and unfinished concrete flooring. One each 500 gallon diesel and 1,000 gallon gasoline above ground storage tanks are located adjacent to the Hazardous Material Storage Shed. Both are double walled ASTs and are underneath a permanent “cover” and on top of concrete pads.

Intake Structure (JCIS)

The Intake Structure is located on the western side of the JC Boyle Reservoir. The south end of the structure includes a Fish Screen Building accessed by a wooden bridge. The perimeter of the Fish Screen Building is encircled by a wooden walkway above the reservoir to access metal fish screens. The exterior of the Fish Screen Building consists of corrugated metal siding and roofing. The interior of the Fish Screen Building consists of concrete flooring, walls, and ceiling. The JC Boyle Dam extends north of the Fish Screen Building, including stop log gates, metal grating walkways, electrical panels, and mules. The Fish Ladder extends west on the north end of the dam.

Office and Warehouse (JCOW)

The Office and Warehouse Building is approximately 1,800 square feet with a slab-on-grade concrete foundation. It resembles a “Red Barn” and is located approximately 300 feet west of the dam. The office portion contains a small kitchen with a sink and a restroom with water discharged to a septic tank. The maintenance warehouse portion is a large open area for typical repair and maintenance activities, the storage

maintenance equipment, tools and miscellaneous supplies, and has a side fenced storage area.

Outdoor Storage Area (JCBY)

The Outdoor Storage Area (also referred to as the boneyard) is located south of the Vehicle Storage Shed. Various items are scattered throughout the Outdoor Storage Area, including scrap metal and a decommissioned storage tank.

Penstocks (JCPS)

The Penstocks extend downhill from the surge tank, on the north side of the Powerhouse, and feed the turbines inside the Powerhouse.

Powerhouse (JCPH)

The Powerhouse is approximately 7,000 square feet and is a reinforced concrete structure and contains three levels; above ground, first lower level, and second lower level. The above ground level contains the upper portions of two vertical-shafts and Francis-type turbines contained in their own concrete vaults. A single 150-ton gantry crane was observed over the two turbines. The first lower level contained the lower portions of the turbines that were housed in concrete vaults, electrical panels, tanks, air compressors, oil, water and air piping, a small open office, and a restroom connected to an outdoor septic tank. The second lower level contained the piping, penstock intakes, and sump pumps. Exterior and interior wall, floor, and ceiling finishes consist of concrete and CMU that are primarily painted throughout.

Residence 1 (JCR1)

Residence 1 is approximately 2,000 square feet and is located east of the Vehicle Storage Shed. The building exterior consists of wood siding and asphaltic shingle roofing. The interior of the building contains bedrooms, bathrooms, a kitchen, a living room, and closets. The interior finishes include gypsum walls and ceilings, vinyl floor sheeting, and carpeting.

Residence 2 (JCR2)

Residence 2 is approximately 2,000 square feet and is located east of the Vehicle Storage Shed. The interior of the building was inaccessible during the inspection. The building exterior consists of wood siding and asphaltic shingle roofing.

Spillway Control Center Building (JCSW)

The Spillway Control Center Building is approximately 420 square feet and is located adjacent to the Spillway. The exterior consists of metal siding and roofing. The interior of the building was not accessed during the inspection due to the observable presence of bats.

Substation (JCST)

The Substation is located inside the Switchyard and was not accessed during the inspection due to safety considerations.

Switchyard (JCSW)

The Switchyard is approximately 23,000 square feet, is located west of the Powerhouse, and was not accessed during the inspection due to safety considerations. The Switchyard

contains electrical transformers, substations, transmission poles and lines within a fenced gravel area.

Timber Bridge (JCWB)

The Timber Bridge is approximately 1,600 square feet, and is located near the 14' diversion pipe, at the base of the Headgate.

Vehicle Storage Shed (JCVS)

The Vehicle Storage Shed is located east of the Office/Warehouse building and is approximately 4,400 square feet. The exterior of the building consists of metal siding and corrugated metal roofing. The interior finishes consist of unfinished metal framed walls and ceiling with batt insulation and unfinished concrete flooring.

Warehouse (JCWH)

The Warehouse is approximately 4,800 square feet. The exterior of the building consists of metal siding and corrugated metal roofing. The interior of the building consists of unfinished metal framed walls and ceiling with batt insulation and unfinished concrete flooring.

Asbestos Inspection and Sample Collection Protocols

Entek included all specific designated interior and exterior areas of the buildings included in this report. Entek did not use any demolition methods to look within enclosed wall or ceiling cavities during this investigation. Entek did include all suspect materials observed in, on, or associated with the areas included in this report.

Entek reviewed the report prepared by AECOM prior to and during the site inspection. Materials sampled by AECOM were not resampled as part of this assessment. Only new material or materials which were assumed to contain asbestos by AECOM were sampled where possible.

Bulk samples were collected of various materials suspected to contain asbestos by utilizing a power drill and coring tube, cutting the materials with a razor knife, or use of other appropriate hand tools.

Surfacing materials were collected in a statistically random manner representative of the associated homogenous area as required in 40 CFR Part 763, Asbestos-Containing Materials in Schools; Final Rule and Notice, published October 30, 1987.

Miscellaneous materials were collected from each homogenous area in a manner sufficient to determine whether the material is or is not ACM as required in 40 CFR Part 763, Asbestos-Containing Materials in Schools; Final Rule and Notice, published October 30, 1987.

Approximate locations of all samples collected during this inspection are indicated on the "Bulk Asbestos Material Analysis Request Form for Entek", which served as the chain of custody for the samples, and on the building diagram(s) attached to this report.

Asbestos Bulk Sample Results

There were several materials observed which are considered "suspect" under US EPA guidelines. Under current US EPA guidelines for conducting building inspections for ACM, all "suspect" materials must be assumed to contain asbestos until otherwise determined by laboratory testing.

The samples of materials suspected of containing asbestos were submitted to Asbestech, a laboratory located in Carmichael, California. These samples were subsequently analyzed by polarized light microscopy (PLM) with dispersion staining.

The US EPA NESHAP uses the terms Regulated Asbestos Containing Material (RACM), Category I, and Category II when identifying materials which contain asbestos in amounts greater than 1%. Cal/OSHA uses the term ACCM which indicates a manufactured construction material contains greater than 0.1% asbestos by weight by the PLM method. This definition can be found in Title 8, 1529.

Copies of Asbestech's laboratory reports and accreditations are attached.

Bulk samples were collected of all the materials considered to be "suspect", which had not been previously sampled, and were observed during this investigation. Some of those samples contained multiple layers which were individually analyzed to determine their asbestos content. Analysis of all samples collected was by PLM with dispersion staining. Results of the analysis for materials found to contain asbestos by both AECOM and Entek compiled in the table on the following pages

For all materials tested and found not to contain asbestos by Entek, refer to all laboratory results that are attached. In addition, the report by AECOM provides a list of materials with laboratory results of materials they collected, which include materials found to be positive and negative for asbestos.

Suspect Materials Found or Assumed TO Contain >1% Asbestos					
Sample ID#'s	Suspect Material	Location	NESHAP Category	Asbestos Content/Type (%) by PLM	Total Estimated Quantity
Communications Building (JCCB)					
JCCB-04	Tan Caulking	Base of Interior Wall/Concrete Interface	Cat. II	2% Chrysotile	78 Linear Feet
HazMat Shed and Fuel Shed (JCHM)					
JCHM-01	Asphaltic Concrete Crack Sealant	Asphalt Pad Associated with HazMat Shed and Above Ground Storage Tank	Cat. II	2% Chrysotile	20 Linear Feet
JCHM-03	Off-White Caulking	On Above Ground Storage Tank Casing Pipe Threads and Penetrations	Cat. II	<1% Chrysotile (Confirmed by 1,000 Point Count)	4 Each (Penetrations)
JCHM-06	Off-White Sealant	Ceiling/Roof Seams of HazMat Shed	Cat. II	45% Chrysotile	100 Linear Feet
Office Warehouse (JCOW)					
N/A	Silver Woven Electrical Wire Insulation	Throughout Office and Warehouse	Cat. II	Assumed to Contain Asbestos	Not Quantified
Powerhouse (JCPH)					
N/A	Gaskets	Piping and Mechanical Equipment Throughout Powerhouse	Cat. II	Assumed to Contain Asbestos	Not Quantified
JCPH-08	Gray Door Sealant	Entry into upper level of Powerhouse (Interior and Exterior of Door)	Cat. II	3-6% Chrysotile	32 Linear Feet
N/A	Metal Clad Fire Doors	Doors Throughout Powerhouse	Cat. II	Assumed to Contain Asbestos	5 Each

Suspect Materials Found or Assumed TO Contain >1% Asbestos					
Sample ID#'s	Suspect Material	Location	NESHAP Category	Asbestos Content/Type (%) by PLM	Total Estimated Quantity
N/A	Wicket Gates	Associated with Turbines	Cat. II	Assumed to Contain Asbestos	2 Each
Warehouse (JCWH)					
JCWH-01	Black Asphaltic Slip Sheet with Cementitious Material	Exterior Interface between metal Siding and Concrete Foundation	Cat. II	10-14% Chrysotile	200 Linear Feet
JCWH-05	Tan Brittle Caulking	Metal Seams around roll-up door	Cat. II	4% Chrysotile	330 Square Feet
Residence 1 (JCR2)					
N/A	Ceiling Texture	Ceiling Throughout	N/A	<1% Chrysotile (Confirmed by 1,000 Point Count)	2,000 Square Feet
Residence 2 (JCR2)					
<i>This Structure was not accessible by Entek or AECOM. The materials listed below are provided as an estimate of what materials may be present as requested by the client. It is recommended that a survey of the structure be completed prior to asbestos abatement activities. More or less materials may be actually present.</i>					
N/A	Asphaltic Roofing and Associated Felt Paper	Roof Throughout	Cat. II	Assumed to Contain Asbestos	2,000 Square Feet
N/A	Felt Paper Behind Wood Siding	Siding Throughout	Cat. II	Assumed to Contain Asbestos	1,500 Square Feet
N/A	Drywall And Joint Compound	Interior Walls and Ceiling Throughout	Cat. II	Assumed to Contain Asbestos	4,500 Square Feet
N/A	Wall and Ceiling Texture	Interior Walls and Ceiling Throughout	RACM	Assumed to Contain Asbestos	4,500 Square Feet

Suspect Materials Found or Assumed TO Contain >1% Asbestos					
Sample ID#'s	Suspect Material	Location	NESHAP Category	Asbestos Content/Type (%) by PLM	Total Estimated Quantity
N/A	Vinyl Sheet Flooring and Mastic	Throughout Floor of Structure	Cat. II	Assumed to Contain Asbestos	2,000 Square Feet
Throughout JC Boyle Development					
N/A	Transite Piping	Assumed to be present underground throughout the JC Boyle Development	Cat. II	Assumed To Contain Asbestos	Unable to Quantify

NOTE: Any CAT-I or CAT-II materials identified in the previous tables which will be subjected to mechanical removal, must be considered RACM for the purposes of notification to US EPA Region IX, CARB, or Local AQMD and classification of waste. Removal of any CAT-I or CAT-II materials prior to demolition of a building is dependent upon how the materials will be impacted and if the impact will cause the materials to become friable. If any remaining CAT-I or CAT-II materials will become friable they must be removed prior to the initiation of demolition.

NOTE: Cal/OSHA regulates all materials containing greater than 0.1% asbestos. As a result, impact to materials identified as ACCM and ACM must be performed by properly asbestos trained personnel utilizing appropriate personal protection, work practices, as well as, properly constructed and demarcated work areas or containments, in accordance with Cal/OSHA asbestos regulations.

The tables above provide an estimate of the amount of materials in square feet or linear feet. Contractors are responsible for quantifying the exact quantity of materials impacted by the renovation or demolition and shall not rely on the quantities in the above tables.

US EPA AHERA uses three terms when determining the classification of a material for the purpose of sampling. These terms include miscellaneous, surfacing, and thermal system insulation (TSI).

Miscellaneous materials are building materials on structural components, structural members or fixtures, such as floor and ceiling tiles, and do not include surfacing material or TSI.

Surfacing materials are materials that are sprayed-on, troweled-on, or otherwise applied to surfaces, such as acoustical plaster on ceiling and fireproofing materials on structural members, or other materials on surfaces for acoustical, fireproofing, or other purposes.

TSI is material applied to pipes, fittings, boilers, breeching, tanks, ducts, or other structural components to prevent heat loss or gain, water condensation, or for other purposes.

The information provided in the tables of this report are for use by the Owner in determining where asbestos containing materials are located, and whether or not any future work may impact those materials. The information is also provided for use by any contractor who may perform work in areas impacting the materials listed in this report, and for use as appropriate by asbestos abatement contractors to provide costs related to work impacting ACM.

Any building materials which are considered “suspect” for containing asbestos which have not been identified in this report must be assumed to contain asbestos in amounts >1% until properly investigated and/or tested.

Materials commonly excluded from being suspected for containing asbestos include, but are not limited to: unwrapped pink and yellow fiberglass insulating materials or products, foam insulation, wood, metal, plastic, or glass. All other types of building materials or coatings on the materials listed above are commonly listed as “suspect” and must be tested prior to impact by a Contractor. Work impacting these untested or newly discovered materials must cease until an investigation can be completed.

Asbestos Regulatory Requirements

US EPA

A demolition is the wrecking, taking out, or burning of any load supporting structural member. A renovation is everything else. 10 day written notification to the US EPA Region IX, CARB or local AQMD is required prior to the performance of any demolition project regardless of asbestos being present or not. This notification would also apply to any renovation project which involves the wrecking, taking out, or burning of any load bearing structural member during a renovation as well.

There is a sufficient amount of ACM present to require a 10 day notification to the US EPA Region IX, CARB or local AQMD be submitted prior to starting work which will impact

materials identified as RACM or CAT-I and CAT-II materials if they are made friable. If more than 160 square feet, 260 linear feet or 35 cubic feet of RACM is planned for removal on the project, formal written notification to US EPA Region IX, CARB or local AQMD is required.

Oregon OSHA

Disturbance of any ACM or ACCM could generate airborne asbestos fibers and would be regulated by Oregon OSHA. Oregon OSHA worker health and safety regulations apply during any disturbance of ACM or ACCM by a person while in the employ of another. This is true regardless of friability or quantity disturbed. The contractor shall comply with all Oregon OSHA regulations and notification requirements prior to the disturbance of the material.

Lead Inspection and Sampling

An X-ray fluorescence (XRF) Spectrum Analyzer was used during the lead inspection portion of this survey as a screening tool in determining if lead is present in quantities which would require existing paints and/or coatings to be classified as Lead-Based Paint (LBP).

In XRF spectroscopy, the process begins by exposing the sample in question to a source of x-rays or gamma rays. As these high energy photons strike the sample, they tend to knock electrons out of their orbits around the nuclei of the atoms that make up the sample. When this occurs, an electron from an outer orbit, or “shell”, of the atom will fall into the shell of the missing electron. Since outer shell electrons are more energetic than inner shell electrons, the relocated electron has an excess of energy that is expended as an XRF photon. This fluorescence is unique to the composition of the sample. The detector collects this spectrum and converts them to electrical impulses that are proportional to the energies of the various x-rays in the sample’s spectrum. Since each element has a different and identifiable x-ray signature, we can look at specific parts of the emitted spectrum, and by counting the pulses in the sector, determine the presence and concentration of the element(s) in question within the sample. Entek used a Niton XRF spectrum analyzer which is specific to measuring only lead in the building substrate.

Lead Sampling Results

XRF Spectrum Analyzer testing indicated lead was present in concentrations $>1.0 \text{ mg/cm}^2$ on various building components. XRF direct reading technology is not capable of determining lead concentrations below 1.0 mg/cm^2 . The limit of detection for this device with a 95% confidence level is 1.0 mg/cm^2 . As a result, any reading provided by the XRF technology does not provide adequate information to determine the actual content of lead in the paint/coating being tested. Any XRF reading less than 1.0 mg/cm^2 (including readings of 0.00) only indicate lead is not present at levels high enough to classify the paint/coating as LBP. Coatings or materials which resulted in a lead concentration of below 1.0 mg/cm^2 were then sampled and analyzed by atomic absorption spectrometry (AAS) for lead content. Results of the XRF analysis and laboratory analysis are included in the tables below. Coating which reported concentrations below the laboratories detection limit are included in the laboratory results attached to this report.

Paints/Coatings/ Materials Determined to Contain Lead			
Paint/Coating Color or Material	Lead Content	Component/Location	LBP/LCP
Canal Headgate (JCCH)			
Tan/Silver/orange Paint	350,000 ppm	Diversion Piping	LBP
Communications Building (JCCB)			
Tan Paint	140 ppm	Exterior Metal Trim	LCP
Fire Protection Building (JCFP)			
Red Paint	56 ppm	Metal Piping Throughout Structure	LCP
HazMat Shed (JCHM)			
Tan Paint	290,000 ppm	Throughout Exterior Siding of Small Shed Next To HazMat Storage Shed	LBP
Silver/Orange Paint	220,000 ppm	Roof of Small Shed Next To HazMat Storage Shed	LBP
Red Paint	560 ppm	Interior Structural Steel of HazMat Shed	LCP
Intake Structure (JCIS)			
Gray Paint on Brown Paint	19,000 ppm	Metal Handrails on Fish Ladder bridge	LBP
Tan Paint	490 ppm	Throughout exterior metal siding of reservoir level gauge house	LCP
Gray Paint	740 ppm	Exterior Underhang of Fish Screen House	LCP
White Paint	120 ppm	Concrete Interior Walls of Fish Screen Building	LCP
Green/Silver Paint	12,000 ppm	Interior Piping of Fish Screen Building	LBP
Gray Paint	68 ppm	Metal Interior Mechanical Fish Screen Building on Traveling Water Screens	LCP
Silver/Orange Paint	57,000 ppm	Metal Intake Structure Supports	LBP
Silver Paint	74,000 ppm	Metal Screen on Exterior of Fish Screen Building	LBP
Outdoor Storage Area (JCBY)			
Silver Paint	15,000 ppm	Out of Commission tank in Outdoor Storage Area	LBP
Penstock (JCPS)			
Tan on Orange Paint	97,000 ppm	Metal Penstock Piping	LBP
Powerhouse (JCPH)			
White Paint	680 ppm	CMU Walls Throughout	LCP
Gray Paint	180 ppm	Concrete Floor of Powerhouse	LCP
White Paint	360 ppm	Concrete Walls of Powerhouse	LCP
Orange Paint	100,000 ppm	Handrails throughout Powerhouse	LBP
Silver Paint	21,000 ppm	Exterior Track on top of powerhouse	LBP
Silver Paint	3.6 mg/cm ²	Metal Crane Structure	LBP

Paints/Coatings/ Materials Determined to Contain Lead			
Paint/Coating Color or Material	Lead Content	Component/Location	LBP/LCP
Spillway (JCSW)			
Beige Paint	2,200	Concrete Spillway Canal Walls	LCP
Vehicle Storage Shed (JCVS)			
Yellow Paint	150 ppm	Concrete Bollards	LCP
Warehouse (JCWH)			
Red Paint	15,000 ppm	Metal Interior Structural Support Beams	LBP

LBP - Materials/coatings/paints meeting the definition of lead-based paint as defined by the CDPH and the US EPA, currently defined as containing lead in concentrations equal to or greater than 1.0 mg/cm², 5,000 ppm, or 0.5% by weight.

LCP - Materials/coatings/paints which contain measurable amounts of lead. The disturbance of these materials/coatings/paints is regulated by Cal/OSHA.

Lead Regulatory Compliance

Any upcoming project which may result in the disturbance of lead containing products or surfaces, but is not intended to remediate a lead hazard or specifically designed to remove LBP to reduce or eliminate a known hazard, would be considered “lead related construction work”.

Lead related construction work means any “construction, alteration, painting, demolition, salvage, renovation, repair, or maintenance of any residential or public building, including preparation and cleanup that, by using or disturbing lead-containing material or soil, may result in significant exposure of adults or children to lead”.

Currently, Oregon OSHA has not established a definition for LBP, nor have they established minimum concentrations where their regulations do not apply. Oregon OSHA regulates all construction activities involving materials containing lead, including LBP.

Oregon OSHA has not established a concentration of lead in a product where their regulations do not apply, therefore, any disturbance to products containing lead come under the jurisdiction of Oregon OSHA and their regulations. Disturbance of paints/coatings or materials determined to be LBP may trigger a pre-work notification to Oregon OSHA if “trigger tasks” disturb 100 square feet or more of those paints/coatings or materials.

Fluorescent Light Tubes and Polychlorinated Biphenyls (PCBs)

Fluorescent light tubes which contain mercury are considered a universal waste and must be packaged and recycled appropriately if they are removed from a building and not used again. The regulation, called the Universal Waste Rule, is in the California Code of Regulations (CCR), Title 22, Division 4.5, Chapter 23.

Fluorescent light tubes are the bulb or tube portion of an electric lighting device and are

commonly referred to as “lamps”. Examples of other common electric lamps considered to be universal wastes include, but are not limited to, high intensity discharge, neon, mercury vapor, high pressure sodium, and metal halide lamps. Any lamp which is not spent and has been designated to be reused is not classified as a waste and does not meet the requirements of a hazardous waste or a universal waste.

Spent lamps typically contain concentrations of mercury exceeding the established Total Threshold Limit Concentration (TTLC) and/or the Soluble Threshold Limit Concentration (STLC) values. Therefore, these lamps must be sent to an authorized recycle facility or to a universal waste consolidator for shipment to an authorized recycling facility.

At a minimum, if removed lamps will not be reused they must be packaged in boxes/packages/containers which are structurally sound, adequate to prevent breakage, and compatible with the content of the lamps. These packages must remain closed and be free of damage which could cause leakage under reasonably foreseeable conditions. Each container must be labeled or marked clearly with one of the following phrases: “Universal Waste Lamp(s),” or “Waste Lamp(s),” or “Used Lamp(s).” Entek recommends shipping any lamp not designated for reuse to a universal waste recycling facility once they have been packaged.

PCB containing light ballasts are considered a hazardous waste, and must be properly manifested for transport to a hazardous waste facility. Any contractor who may perform PCB related work (inspection, removal, clean-up) must be trained and qualified to do so. All workers must also follow current OSHA regulations including 29 CFR 1910.120 and 8 CCR 5192, as well as, other applicable federal, state, and local laws, and regulations. While light ballasts marked “No PCB” are not considered a hazardous waste, they are considered a universal waste. As a result, removal, packaging, and disposal/recycling of these types of ballasts must be conducted in accordance with current regulations of Title 22.

Entek and AECOM made an effort to assist in quantifying select materials throughout the structure. The below quantities are estimates based on observations during the assessment. It shall be the contractor responsibility to verify the total quantities present.

Universal Waste Inventory	
Other Regulated Building Material Description	Approximate Quantity
Mercury-Containing fluorescent light tubes (4' length)	68
Mercury-Containing fluorescent light tubes (6' length)	10
Mercury-Containing fluorescent light tubes (8' length)	8
Magnetic light ballasts	50
HID Lamps	39
Mercury-containing switches, controls, and recorders	None Observed

PCB Caulking Results		
Material Description	Material Location	Sample Results (mg/kg)
Flexible Gray Expansion Joint Sealant	Powerhouse Roof at Expansion Joints	<0.82

Thermostats with Mercury Switches

It is possible existing thermostats may utilize switches containing mercury. The mercury in these switches would be considered a hazardous waste if removed and disposed. Any work requiring removal of thermostats containing mercury switches, must include having the switches inspected for the presence of mercury, and subsequently following all requirements for packaging and disposal of any switch found to contain mercury.

Freon and Fluorocarbons

Freon and other fluorocarbon products associated with HVAC systems, refrigerators, etc. may be present in or on the exterior of the buildings included in this investigation. Prior to demolition of a structure or removal of existing HVAC systems, refrigerators, or any other type of equipment which typically uses these types of coolant products shall have the coolant materials investigated prior to their demolition and removed from the mechanical systems and recycled in accordance with EPA requirements.

Smoke Detectors Which May Contain a Radioactive Element

It is possible existing smoke detectors may contain a radioactive element. These types of detectors are easily identified by reviewing the label which is usually found on the back of the detector. Older units may display the international radiation symbol (three bladed propeller) and the radioactive content. Newer units state the radioactive content and their Nuclear Regulatory Agency (NRC) license number.

Any work requiring the removal of smoke detectors with a radioactive element must include contacting the manufacturer of the smoke detector to determine their return policies.

Limitations

Entek inspected only the specific designated areas identified by the Owner to be included in the upcoming project. Select structures as outlined in the building description portion of this report were not assessed due to either safety concerns or at the request of the building owner. As a result the information provided in this inspection report may not be used to extend the inspection results to areas not included in this report without additional review and sampling as necessary.

Entek did not perform any destructive sampling to look into ceiling and wall cavities. As a result, it may be possible for materials to be hidden in these areas which are not included in this report. Entek also did not employ any destructive measures on floors of interior spaces or exterior areas covered with asphalt, concrete, or dirt.



If any new materials not listed as having been sampled, or listed as assumed for containing asbestos in this report are discovered, the new material must be assumed to contain asbestos until properly inspected and tested for asbestos content.

Entek's policy is to retain a full copy of these written documents for three (3) years once the file is closed. At the end of the 3 year period the written files will be destroyed without further notice. It is suggested copies of the file(s) are maintained as per your policy.

Entek will be providing only this electronic copy of the report and its attachments for your use. However, if you would like a hard copy of this report please do not hesitate to ask. Entek will be happy to mail the report upon receipt of your request.

Thank you for choosing Entek for your environmental needs. Please call me at (916) 632-6800 if you have any questions regarding this report.

Prepared by: Andy Roed
Andy Roed, CIH, CSP, CAC
President
Cal/OSHA CAC #16-5695
CDPH I/A Certification #29001

Appendices

- A. Asbestos Related Documents
- B. Lead Related Documents
- C. Sample Location Maps
- D. Backup Documentation
- E. Historical Documents

APPENDIX A

ASBESTOS RELATED DOCUMENTS

- Bulk Asbestos Analysis Report From Asbestech
- Bulk Asbestos Material Analysis Request Form for Entek

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67972

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCWH-01A	Gray concrete stem wall near door	NONE DETECTED	Granular Mins.
02A	Gray concrete foundation of bldg.	NONE DETECTED	Granular Mins.

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67978

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCVS-01A	Black asphalt sealant, perimeter of vehicle shed	NONE DETECTED	Tar Binder Calcite
02A	Gray concrete , foundation of bldg.	NONE DETECTED	Granular Mins.
03A	White caulking, base of roll-up doors	NONE DETECTED	Synthetics

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67977

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCPS-01A	Gray concrete on overflow spillway	NONE DETECTED	Granular Mins.
02A	Black rubber gasket on concrete overflow spillway near canal headgate	NONE DETECTED	Rubber
03A	Black rubber gasket at penstock piping	NONE DETECTED	Calcite Opaques
04A	Gray concrete at base of metal supports for penstock	NONE DETECTED	Granular Mins.
05A	Gray concrete on support structure of penstock	NONE DETECTED	Granular Mins.

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67976

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCPH-01A	Black asphaltic roofing, emergency spill shed	NONE DETECTED	Tar Binder Fibrous Glass
02A	Gray concrete, foundation of emergency spill shed	NONE DETECTED	Granular Mins.
03A	Black vibration cloth on crane tracks	NONE DETECTED	Opagues
04A	Black asphaltic roofing, pump house roof near powerhouse	NONE DETECTED	Tar Binder Fibrous Glass
	Black felt paper	NONE DETECTED	Tar Binder Cellulose

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67973

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCOW-01A	Gray concrete foundation	NONE DETECTED	Granular Mins.
	Black asphaltic sealant	NONE DETECTED	Tar Binder
02A	Gray brittle caulking at base of metal siding	NONE DETECTED	Granular Mins.
03A	Black asphalt, parking area	NONE DETECTED	Granular Mins. Tar Binder

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROviso THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67974

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCIS-01A	Red gasket on piping of intake structure	NONE DETECTED	Calcite Cellulose
02A	Green gasket on piping of intake structure	NONE DETECTED	Granular Mins. Cellulose

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67980

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCHM-01A	Gray concrete , foundation of fuel tank	NONE DETECTED	Granular Mins.
02A	Gray concrete , foundation of hazmat storage shed	NONE DETECTED	Granular Mins.
03A	Black asphalt road near hazmat shed	NONE DETECTED	Granular Mins. Tar Binder

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67971

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCHG-01A	Gray CMU, canal headgate exterior	NONE DETECTED	Granular Mins.
	Gray grout	NONE DETECTED	Granular Mins.
02A	Gray CMU, canal headgate exterior	NONE DETECTED	Granular Mins.
	Gray grout	NONE DETECTED	Granular Mins.
03A	Gray CMU, canal headgate exterior	NONE DETECTED	Granular Mins.
	Gray grout	NONE DETECTED	Granular Mins.

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67989
Date/Time Collected: 9/22/20
Date Received: 10/16/20

NVLAP Lab Code 101442-0
CDPH # 1153
Date Analyzed: 10/17/20

<u>Sample No.</u>	<u>Color/Description</u>	<u>% Type Asbestos</u>	<u>Other Materials</u>
ECG-20-5562-JCGWPH-01A	Gray concrete foundation of groundwater pump house	NONE DETECTED	Granular Mins.

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67981

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCFP-			
01A	Gray CMU, exterior of structure	NONE DETECTED	Granular Mins.
	Gray grout	NONE DETECTED	Granular Mins.
02A	Gray concrete , foundation of structure	NONE DETECTED	Granular Mins.
03A	Gray concrete patch , pipe penetration	NONE DETECTED	Granular Mins.
04A	Gray concrete block for anchoring near water	NONE DETECTED	Granular Mins.
05A	Green foam insulation , pipe penetration	NONE DETECTED	Synthetics
06A	Red gaskets , pipe connections in bldg.	NONE DETECTED	Calcite Opagues
07A	Black gaskets , pipe connections in bldg.	NONE DETECTED	Rubber Synthetics

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67979

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCFL- 01A	Gray concrete , fish ladder wall	NONE DETECTED	Granular Mins.
02A	Gray concrete , fish ladder	NONE DETECTED	Granular Mins.
	Brown felt	NONE DETECTED	Cellulose

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, California 95608
Tel.(916) 481-8902 asbestech@sbcglobal.net

Client:

Entek Consulting Group, Inc.
4200 Rocklin Rd., Suite 7
Rocklin, CA 95677

Job:

20-5562 NV5
JC Boyle

BULK ASBESTOS ANALYSIS REPORT

LAB JOB # 67975

Date/Time Collected: 9/22/20

Date Received: 10/16/20

NVLAP Lab Code 101442-0

CDPH # 1153

Date Analyzed: 10/17/20

<i>Sample No.</i>	<i>Color/Description</i>	<i>% Type Asbestos</i>	<i>Other Materials</i>
ECG-20-5562-JCCB-01A	Gray concrete, foundation of bldg.	NONE DETECTED	Granular Mins.
02A	Gray paper fibrous material at seams of metal siding	NONE DETECTED	Calcite Opaques
03A	Clear sealant, bolt hole penetrations	NONE DETECTED	Synthetics

THE ANALYSIS USES POLARIZED LIGHT MICROSCOPY AND DISPERSION STAINING FOLLOWING E.P.A. METHOD 600/R-93/116. NON-FRIABLE MATERIALS WERE ANALYZED APPLYING THE SAME METHOD. THE LOWER DETECTION LIMIT IS <1 % WITH THE PROVISIO THAT PLM MAY NOT DETECT FIBERS <0.25 MICRONS IN DIAMETER THAT MAY BE PRESENT IN SAMPLES SUCH AS FLOOR TILES. IN ACCORDANCE WITH TITLE 22, CCR, SECTION 66261.24(a)(2)(A), THE MCL IS 1 %. SAMPLES WERE NOT COLLECTED BY ASBESTECH. THIS REPORT MUST NOT BE REPRODUCED EXCEPT IN FULL WITHOUT THE APPROVAL OF ASBESTECH. THIS REPORT RELATES ONLY TO THE ITEMS TESTED. THIS REPORT MUST NOT BE USED TO CLAIM PRODUCT ENDORSEMENT BY N.V.L.A.P. OR ANY AGENCY OF THE U.S. GOVERNMENT. ASBESTECH ACCEPTS TECHNICAL RESPONSIBILITY FOR THIS REPORT AND DATE OF ISSUE.



67972

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCWH-01A	Concrete / Stem Wall Near Door
ECG-20-5562-JCWH-02A	Concrete / Foundation of Building


C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JC\COCs\JCWH\Bulk Request
10-14-2020.wpd

Delivered by: 

Date: 10/14/20 **Time:** 4 AM/PM

Received by: 

Date: 10/16/20 **Time:** 9 AM/PM



BULK ASBESTOS MATERIAL *Analysis Request*

67978

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 /20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCVS-01A	Black Asphalt Sealant / Perimeter of Vehicle Shed
ECG-20-5562-JCVS-02A	Concrete / Foundation of Building
ECG-20-5562-JCVS-03A	White Caulking / Base of Roll-up Doors

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JC\B\COCs\JCVS\Bulk Request
10-14-2020.wpd

Delivered by: 

Date: 10 / 14 / 20 **Time:** 4 AM/PM

Received by: 

Date: 10 / 16 / 20 **Time:** 9 AM/PM



67977

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCPS-01A	Concrete on Overflow Spillway
ECG-20-5562-JCPS-02A	Black Runbber Gasket on Concrete Overflow Spillway near canal headgate
ECG-20-5562-JCPS-03A	Red Rubber gasket at Penstock piping
ECG-20-5562-JCPS-04A	Concrete at Base of metal Supports for Penstock
ECG-20-5562-JCPS-05A	Concrete on Support Structure of Penstock

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JCBI\COCS\JCPS\Bulk Request
10-14-2020.wpd

Delivered by: 

Date: 10 / 14 / 20 **Time:** 4 **AM/PM** PM

Received by: 

Date: 10 / 16 / 20 **Time:** 9 **AM/PM** AM



67976

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm


ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCPH-01A	Asphaltic Roofing / Emergency Spill Shed
ECG-20-5562-JCPH-02A	Concrete / Foundation of Emergency Spill Shed
ECG-20-5562-JCPH-03A	Black Vibration Cloth on Crane Tracks
ECG-20-5562-JCPH-04A	Black Asphaltic Roofing with Felt Paper / Pump House Roof Near Powerhouse


C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JCBI\COCs\JCPH Bulk Request
10-14-2020.wpd

Delivered by: 

Date: 10 / 14 / 20 **Time:** 4 AM/PM

Received by: 

Date: 10 / 16 / 20 **Time:** 9 AM/PM



67973

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCOW-01A	Concrete Foundation with Asphaltic Sealant
ECG-20-5562-JCOW-02A	Gray Brittle Caulking at Base of Metal Siding
ECG-20-5562-JCOW-03A	Asphalt / Parking Area

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JC\COCs\JCOWBulk Request 10-14-2020.wpd

Delivered by: [Signature] **Date:** 10/14/20 **Time:** 4 **AM/PM** (M)

Received by: [Signature] **Date:** 10/16/20 **Time:** 9 **AM/PM** (M)



67974

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 /20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining


Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCIS-01A	Red Gasket on Piping of Intake Structure
ECG-20-5562-JCIS-02A	Green Gasket on Piping of Intake Structure

C:\Users\seibert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JC\JCOCs\JCIS\Bulk Request 10-14-2020.wpd

Delivered by:  **Date:** 10/14/20 **Time:** 4 AM/PM

Received by:  **Date:** 10/16/20 **Time:** 9 AM/PM



67980

BULK ASBESTOS MATERIAL Analysis Request

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm


ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.


Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCHM-01A	Concrete / Foundation of Fuel Tank
ECG-20-5562-JCHM-02A	Concrete / Foundation of Hazmat Storage Shed
ECG-20-5562-JCHM-03A	Asphalt / Road Base Near Hazmat Shed

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JCBI\COCs\JCHM\Bulk Request 10-14-2020.wpd

Delivered by:  Date: 10 / 14 / 20 Time: 4 AM/PM

Received by:  Date: 10 / 16 / 20 Time: 9 AM/PM



67971

BULK ASBESTOS MATERIAL Analysis Request

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCHG-01A	CMU and Grout / Canal Headgate Exterior
ECG-20-5562-JCHG-02A	CMU and Grout / Canal Headgate Exterior
ECG-20-5562-JCHG-03A	CMU and Grout / Canal Headgate Exterior

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JCBI\COCs\JCHG\Bulk Request 10-14-2020.wpd

Delivered by: 

Date: 10 / 14 / 20 **Time:** 4 AM/PM

Received by: 

Date: 10 / 16 / 20 **Time:** 9 AM/PM



679809

BULK ASBESTOS MATERIAL Analysis Request

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCGWPH-01A	Concrete Foundation of Groundwater Pump House

C:\Users\seibert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JC\COCs\JCGWPH\Bulk Request 10-14-2020.wpd

Delivered by: 

Date: 10 / 14 / 20 Time: 4 AM/PM

Received by: 

Date: 10 / 16 / 20 Time: 9 AM/PM



67981

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCFP-01A	CMU and Grout / Exterior of Structure
ECG-20-5562-JCFP-02A	Concrete / Foundation of Structure
ECG-20-5562-JCFP-03A	Concrete Patch / Pipe Penetration
ECG-20-5562-JCFP-04A	Concrete / Block for Anchoring Near Water
ECG-20-5562-JCFP-05A	Green Foam Insulation / Pipe Penetration
ECG-20-5562-JCFP-06A	Red Gaskets / Pipe Connections in Building
ECG-20-5562-JCFP-07A	Black Gaskets / Pipe Connections in Building

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JCBI\COCs\JCFP\Bulk Request
10-14-2020.wpd

Delivered by: 

Date: 10/14/20 **Time:** 4 **AM/PM** PM

Received by: 

Date: 10/16/20 **Time:** 9 **AM/PM** AM



67979

BULK ASBESTOS MATERIAL Analysis Request

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JC ^{FL} CB-01A	Concrete / Fish Ladder Wall
ECG-20-5562-JC ^{FL} CB-02A	Concrete / Fish Ladder

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JC\COCs\JCFL\Bulk Request 10-14-2020.wpd

Delivered by: 

Date: 10 / 14 / 20 Time: 4 AM/PM

Received by: 

Date: 10 / 16 / 20 Time: 9 AM/PM



67975

BULK ASBESTOS MATERIAL *Analysis Request*

ENTEK CONSULTING GROUP, INC.

4200 ROCKLIN ROAD, SUITE 7
ROCKLIN, CA 95677
(916) 632-6800 PHONE
(916) 632-6812 FAX
mainoffice@entekgroup.com

Date of Sampling: 09-22-2020

Job Number: 20-5562

Client Name: NV5

Site Address: JC Boyle

Lab: Asbestech

Collected by: Andy Roed

Turnaround Time: Day: Tuesday
Date: 10 / 20 / 20 Time: 5 pm

ANALYSIS REQUESTED: Asbestos by PLM
with Dispersion Staining

Special Instruction: *Stop Analysis upon first positive result (>1%) for sample in a series. Also stop analysis upon first positive result (>1%) in the joint compound for sample series.*

Please e-mail results at mainoffice@entekgroup.com as soon as available and include copy of submittal with those results.

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCCB-01A	Concrete / Foundation Of Building
ECG-20-5562-JCCB-02A	Gray Paper/Fibrous Material / At Seams of Metal Siding
ECG-20-5562-JCCB-03A	Sealant / Bolt Hole Penetrations

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JCB\COCs\JCCB\Bulk Request
10-14-2020.wpd

Delivered by:  **Date:** 10 / 14 / 20 **Time:** 4 AM PM

Received by:  **Date:** 10 / 16 / 20 **Time:** 9 AM PM

APPENDIX B

LEAD RELATED DOCUMENTS

- Lead in Paint Samples Analysis Report From EMLAB
- Bulk Lead Material Analysis Request Form for Entek
- XRF Data




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562, NV5; JC Boyle
EML ID: 2505172

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-20-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Eurofins EMLab P&K

17461 Derian Ave, Suite 100, Irvine, CA 92614
(866) 888-6653 Fax (623) 780-7695 www.emlab.com

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562, NV5; JC Boyle

Date of Sampling: 09-22-2020
Date of Receipt: 10-19-2020
Date of Report: 10-26-2020

LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY

Location:	ECG-20-5562-JCPH-01Pb: Gray Paint on Exterior Wooding Siding of Spill Shed	ECG-20-5562-JCPH-02Pb: Brown Paint on Exterior Wooding Siding of Pump House
Comments (see below)	None	None
Lab ID-Version‡:	11935353-1	11935354-1
Analysis Date:	10/20/2020	10/20/2020
Sample type	Paint Chip sample	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	65 ppm	96 ppm
Sample size	0.1531 grams	0.1045 grams
§ Total Lead Result	< 65 ppm	< 96 ppm

Comments:

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562, NV5; JC Boyle
EML ID: 2502976

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-15-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562, NV5; JC Boyle

Date of Sampling: 09-22-2020
Date of Receipt: 10-15-2020
Date of Report: 10-22-2020

LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY

Location:	ECG-20-5562-JCHM-01Pb: Red Paint on Bollard
Comments (see below)	None
Lab ID-Version‡:	11924887-1
Analysis Date:	10/15/2020
Sample type	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	120 ppm
Sample size	0.0844 grams
§ Total Lead Result	370 ppm

Comments:

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562, NV5; JC Boyle
EML ID: 2502978

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-16-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Eurofins EMLab P&K

17461 Derian Ave, Suite 100, Irvine, CA 92614
(866) 888-6653 Fax (623) 780-7695 www.emlab.com

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562, NV5; JC Boyle

Date of Sampling: 09-22-2020
Date of Receipt: 10-15-2020
Date of Report: 10-22-2020

LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY

Location:	ECG-20-5562-JCHG-01Pb: Gray Paint on Concrete Flooring of Canal Head Gate Building	ECG-20-5562-JCHG-02Pb: White Paint on Wood Walls of Canal Head Gate Building
Comments (see below)	None	None
Lab ID-Version‡:	11924898-1	11924899-1
Analysis Date:	10/16/2020	10/16/2020
Sample type	Paint Chip sample	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	300 ppm	71 ppm
Sample size	0.0330 grams	0.1407 grams
§ Total Lead Result	< 300 ppm	< 71 ppm

Comments:

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562, NV5; JC Boyle
EML ID: 2502974

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-15-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562, NV5; JC BoyleDate of Sampling: 09-22-2020
Date of Receipt: 10-15-2020
Date of Report: 10-22-2020**LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY**

Location:	ECG-20-5562-JCGWPH-01Pb: Red Paint on Wood Door
Comments (see below)	None
Lab ID-Version‡:	11924869-1
Analysis Date:	10/15/2020
Sample type	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	92 ppm
Sample size	0.1090 grams
§ Total Lead Result	< 92 ppm

Comments:

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".




Report for:

Andy Roed
Entek Consulting Group
4200 Rocklin Road, Suite 7
Rocklin, CA 95677

Regarding: Project: 20-5562; JC Boyle
EML ID: 2502977

Approved by:

Dates of Analysis:
Lead - Flame AA: 10-16-2020



Technical Manager
Andrew Ikeda

Service SOPs: Lead - Flame AA (EM-BC-S-8443)
AIHA-LAP, LLC accredited service, Lab ID #178697

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. Due to the nature of the analyses performed, field blank correction of results is not applied. The results relate only to the samples as received. Sample size, as it relates to Wipe samples only, is supplied by the client.

Eurofins EMLab P&K ("the Company") shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Eurofins EMLab P&K's LabServe® reporting system includes automated fail-safes to ensure that all AIHA-LAP, LLC quality requirements are met and notifications are added to reports when any quality steps remain pending.

Client: Entek Consulting Group
C/O: Andy Roed
Re: 20-5562; JC BoyleDate of Sampling: 09-22-2020
Date of Receipt: 10-15-2020
Date of Report: 10-22-2020**LEAD: FLAME ATOMIC ABSORPTION SPECTROMETRY**

Location:	ECG-20-5662-JCCB-01Pb: Black on Metal Chase for Cables
Comments (see below)	A
Lab ID-Version‡:	11924888-1
Analysis Date:	10/16/2020
Sample type	Paint Chip sample
Method*	NIOSH 7082 & EPA 7000B modified
† Method Reporting Limit	1400 ppm
Sample size	0.0074 grams
§ Total Lead Result	< 1400 ppm

Comments: A) Sample weight is below method requirements and was analyzed at client request.

Sample results have not been corrected for blank values.

Bulk samples are not covered under the AIHA-LAP, LLC service accreditation.

Wipe samples must meet ASTM E1792 criteria. Method Reporting Limits may not be valid for non-ASTM E1792 wipe samples.

*Sample preparation and analytical methods are based upon NIOSH 7082 and EPA 7000B.

† The Method Reporting Limit is the minimum concentration of Lead that the laboratory can confidently detect in the sample.

§ Total Lead Result has been rounded to two significant figures to reflect analytical precision.

‡ A "Version" indicated by -"x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".



002505172

BULK LEAD MATERIAL *Analysis Request***ENTEK CONSULTING GROUP, INC.**

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com**Date of Sampling:** 9-22-2020**Lab:** Emlab P & K - Irvine**Job Number:** 20-5562**Collected by:** Andy Roed**Client Name:** NV5**Turnaround Time:** Standard**Site Address:** JC Boyle**ANALYSIS REQUESTED:** Lead by Flame Atomic
Absorption Spectroscopy**Special Instruction:** *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCPH-01Pb	Gray Paint on Exterior Wooding Siding of Spill Shed
ECG-20-5562-JCPH-02Pb	Brown Paint on Exterior Wooding Siding of Pump House

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dam\Field Documents\UCB\COCs\JCPH\Bulk Request Pb
10-14-2020.wpd

Delivered by:**Date:**

10-16-20

10/14/20

Time:

11:36am

4 AM/PM

Received by:**Date:**

10/19/2020

Time:

9:36 AM/PM



002502976

BULK LEAD MATERIAL *Analysis Request***ENTEK CONSULTING GROUP, INC.**

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com**Date of Sampling:** 9-22-2020**Lab:** Emlab P & K - Irvine**Job Number:** 20-5562**Collected by:** Andy Roed**Client Name:** NV5**Turnaround Time:** Standard**Site Address:** JC Boyle**ANALYSIS REQUESTED:** Lead by Flame Atomic
Absorption Spectroscopy**Special Instruction:** *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCHM-01Pb	Red Paint on Bollard

C:\Users\salbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JCBI\COCS\JCHM\Bulk Request Pb
10-14-2020 wpd

Delivered by: **Date:** 10/14/20 **Time:** 4 AM/PM**Received by:** **Date:** 10/15/2020 **Time:** 9:54 AM/PM



002502978

BULK LEAD MATERIAL *Analysis Request***ENTEK CONSULTING GROUP, INC.**

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com**Date of Sampling:** 9-22-2020**Lab:** Emlab P & K - Irvine**Job Number:** 20-5562**Collected by:** Andy Roed**Client Name:** NV5**Turnaround Time:** Standard**Site Address:** JC Boyle**ANALYSIS REQUESTED:** Lead by Flame Atomic
Absorption Spectroscopy**Special Instruction:** *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCHG-01Pb	Gray Paint on Concrete Flooring of Canal Head Gate Building
ECG-20-5562-JCHG-02Pb	White Paint on Wood Walls of Canal Head Gate Building

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\JCBI\COCs\JCHG\Bulk Request Pb
10-14-2020.wpd

Delivered by: **Date:** 10/14/20**Time:** 4

AM/PM

Received by: **Date:** 10/15/2020**Time:** 9:54

AM/PM



002502974

BULK LEAD MATERIAL *Analysis Request***ENTEK CONSULTING GROUP, INC.**

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com**Date of Sampling:** 9-22-2020**Lab:** Emlab P & K - Irvine**Job Number:** 20-5562**Collected by:** Andy Roed**Client Name:** NV5**Turnaround Time:** Standard**Site Address:** JC Boyle**ANALYSIS REQUESTED:** Lead by Flame Atomic
Absorption Spectroscopy**Special Instruction:** *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCGWPH-01Pb	Red Paint on Wood Door

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\UCB\COCs\JCGWPH\Bulk Request Pb
10-14-2020 wpd

Delivered by: **Date:** 10/14/20 **Time:** 4 AM/PM**Received by:** **Date:** 10/15/2020 **Time:** 9:54 AM/PM



002502977

BULK LEAD MATERIAL *Analysis Request***ENTEK CONSULTING GROUP, INC.**

4200 ROCKLIN ROAD, SUITE 7

ROCKLIN, CA 95677

(916) 632-6800 PHONE

(916) 632-6812 FAX

mainoffice@entekgroup.com**Date of Sampling:** 9-22-2020**Lab:** Emlab P & K - Irvine**Job Number:** 20-5562**Collected by:** Andy Roed**Client Name:** NV5**Turnaround Time:** Standard**Site Address:** JC Boyle**ANALYSIS REQUESTED:** Lead by Flame Atomic
Absorption Spectroscopy**Special Instruction:** *Please report result in PPM and % by weight. Please email results as soon as possible.*

SAMPLE #	MATERIAL DESCRIPTION/LOCATION
ECG-20-5562-JCCB-01Pb	Black on Metal Chase for Cables

C:\Users\selbert\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Field Documents\UCB\COCs\UCCBIBulk Request Pb
10-14-2020.wpd

Delivered by:**Date:**

10/14/20

Time:

4

AM/PM

Received by:**Date:**

10/15/2020

Time:

9:54

AM/PM

Lead Testing Data Sheet (OSHA)

Iron Gate Development

Entek Project # 20-5562

Niton: XLp-300A Lead Analyzer

Date: 9-22, 2020

Address: JC Boyle Development

XRF Serial No.: 24015

Source No.: TR3580

Room Equivalent: JC Boyle Development

Inspector(s): Andy Roed

Component	Substrate	Color	Test Locations	XRF Reading (mg/cm ²)
Cable Chase	Metal	Black	Communications Building - Metal Chase for Cabels	0.0
Door	Wood	Red	Ground Water Pump House	0.1
Floor	Concrete	Gray	Canal Head Gate Building	0.0
Wall	Wood	White	Canal Head Gate Building Interior	0.0
Siding	Wood	Gray	Spill Shed - Wood Siding	0.0
Siding	Wood	Brown	Pump House Exterior Siding	0.0

C:\Users\andy\Entek Consulting Group, Inc\Entekgroup - Documents\Clients\NV5\20-5562 Klamath Dams\Reports\JC Boyle\Lead Test Data Sheet\OSHA.wpd

All XRF Readings ≥ 1.0 mg/cm² = Lead Based Paint (LBP)All XRF Readings < 1.0 mg/cm² = Lead Containing Coating (LCC)

Calibration Check Test Results

Klamath River Dams

Site Name: JC Boyle Development Date: 9-22-2020
City: Hornbrook, CA
Device: Niton Xlp 300 Source Assay Date: 12-1-19
XRF Serial No. 24015 Source Number: TR3580
Contractor: Entek Consulting Group, Inc.
Inspector Name: Andy Roed
Inspector Signature: _____

Calibration Check Tolerance Used <u>1.04 ±0.06</u>			
First Calibration Check <u>0800</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
1.0	1.0	0.9	

Second Calibration Check <u>1700</u> hours			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	Yes
1.0	1.1	1.0	

Third Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

Fourth Calibration Check <u>N/A</u>			
Red SRM (2573) 0.8 to 1.2 mg/cm ²			Do All Three Checks Meet the Standard?
First Reading	Second Reading	Third Reading	N/A
N/A	N/A	N/A	

* If the Calibration Check from the red SRM film value is greater or less than the specified Calibration Check Tolerance for this device, consult the manufacturer's recommendations to bring the instrument back into control. Retest all testing combinations tested since the last successful Calibration Check test.


APPENDIX C

Sample Location Maps

- Asbestos and Lead Sample Location Diagrams

AECOM Sample Locations

Entek Sample Locations

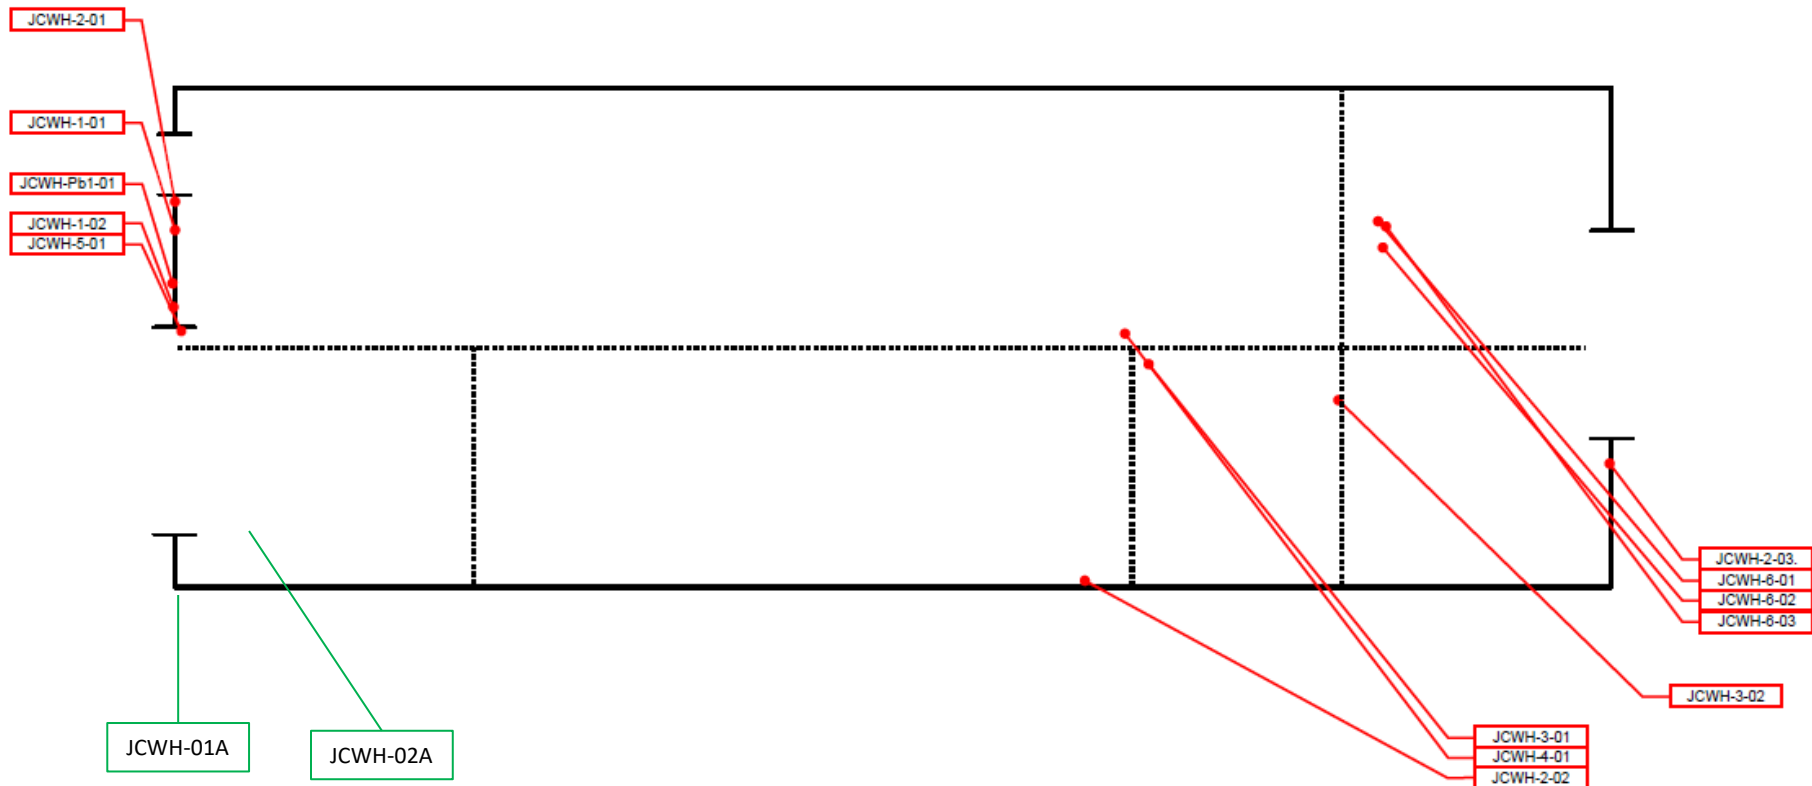

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

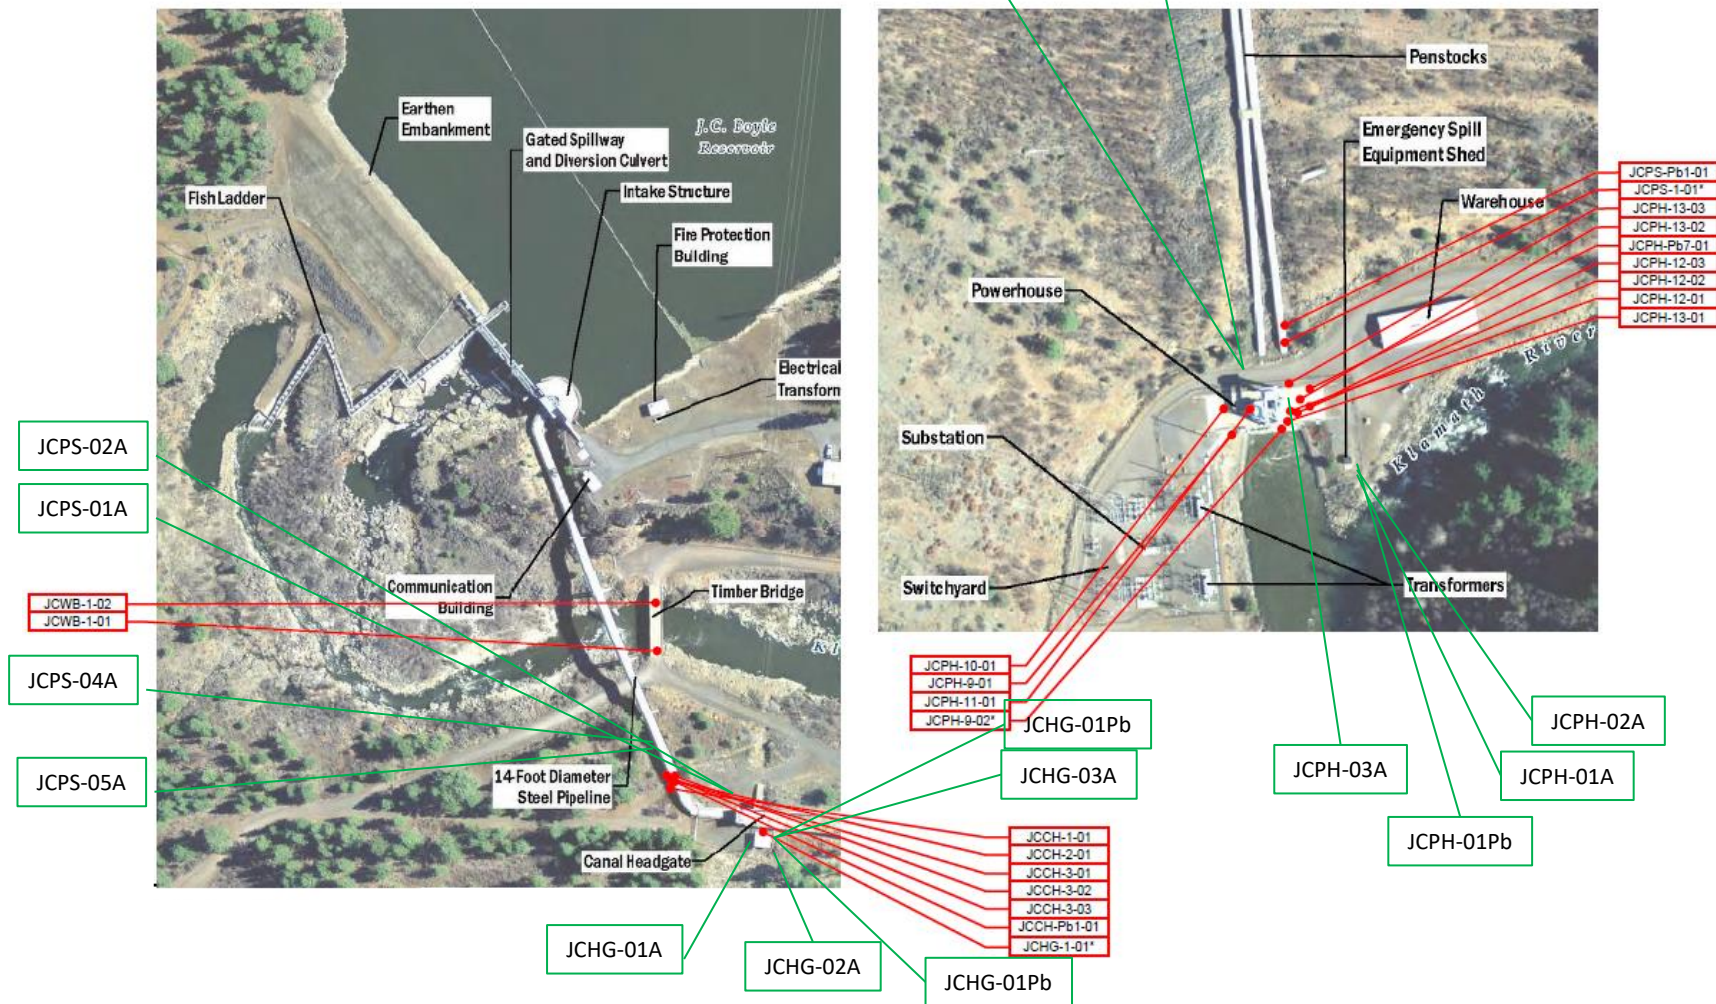


NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

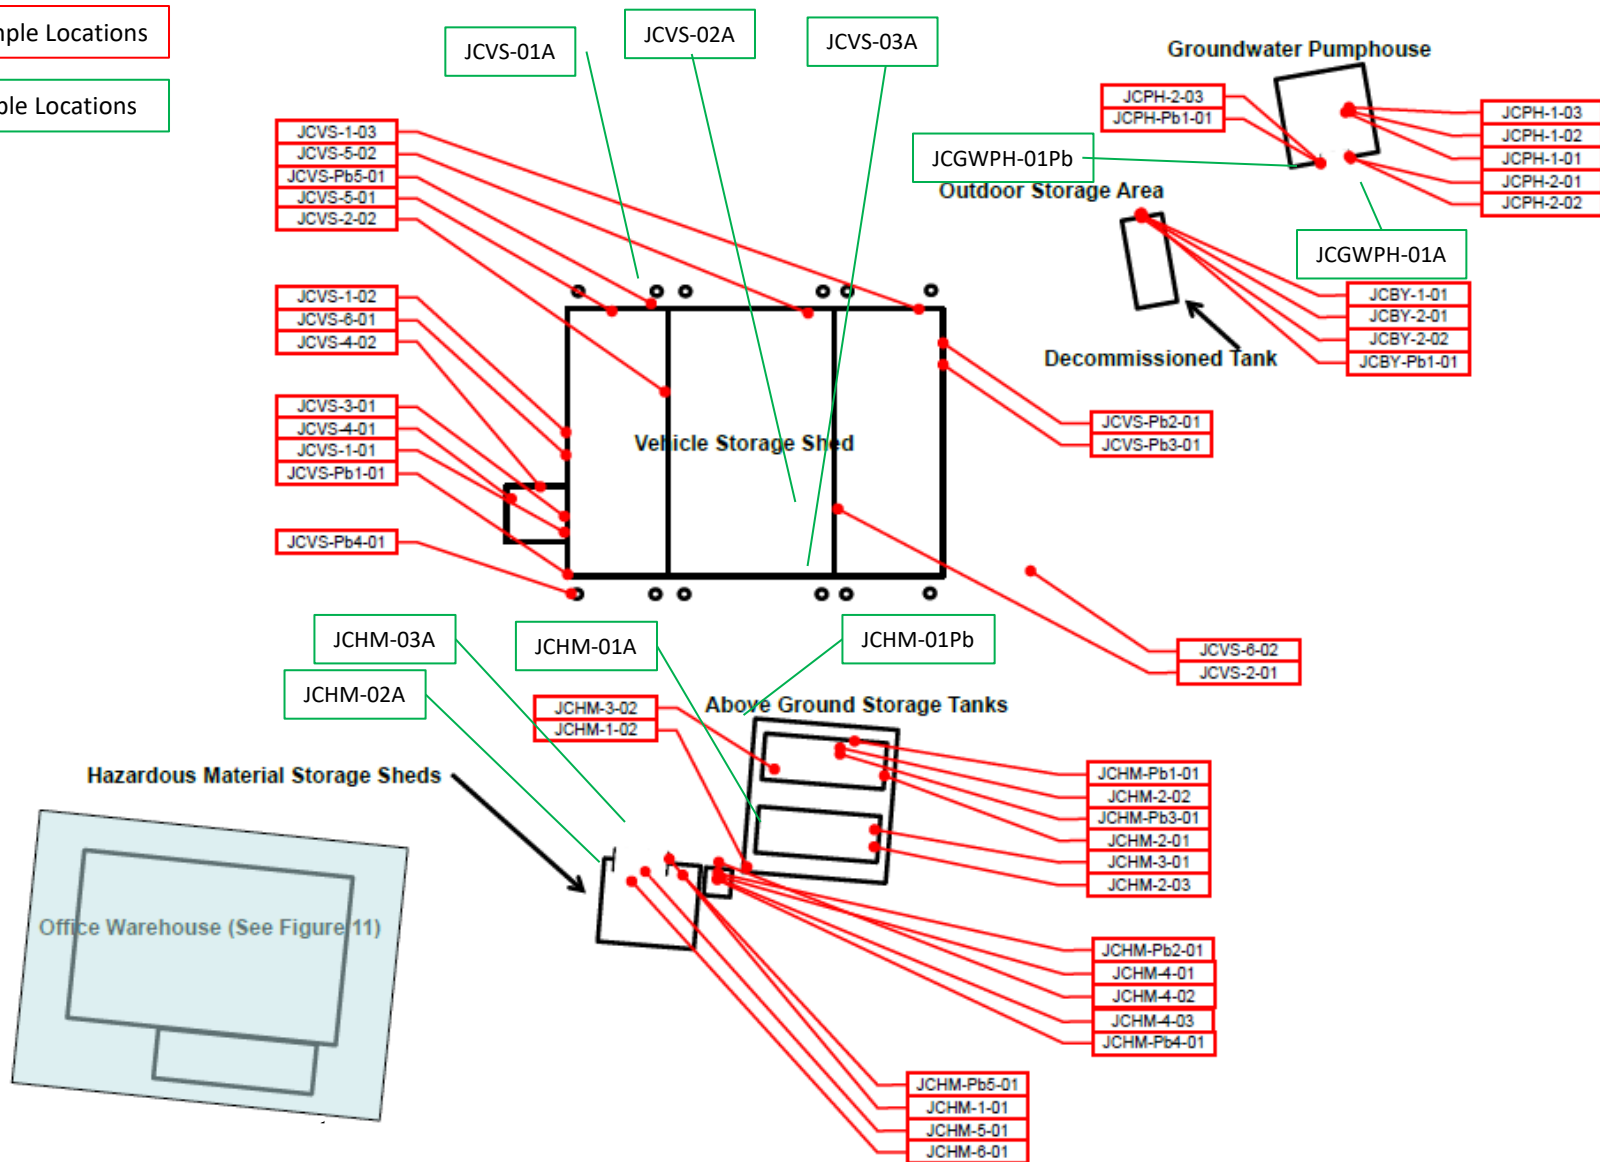


NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

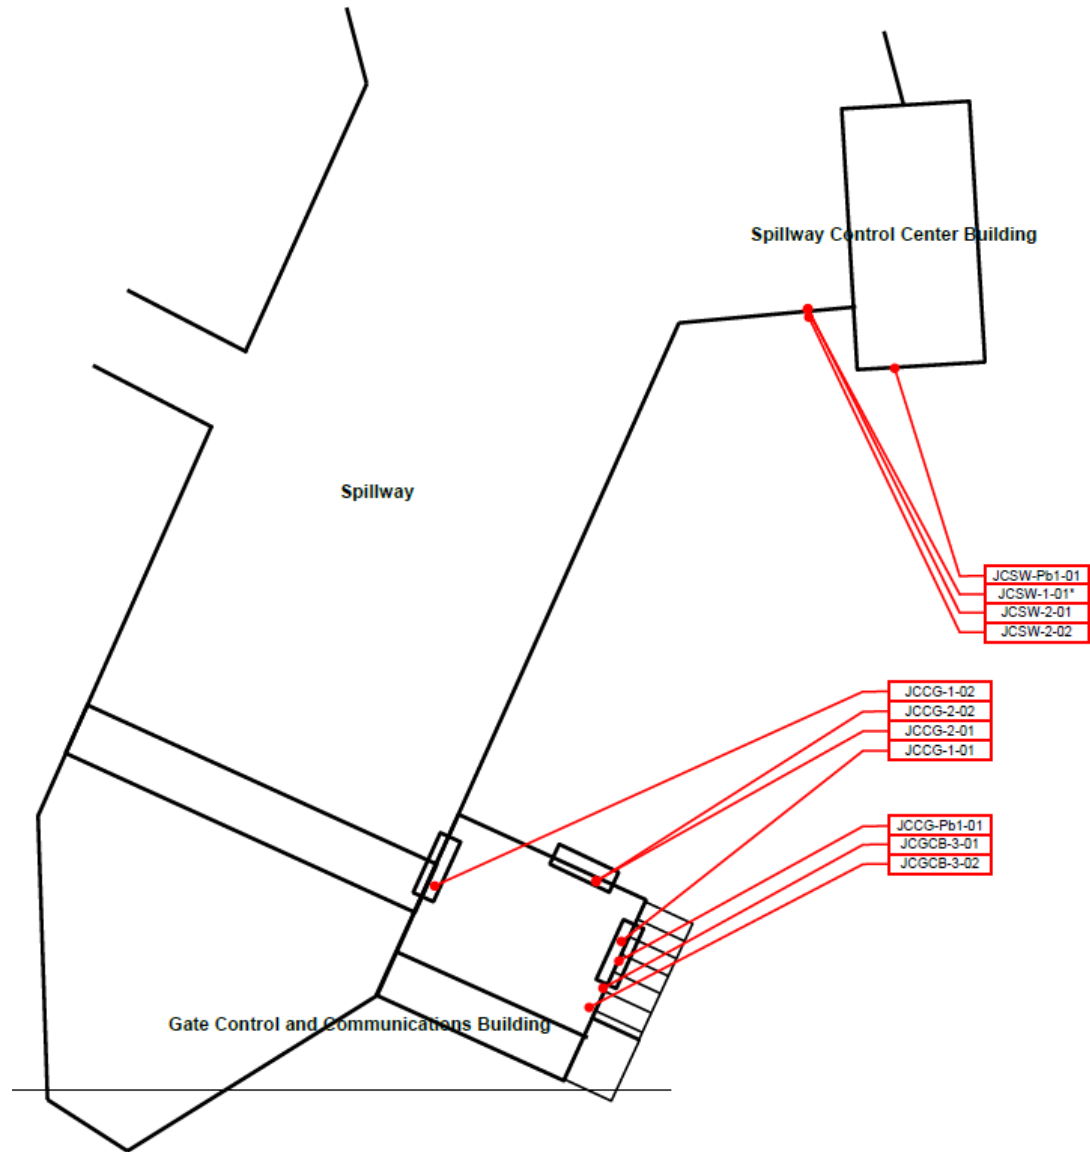

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

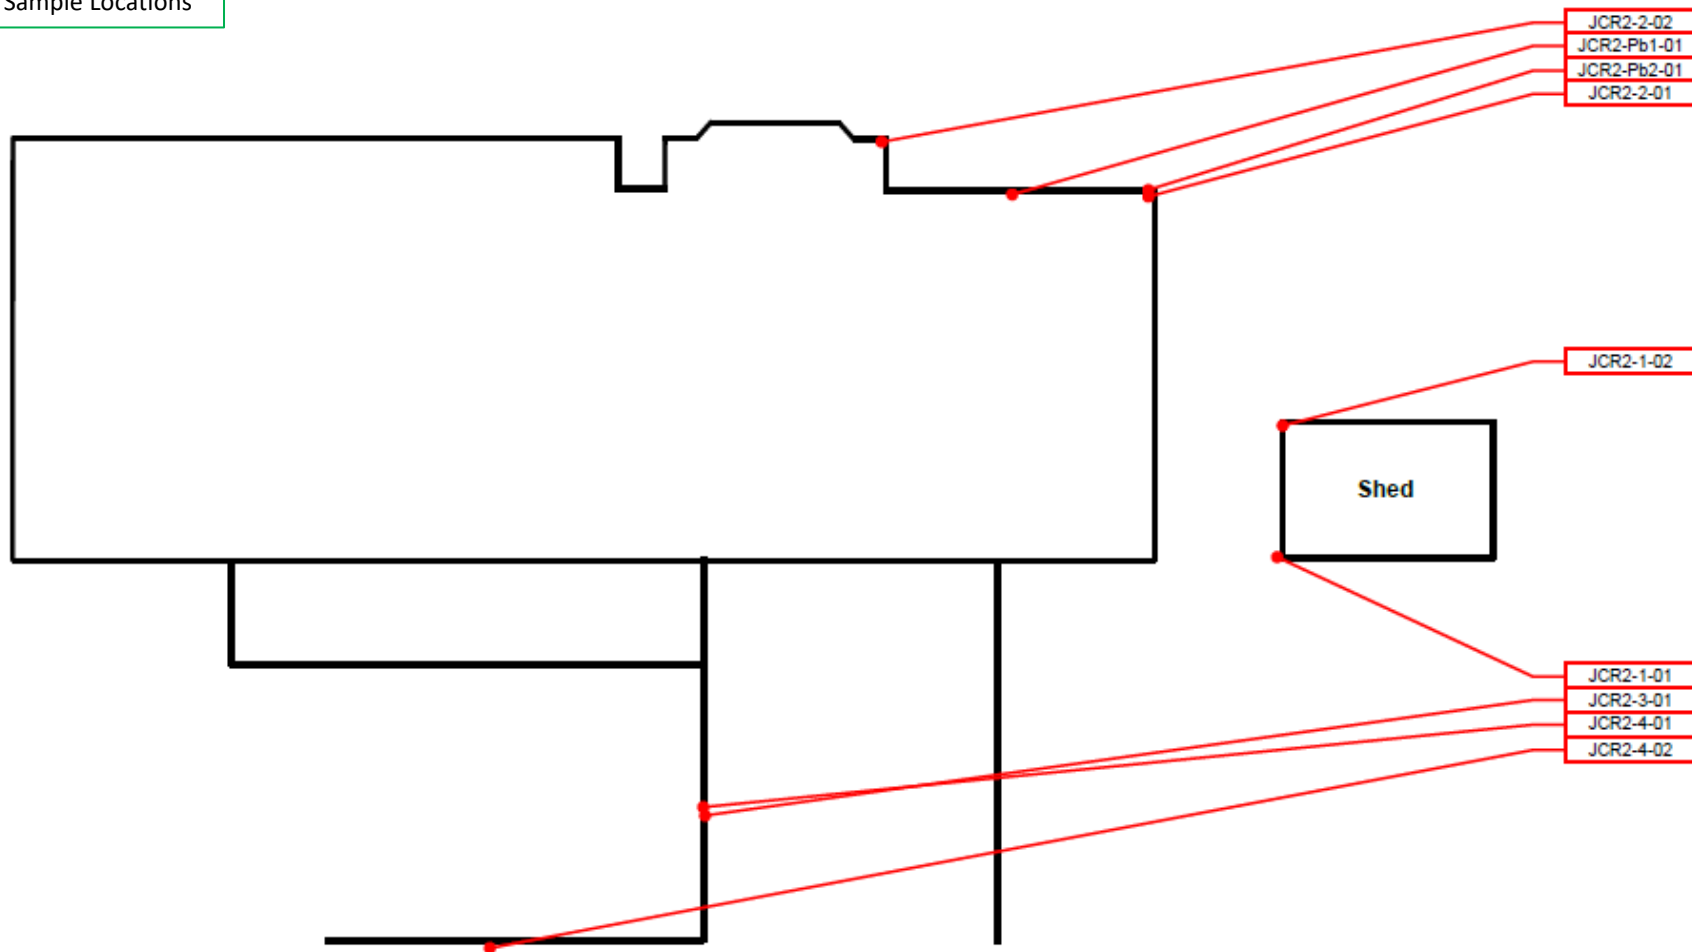

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

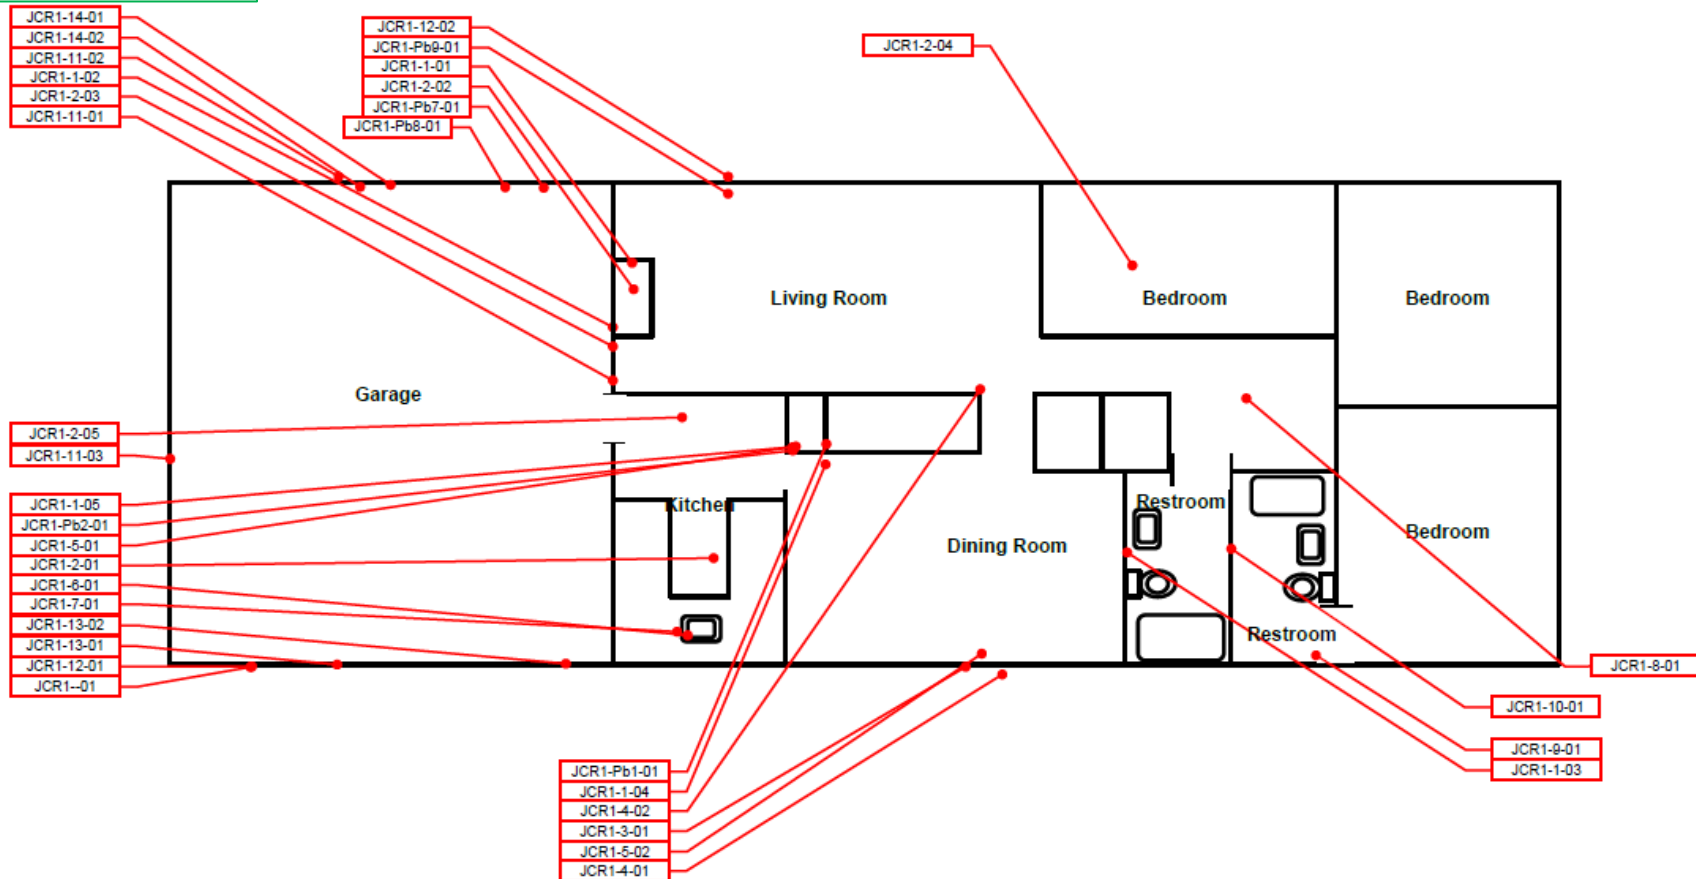

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

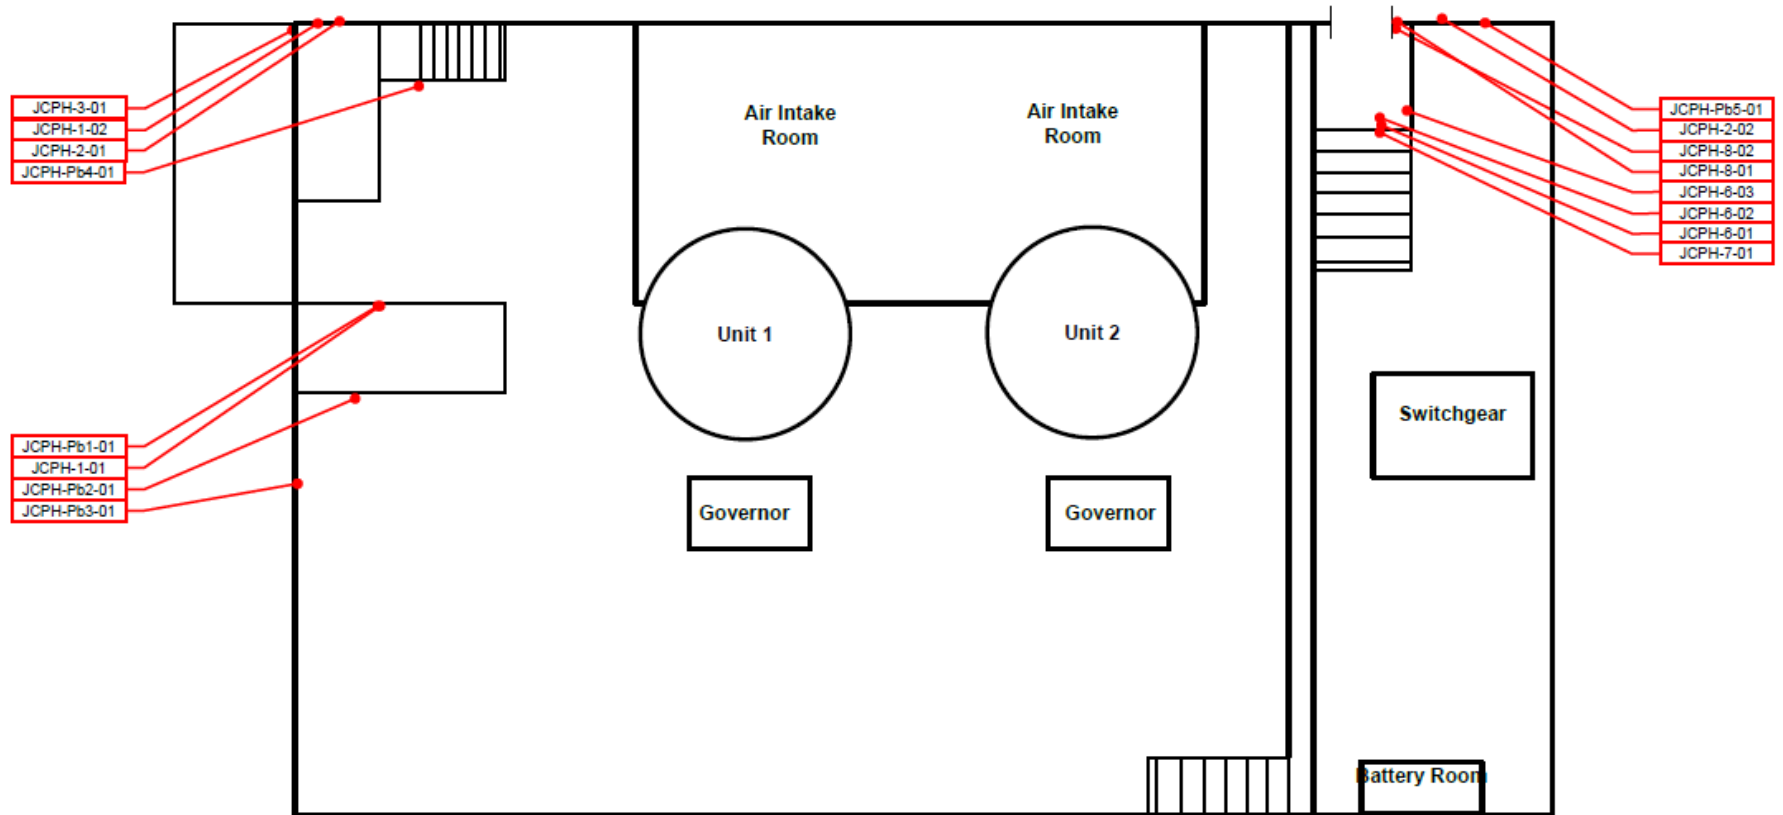


NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

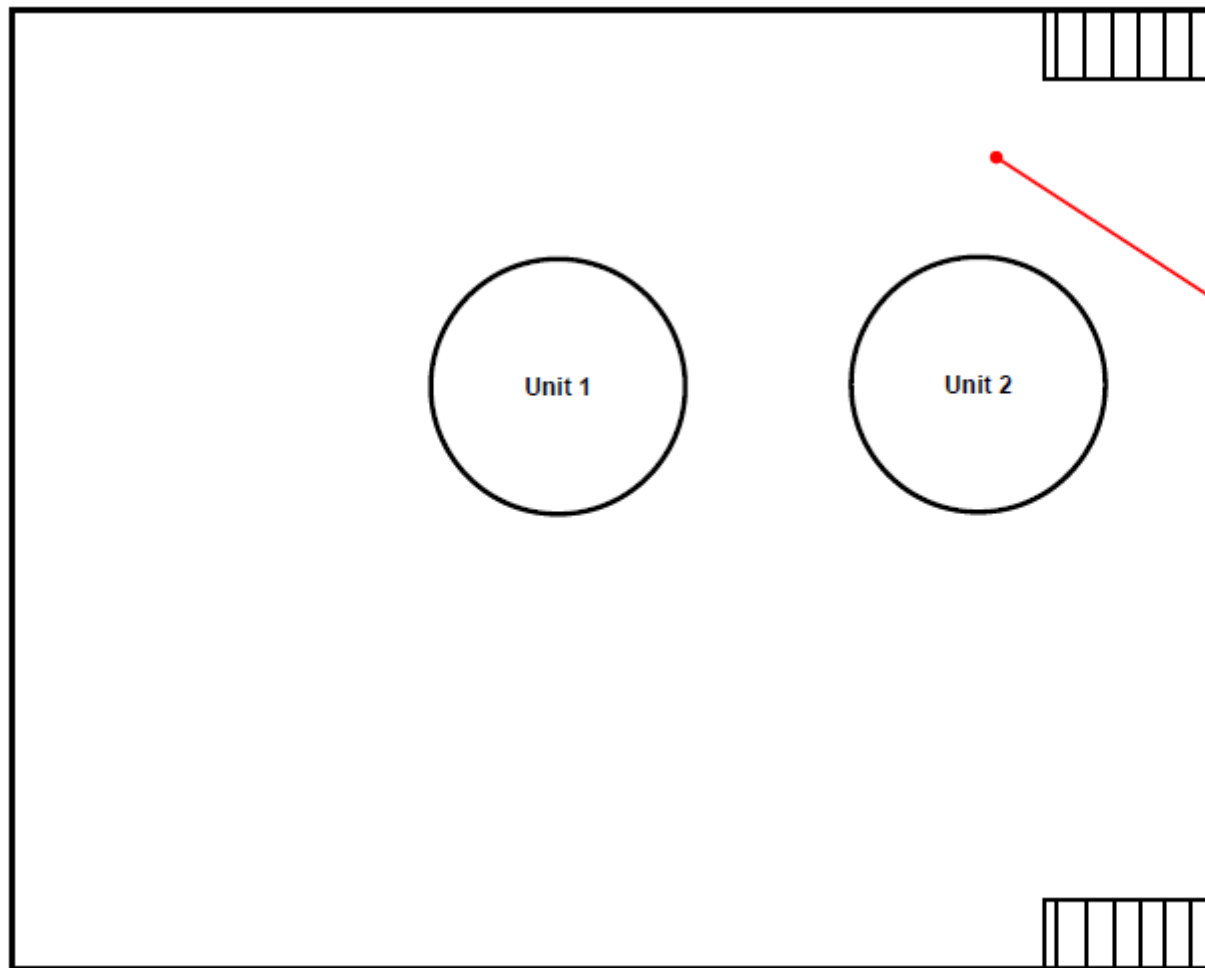

JCPH-4-01

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

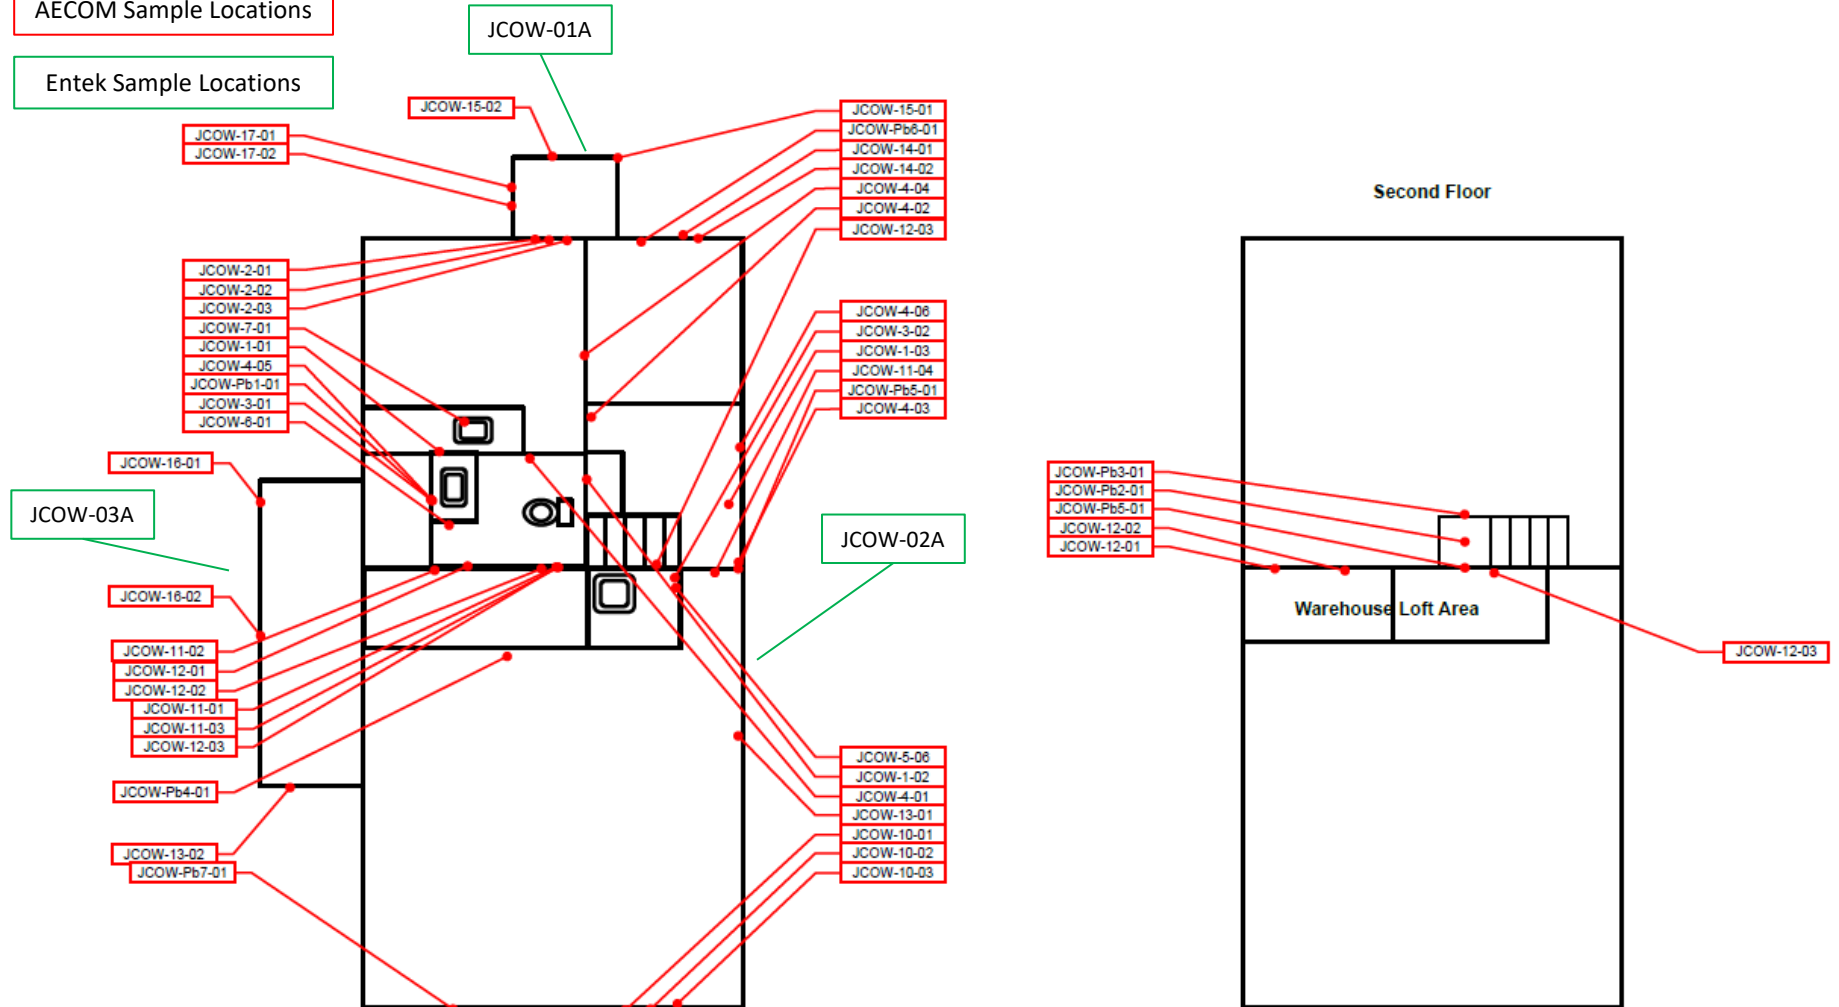

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

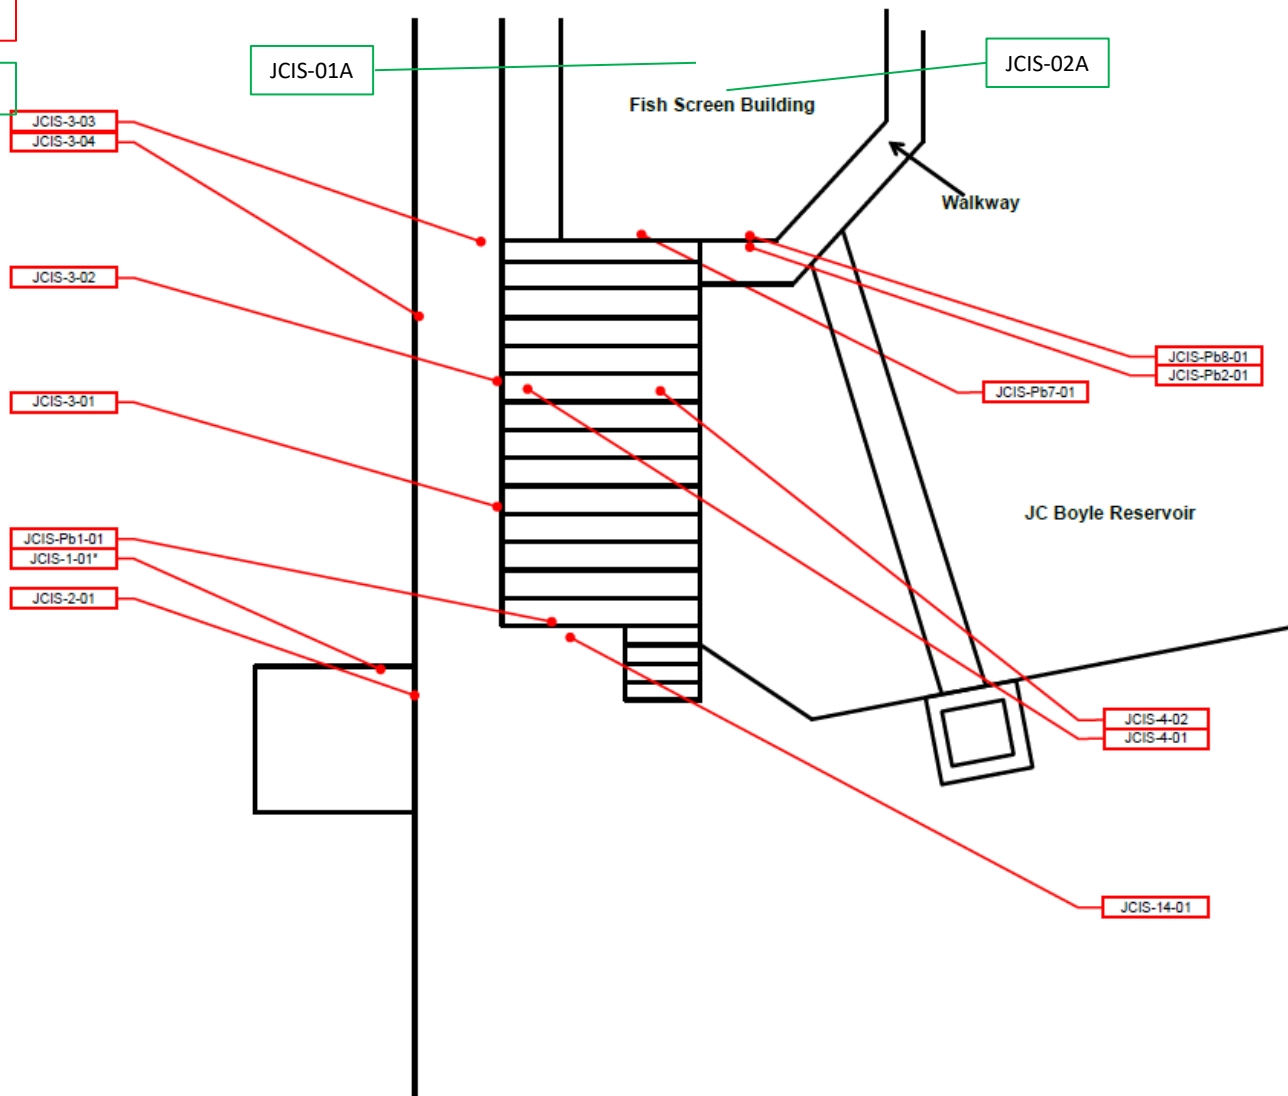

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

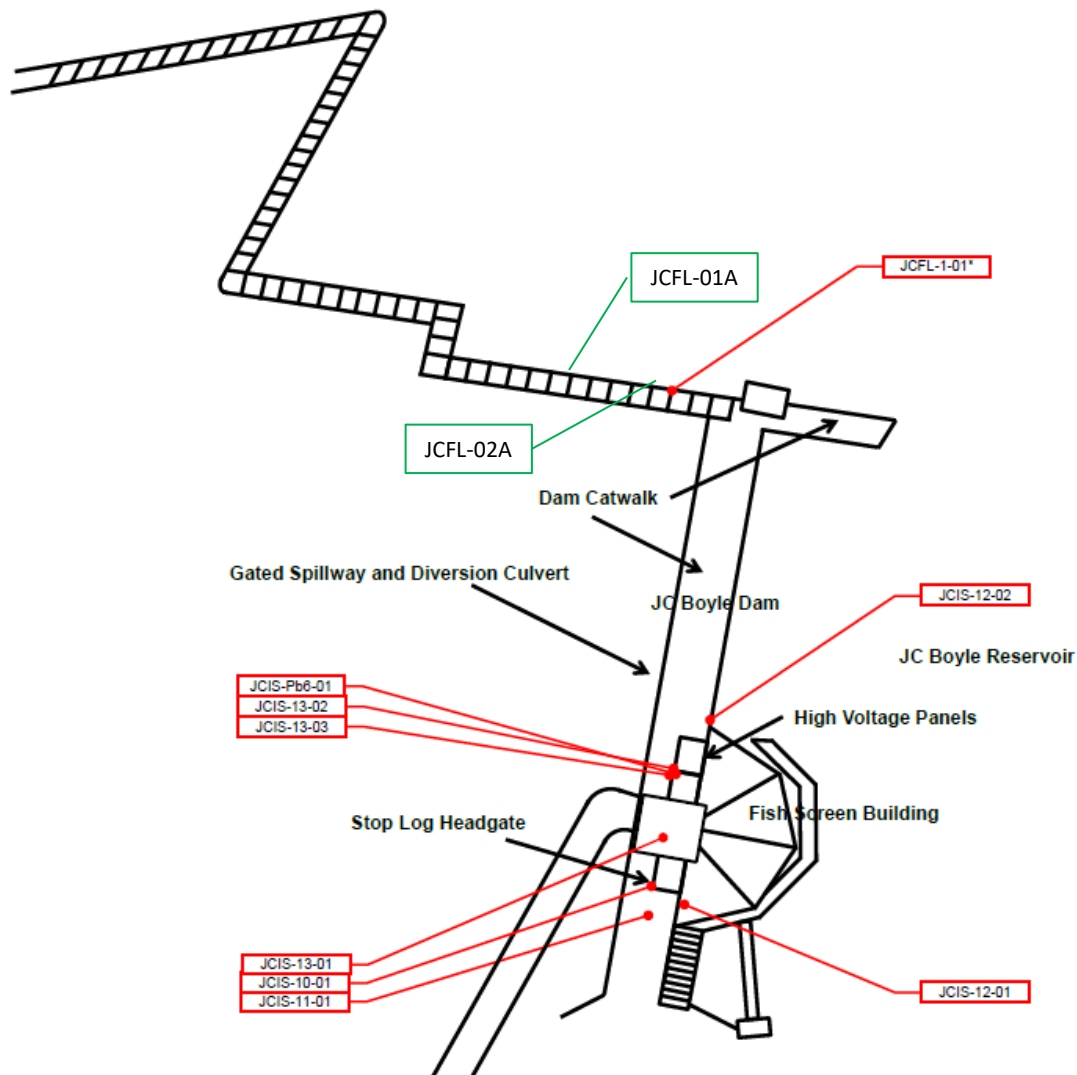

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

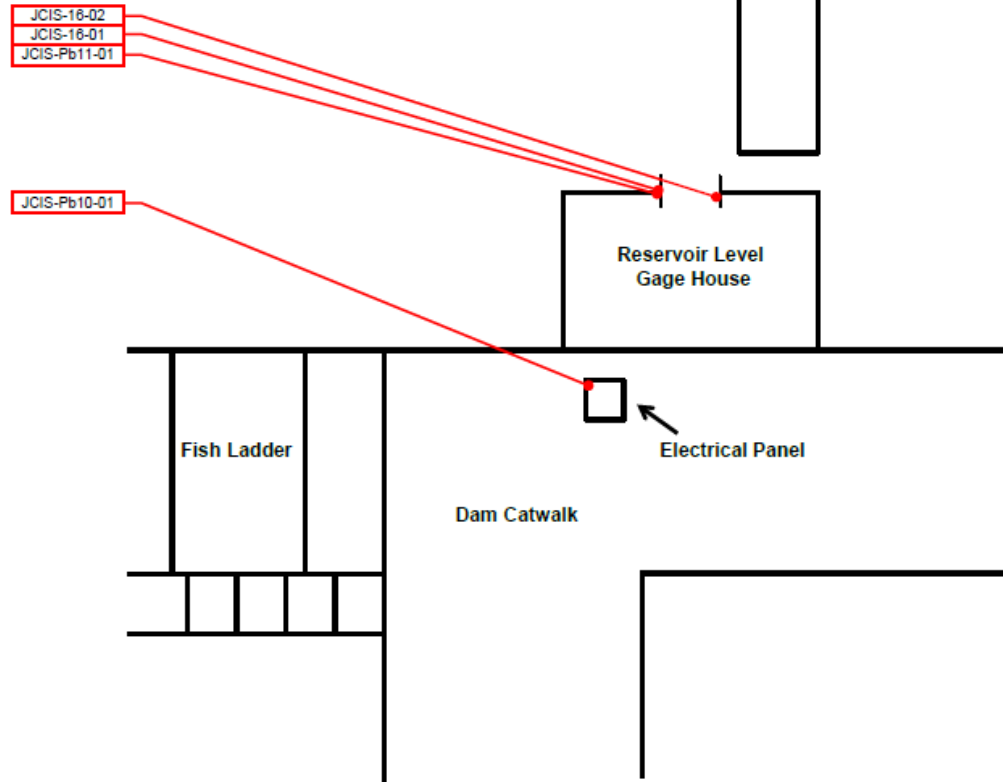

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

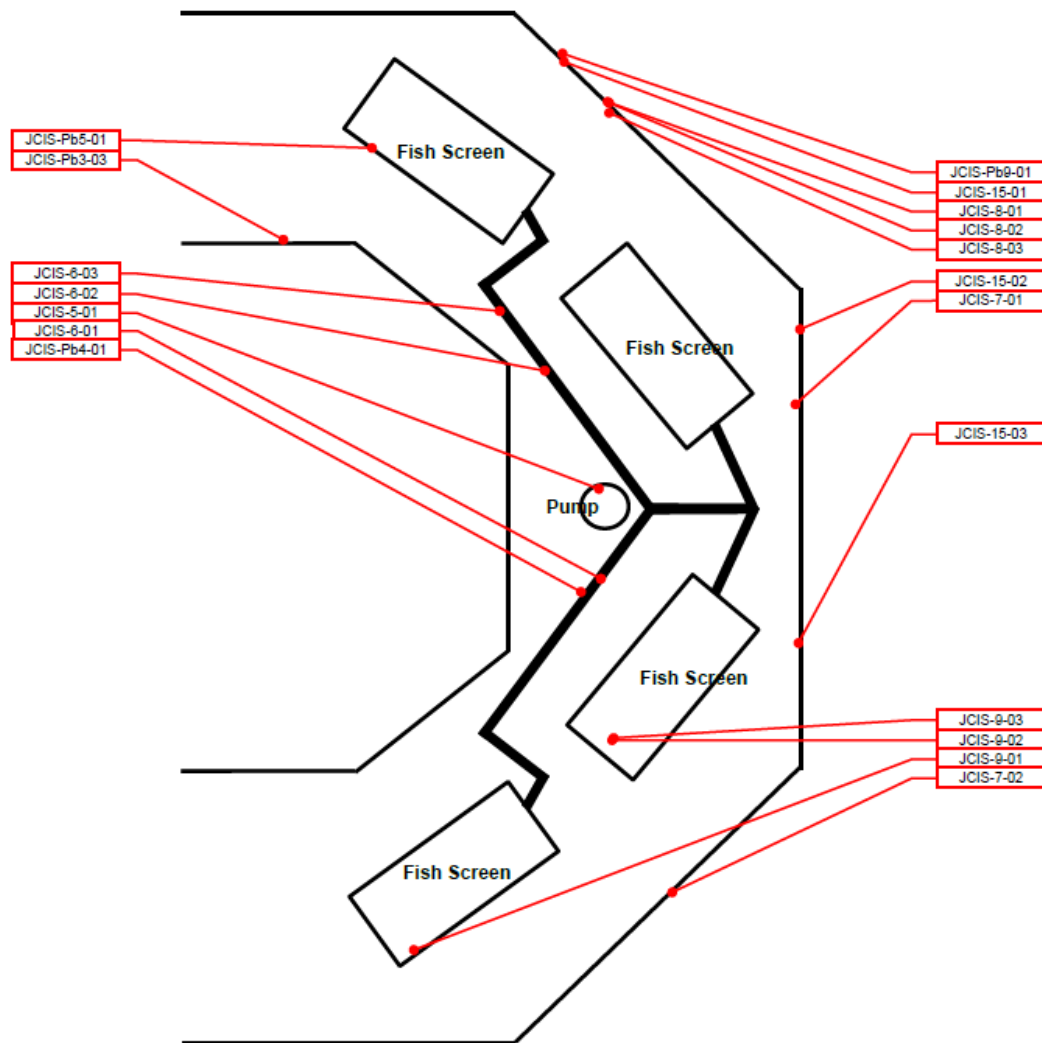

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle


Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

JCFP-Pb3-01
JCFP-4-01
JCFP-5-01

JCFP-3-01
JCFP-Pb2-01

AECOM Sample Locations

Entek Sample Locations

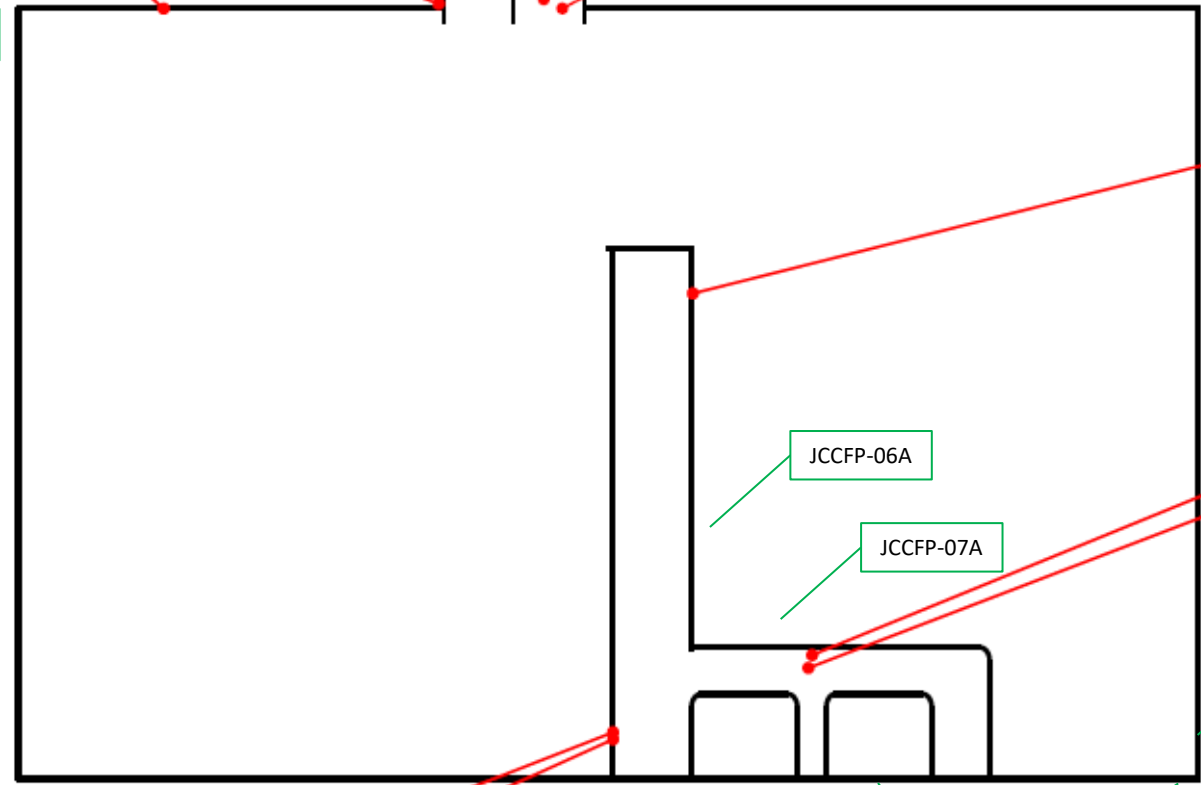

JCCFP-04A

JCFP-1-03
JCFP-Pb1-01

JCCFP-03A

JCCFP-05A

JCCFP-02A

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR


Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562

AECOM Sample Locations

Entek Sample Locations

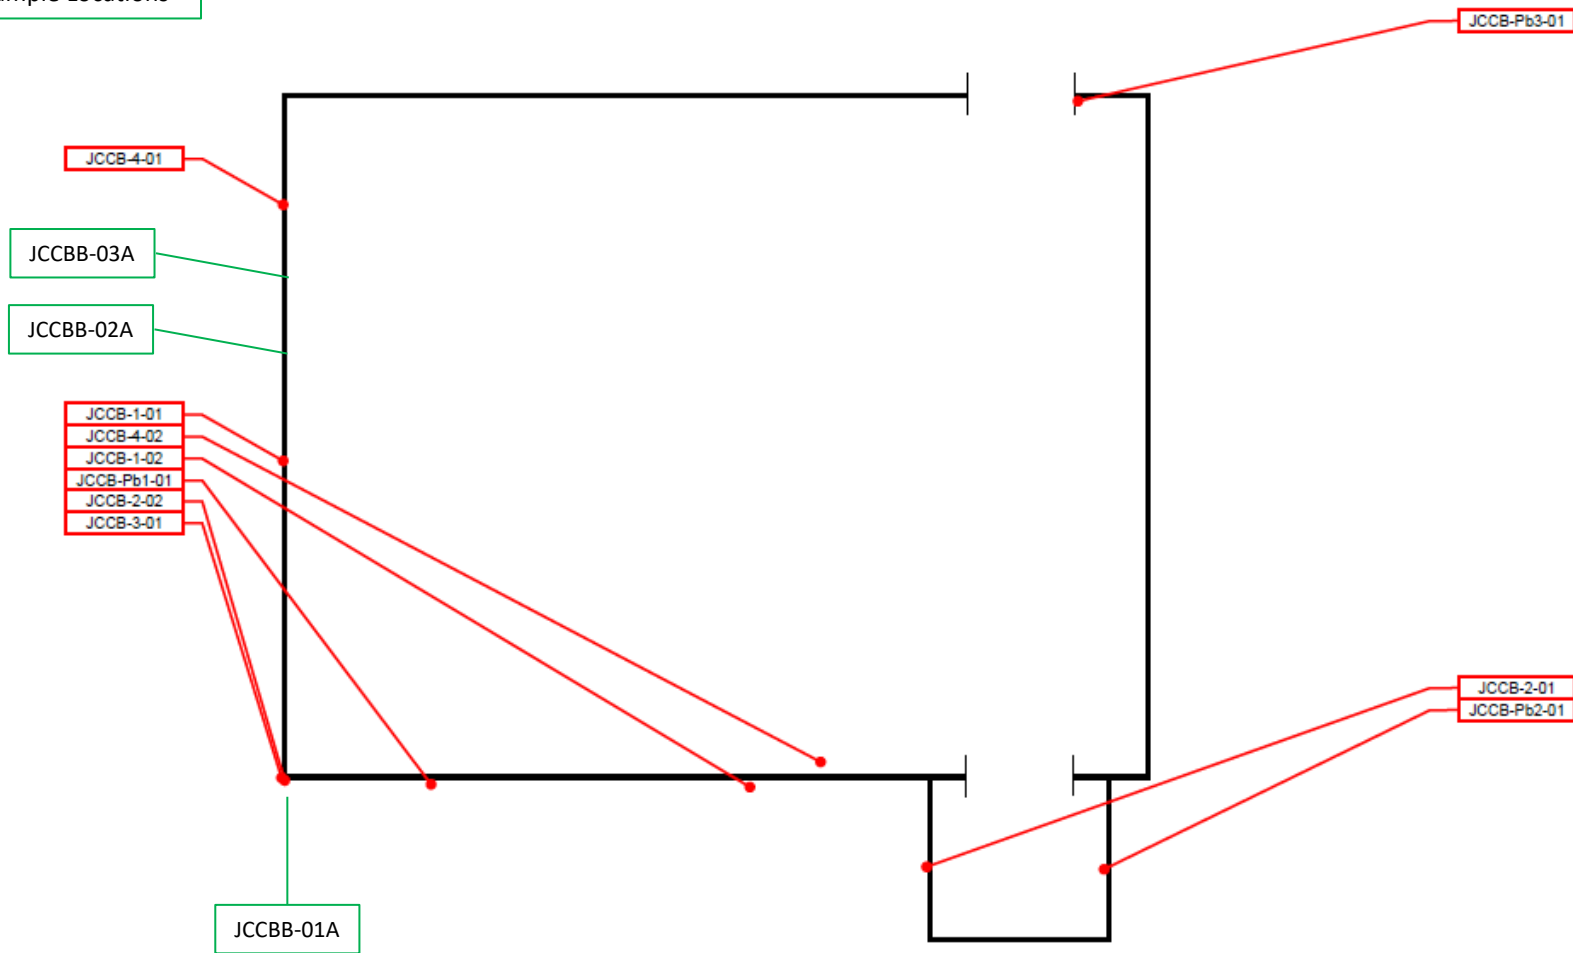

NV5
Klamath Dams
J.C. Boyle Dam
Keno, OR

Entek Consulting Group, Inc.
4200 Rocklin Road, Suite 7
Rocklin, CA 95677
Map Not to Scale

Cloud\Clients\NV5\20-5562 Klamath Dams\Drawings\JC Boyle

Asbestos and Lead Bulk Sample Locations
Collected by Andy Roed
On September 22, 2020
Project Number 20-5562



APPENDIX D

BACK UP DOCUMENTATION

- Inspector Accreditations and Certifications
- Laboratory Accreditations for Asbestos and Lead Analysis

State of California
Division of Occupational Safety and Health
Certified Asbestos Consultant

Andrew R Roed

Name



Certification No. **16-5695**

Expires on **08/17/21**

This certification was issued by the Division of Occupational Safety and Health as authorized by Sections 7180 et seq. of the Business and Professions Code.



STATE OF CALIFORNIA
DEPARTMENT OF PUBLIC HEALTH



LEAD-RELATED CONSTRUCTION CERTIFICATE

INDIVIDUAL:



Andrew Roed

CERTIFICATE TYPE:

Lead Inspector/Assessor

NUMBER:

LRC-00002989

EXPIRATION DATE:

9/11/2021

Disclaimer: This document alone should not be relied upon to confirm certification status. Compare the individual's photo and name to another valid form of government issued photo identification. Verify the individual's certification status by searching for Lead-Related Construction Professionals at www.cdph.ca.gov/programs/clppb or calling (800) 597-LEAD.

United States Department of Commerce
National Institute of Standards and Technology



Certificate of Accreditation to ISO/IEC 17025:2017

NVLAP LAB CODE: 101442-0

ASBESTECH

Carmichael, CA

*is accredited by the National Voluntary Laboratory Accreditation Program for specific services,
listed on the Scope of Accreditation, for:*

Asbestos Fiber Analysis

*This laboratory is accredited in accordance with the recognized International Standard ISO/IEC 17025:2017.
This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality
management system (refer to joint ISO-ILAC-IAF Communique dated January 2009).*

2020-07-01 through 2021-06-30

Effective Dates



A handwritten signature in dark ink, appearing to read "Dana S. Gorman".

For the National Voluntary Laboratory Accreditation Program

SCOPE OF ACCREDITATION TO ISO/IEC 17025:2017

ASBESTECH
6825 Fair Oaks Blvd., Suite 103
Carmichael, CA 95608
Mr. Tommy Conlon
Phone: 916-481-8902 Fax: 916-481-3975
Email: asbestech@sbcglobal.net
<http://www.asbestechlab.com>

ASBESTOS FIBER ANALYSIS


NVLAP LAB CODE 101442-0

Bulk Asbestos Analysis

<u>Code</u>	<u>Description</u>
18/A01	EPA -- 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples
18/A03	EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials

Airborne Asbestos Analysis

<u>Code</u>	<u>Description</u>
18/A02	U.S. EPA's "Interim Transmission Electron Microscopy Analytical Methods-Mandatory and Nonmandatory-and Mandatory Section to Determine Completion of Response Actions" as found in 40 CFR, Part 763, Subpart E, Appendix A.

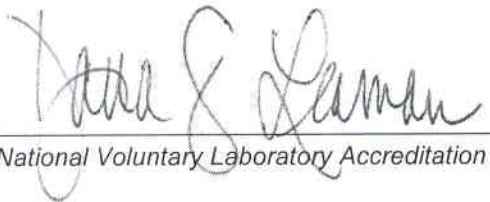
For the National Voluntary Laboratory Accreditation Program



STATE WATER RESOURCES CONTROL BOARD
REGIONAL WATER QUALITY CONTROL BOARDS

CALIFORNIA STATE



ENVIRONMENTAL LABORATORY ACCREDITATION PROGRAM

CERTIFICATE OF ENVIRONMENTAL ACCREDITATION

Is hereby granted to

Asbestech

6825 Fair Oaks Boulevard

Carmichael, CA 95608

Scope of the certificate is limited to the
"Fields of Testing"
which accompany this Certificate.

Continued accredited status depends on successful completion of on-site inspection,
proficiency testing studies, and payment of applicable fees.

This Certificate is granted in accordance with provisions of
Section 100825, et seq. of the Health and Safety Code.

Certificate No.: **1153**

Expiration Date: **3/31/2022**

Effective Date: **4/1/2020**

Sacramento, California
subject to forfeiture or revocation

Christine Sotelo, Chief
Environmental Laboratory Accreditation Program



**CALIFORNIA STATE
ENVIRONMENTAL LABORATORY ACCREDITATION PROGRAM
Accredited Fields of Testing**



Asbestech

6825 Fair Oaks Boulevard
Carmichael, CA 95608
Phone: 9164818902

**Certificate No. 1153
Expiration Date 3/31/2022**

Field of Testing: 121 - Bulk Asbestos Analysis of Hazardous Waste

121.010 001	Bulk Asbestos	EPA 600/M4-82-020
-------------	---------------	-------------------



AIHA Laboratory Accreditation Programs, LLC

acknowledges that

Eurofins EMLab P&K

17461 Derian Ave. Suite 100, Irvine, CA 92614

Laboratory ID: 178697

along with all premises from which key activities are performed, as listed above, has fulfilled the requirements of the AIHA Laboratory Accreditation Programs (AIHA-LAP), LLC accreditation to the ISO/IEC 17025:2017 international standard, *General Requirements for the Competence of Testing and Calibration Laboratories* in the following:

LABORATORY ACCREDITATION PROGRAMS

- ✓ **INDUSTRIAL HYGIENE**
- ✓ **ENVIRONMENTAL LEAD**
- ✓ **ENVIRONMENTAL MICROBIOLOGY**
- ☐ **FOOD**
- ☐ **UNIQUE SCOPES**

Accreditation Expires: September 01, 2021

Accreditation Expires: September 01, 2021

Accreditation Expires: September 01, 2021

Accreditation Expires:

Accreditation Expires:

Specific Field(s) of Testing (FoT)/Method(s) within each Accreditation Program for which the above named laboratory maintains accreditation is outlined on the attached **Scope of Accreditation**. Continued accreditation is contingent upon successful on-going compliance with ISO/IEC 17025:2017 and AIHA-LAP, LLC requirements. This certificate is not valid without the attached **Scope of Accreditation**. Please review the AIHA-LAP, LLC website (www.aihaaccreditedlabs.org) for the most current Scope.

Elizabeth Bair
Chairperson, Analytical Accreditation Board

Cheryl O. Morton
Managing Director, AIHA Laboratory Accreditation Programs, LLC



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

Eurofins EMLab P&K

17461 Derian Ave. Suite 100, Irvine, CA 92614

Laboratory ID: **178697**

Issue Date: 08/21/2019

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

Industrial Hygiene Laboratory Accreditation Program (IHLAP)

Initial Accreditation Date: 06/01/2011

IHLAP Scope Category	Field of Testing (FoT) (FoTs cover all relevant IH matrices)	Technology sub-type/ Detector	Published Reference Method/Title of In-house Method	Method Description or Analyte <i>(for internal methods only)</i>
Asbestos/Fiber Microscopy Core	Phase Contrast Microscopy (PCM)		NIOSH 7400	

A complete listing of currently accredited Industrial Hygiene laboratories is available on the AIHA-LAP, LLC website at:
<http://www.aihaaccreditedlabs.org>



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

Eurofins EMLab P&K

17461 Derian Ave. Suite 100, Irvine, CA 92614

Laboratory ID: **178697**

Issue Date: 08/21/2019

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

Environmental Microbiology Laboratory Accreditation Program (EMLAP)

Initial Accreditation Date: 07/01/2005

EMLAP Category	Field of Testing (FoT)	Method	Method Description <i>(for internal methods only)</i>
Fungal	Air - Direct Examination	EM-MY-S-1038	Preparation and Analysis of Spore Trap (Air) Samples for Fungal Spores, Other Biological and Non-Biological Particles
	Bulk - Direct Examination	EM-MY-S-1039	Preparation and Analysis of Tape, Swab, Wipe, Bulk and Dust - Soil Samples for Qualitative Direct Microscopic Examination
	Surface - Direct Examination	EM-MY-S-1041	Preparation and Analysis of Tape, Swab, Wipe, Bulk, and Dust - Soil Samples for Quantitative Direct Microscopic Examination
Bacterial	Legionella	EM-BT-S-1045	Enumeration of Legionella. International Standard ISO 11731:2017
		EM-BT-S-1687	CDC Laboratory protocol 2016

A complete listing of currently accredited Environmental Microbiology laboratories is available on the AIHA-LAP, LLC website at: <http://www.aihaaccreditedlabs.org>



AIHA Laboratory Accreditation Programs, LLC

SCOPE OF ACCREDITATION

Eurofins EMLab P&K

17461 Derian Ave. Suite 100, Irvine, CA 92614

Laboratory ID: **178697**

Issue Date: 08/21/2019

The laboratory is approved for those specific field(s) of testing/methods listed in the table below. Clients are urged to verify the laboratory's current accreditation status for the particular field(s) of testing/Methods, since these can change due to proficiency status, suspension and/or withdrawal of accreditation.

The EPA recognizes the AIHA-LAP, LLC ELLAP program as meeting the requirements of the National Lead Laboratory Accreditation Program (NLLAP) established under Title X of the Residential Lead-Based Paint Hazard Reduction Act of 1992 and includes paint, soil and dust wipe analysis. Air and composited wipes analyses are not included as part of the NLLAP.

Environmental Lead Laboratory Accreditation Program (ELLAP)

Initial Accreditation Date: 03/01/2017

Field of Testing (FoT)	Technology sub-type/ Detector	Method	Method Description (for internal methods only)
Paint		EPA SW-846 7000B Modified	
		NIOSH 7082	
Settled Dust by Wipe		EPA SW-846 7000B Modified	
		NIOSH 7082	

A complete listing of currently accredited Environmental Lead laboratories is available on the AIHA-LAP, LLC website at:
<http://www.aihaaccreditedlabs.org>



APPENDIX E

HISTORICAL SURVEY DOCUMENTATION

- AECOM Technical Services, Inc. Report Dated April 2019



Klamath River Renewal Project

J.C. Boyle Development
Hazardous Building Materials Survey

April 2019



Prepared for:

Klamath River Renewal Corporation

Assessment Conducted by:

AECOM Technical Services, Inc.

300 Lakeside Drive, Suite 400
Oakland, California 94612

Assessment Personnel

Ms. Shannon MacKay
AHERA-Certified Building Inspector
Number: CA-015-06 (exp. 5/2/2019)

Ms. Kim Riche
AHERA-Certified Building Inspector
Number: 168531 (exp. 7/11/2019)

Assessment Dates

August 20 to 23 and December 6, 2018

Report Prepared by:



Shannon MacKay
Environmental Consultant

Report Reviewed by:



David Simon
CDPH-Certified Asbestos Consultant (CAC)



Nicole Gladu
EHS Compliance Manager

Table of Contents

Executive Summary.....	8
Project Background:.....	8
Hazardous Building Materials Survey:	9
Objective:	9
Summarized HBMS Results:	9
1. Introduction	12
1.1 Project Description	12
1.2 Survey Limitations	12
2. Scope of Services.....	15
2.1 Asbestos Assessment.....	15
2.1.1 Methodology.....	15
2.1.2 Naturally Occurring Asbestos	16
2.2 Sampling Procedures.....	16
2.3 Sampling and Analysis.....	17
2.4 Lead Assessment.....	19
2.4.1 Sampling Methodology.....	19
2.5 Other Regulated Building Materials.....	19
2.5.1 Universal Waste Inventory Methodology.....	19
2.5.2 PCB-Containing Caulking.....	19
3. Site Description.....	22
3.1 J.C. Boyle Development	22
3.1.1 Description of J.C. Boyle Development Structures.....	22
4. Conclusions and Recommendations.....	27
4.1 Asbestos	27
4.1.1 Asbestos Regulations.....	28
4.2 Lead.....	30
4.3 Other Regulated Building Materials.....	30

4.4	Treated Wood	31
4.5	Tables	31

List of Figures (Appendix A)

Figure 1 Aerial Site Photo

Figure 2 Aerial Site Photo

Asbestos and Lead Sample Locations:

Figure 3 Communications Building

Figure 4 Fire Protection Building

Figure 5 Intake Structure, Gated Spillway and Diversion Culvert, and Fish Ladder

Figure 6 Intake Structure/JC Boyle Dam – South Section

Figure 7 Intake Structure Fish Screen Building

Figure 8 Intake Structure/JC Boyle Dam – North Section

Figure 9 Gate Control and Communications and Spillway Control Center

Figure 10 Groundwater Pumphouse, Outdoor Storage Area, Vehicle Storage Shed

Hazardous Materials Storage Sheds and Above Ground Storage Tanks

Figure 11 Office Warehouse

Figure 12 Powerhouse Main Level

Figure 13 Powerhouse Basement Level

Figure 14 Timber Bridge, Powerhouse Roof, and Penstock

Figure 15 Residence 1

Figure 16 Residence 2

Figure 17 Warehouse

Approximate ACM Locations:

Figure 18 – Communications Building

Figure 19 –Hazardous Materials Storage Sheds and Above Ground Storage Tanks and
Office/Warehouse

Figure 20 – Powerhouse Main Level

Figure 21 – Warehouse

List of Appendices

Appendix A	Figures
Appendix B	HSA Photologs
Appendix C	Laboratory Analytical Results
Appendix D	Personnel and Laboratory Certifications

Acronyms and Abbreviations

ACM	Asbestos-Containing Material
AECOM	AECOM Technical Services, Inc.
AHERA	Asbestos Hazard Emergency Response Act
AST	Aboveground Storage Tank
CC1	Copco 1 Dam
CC2	Copco 2 Dam
CFR	Code of Federal Regulations
DEQ	Oregon Department of Environmental Quality
HEPA	High Efficiency Particulate Air
HSA	Homogenous Sampling Area
IGD	Iron Gate Dam
IGH	Iron Gate Hatchery
JCB/JC	JC Boyle Dam
KHSA	Klamath Hydroelectric Settlement Agreement
KRRC	Klamath River Renewal Corporation
LCP	Lead-Containing Paint
mg/kg	milligrams per kilogram
NESHAP	National Emission Standards for Hazardous Air Pollutants
NOA	Naturally Occurring Asbestos
NVLAP	National Voluntary Laboratory Accreditation Program
OAR	Oregon Administrative Rules
ODEQ	Oregon Department of Environmental Quality
OR-OSHA	Oregon Occupational Safety and Health Administration
O&M	Operations & Maintenance
PACM	Presumed Asbestos-Containing Material
PCB	Polychlorinated Biphenyl

RCRA	Resource Conservation and Recovery Act
RM	river miles
USEPA	United States Environmental Protection Agency

A decorative banner with a wavy, flowing shape, filled with a solid blue color. It spans across the middle of the page.

Executive Summary

EXECUTIVE SUMMARY

Project Background:

AECOM Technical Services (AECOM) was retained by Klamath River Renewal Corporation (KRRC) to conduct a Hazardous Building Materials Survey (HBMS) of the J.C. Boyle Development. This report includes the findings of the HBMS conducted at the J.C. Boyle Development and associated support buildings and structures on August 20 to 23 and December 6, 2018. The J.C. Boyle Development is located near Keno, Oregon, and is a remote secured industrial facility owned and operated by PacifiCorp Energy.

The J.C. Boyle Development and original supporting structures were completed in 1958 and are located between RM 233 and 224.9 in Klamath County, Oregon. The J.C. Boyle address is 26020 Highway 66, Keno, Oregon 97627. The J.C. Boyle Dam impounds a narrow reservoir of 350 acres (aka J.C. Boyle Reservoir, aka Topsy Reservoir). Main features at J.C. Boyle include the reservoir, a combination embankment and concrete dam, gated spillway, diversion culvert, water conveyance system, forebay and powerhouse.

Other supporting structures include a fish ladder, 14 foot diameter pipeline, canal headgate and associated structure, timber bridge, a combined office/warehouse building, a vehicle storage shed, a fire protection building, a communications building, a hazardous materials shed, two residences, a vehicle storage shed, a spillway control building and gate control communications building near the forebay, and a warehouse and switchyard near the powerhouse.

Four dams and associated structures including the J. C. Boyle Development, Copco No. 1 Development, Copco No. 2 Development, Iron Gate Development and the Iron Gate Fish and Fall Creek Hatcheries (the Sites) have been identified for decommissioning and removal under the 2016 Amended Klamath Hydroelectric Settlement Agreement (KHSA, 2016) following the U.S. Department of the Interior Bureau of Reclamation's Detailed Plan for Dam Removal – Klamath River Dams, Klamath Hydroelectric Project FERC License No. 2082 Oregon – California (Detailed Plan) (USBR 2012). The Iron Gate Fish Hatchery, Fall Creek Fish Hatchery, and the City of Yreka Diversion Dam have been identified for improvements under the KHSA. All four developments will be transferred to their respective states after dam decommissioning and removal.

The Sites are located on land currently owned by PacifiCorp. An HBMS was conducted at each of the seven Sites, and an HBMS report issued for the Sites as follows:

1. J.C. Boyle Development
2. Copco No. 1 Development
3. Copco No. 2 Development
4. Iron Gate Development

5. Iron Gate and Fall Creek Hatcheries
6. City of Yreka Diversion

Hazardous Building Materials Survey:

AECOM assessed J.C. Boyle Development and support facilities for the following hazardous building materials:

- Asbestos-containing materials (ACMs);
- Asbestos-containing construction materials (ACCMs);
- Assumed asbestos-containing materials;
- Lead-containing coatings (paints);
- Mercury-containing light tubes, switches, and thermostats;
- Polychlorinated Biphenyl (PCB)-containing caulking, putties, gaskets, and membranes;
- Suspected high-intensity discharge (HID) lamps; and
- Suspected PCB-containing fluorescent light ballasts and transformers.

Objective:

The objective of the HBMS was to provide information regarding the presence of lead-containing coatings, PCB-containing light ballasts, PCB-containing caulking, and mercury-containing sources, and the presence, location, and quantity of ACMs, ACCMs, and assumed ACMs, and for the purposes of decommissioning planning.

Summarized HBMS Results:

Two-hundred and three bulk samples of suspect asbestos-containing materials were collected and analyzed using Polarized Light Microscopy (PLM) during this assessment. Seven materials (HSAs) were found to contain detectable asbestos above 0.1%, five materials were assumed to contain asbestos, and three materials were visually assessed and determined to be non-suspect. Per the EPA National Emission Standard for Hazardous Air Pollutants (NESHAP) requirements and the analytical results, four sample layers were further analyzed using PLM Point Count Method.

In addition, six concrete bulk samples were collected and analyzed using PLM California Air Resources Board (CARB) 435 method to determine the content of Naturally Occurring Asbestos (NOA). No concrete samples were found to contain detectable NOA above the PLM point count threshold of 0.25%.

Sixteen paint chip samples were collected and analyzed for total lead content using Atomic Absorption Spectrophotometry; fifteen of the samples were found to contain reportable levels of lead.

Mercury-containing fluorescent light tubes, HID lamps, and magnetic light ballasts labeled “No-PCBs” were observed during the assessment. In the switchyard, the yellow glass portion of the high voltage transformer bushings may contain PCBs in the oil. One caulking sample was collected and analyzed for PCBs using EPA method 8270 by gas chromatography/mass spectrometry (GCMS). No PCBs were detected in the caulking sample.

See Section 4.5: Tables for tabulated HBMS Results.

A decorative banner with a wavy, undulating shape, filled with a solid blue color. It spans across the middle of the page.

Chapter 1: Introduction

1. INTRODUCTION

1.1 Project Description

AECOM Technical Services (AECOM) was retained by KRRC to conduct an HBMS of the J.C. Boyle Development and support facilities. This report includes the findings of the HBMS conducted at the J.C. Boyle Development and associated support buildings and structures on August 20 to 23 and December 6, 2018. The J.C. Boyle Development is located near Keno, Oregon, and is a remote secured industrial facility owned and operated by PacifiCorp.

1.2 Survey Limitations

The conclusions of this report are AECOM's professional opinions, based solely upon visual site observations and interpretations of laboratory analyses, as described in this report. The opinions presented herein apply to the site conditions existing at the time of AECOM's assessment and interpretation of current regulations pertaining to asbestos, lead-containing paint, PCB-containing ballasts and building materials, and mercury-containing components. Therefore, AECOM's opinions and recommendations may not apply to future conditions that may exist at the site which we have not had the opportunity to evaluate. All applicable state, federal, and local regulations should always be verified prior to any work that will disturb materials containing asbestos and other hazardous building materials.

AECOM has performed the services set forth in the Scope of Work in accordance with generally accepted industrial hygiene practices in the same or similar localities, related to the nature of the work accomplished, at the time the services were performed.

Additional sampling needs to be conducted of structures not assessed and inaccessible areas prior to demolition. Suspect regulated building materials throughout the J.C. Boyle Development and support facilities that are not included in this regulated building materials assessment are assumed to be asbestos-containing unless they are sampled by an AHERA-accredited Building Inspector and analyzed by a National Voluntary Laboratory Accreditation Program (NVLAP)-accredited laboratory to confirm the presence of asbestos prior to the disturbing such materials.

The regulated building materials and conditions presented in this report represent those observed on the dates we conducted the sampling. This sampling is intended for the exclusive use of KRRC for specific application to the proposed decommissioning. This assessment is not intended to replace construction or demolition plans, specifications, or bidding documents. This report is not meant to represent a legal opinion.

This report was prepared pursuant to an agreement between KRRC and AECOM and is for the exclusive use of KRRC. No other party is entitled to rely on the conclusions, observations, specifications, or data contained herein without first obtaining AECOM's written consent and provided any such party signs an AECOM-

generated Reliance Letter. A third party's signing of the AECOM Reliance Letter and AECOM's written consent are conditions precedent to any additional use or reliance on this report.

The passage of time may result in changes in technology, economic conditions, site variations, or regulatory provisions, which would render the report inaccurate. Reliance on this report after the date of issuance as an accurate representation of current site conditions shall be at the user's sole risk.

A decorative banner with a wavy, undulating shape, filled with a solid blue color. It spans horizontally across the middle of the page.

Chapter 2: Scope of Services

2. SCOPE OF SERVICES

2.1 Asbestos Assessment

Ms. Shannon MacKay and Ms. Kim Riche, both AHERA-accredited building inspectors, (Certification 167196, expiration date: 5/2/2019; and, Certification 168531, expiration date: 7/11/2019, respectively), performed the sampling at the J.C. Boyle Development and support buildings from August 20 to 23 and on December 6, 2018. Copies of their certifications are included in Appendix C.

The following materials/areas were inaccessible during the site work and should be assumed to contain asbestos until such time as the area becomes accessible and is sampled by an AHERA-accredited building inspector and analyzed by a NVLAP-accredited laboratory:

- Residence 2
- Structure above stop log gates on metal support beams, associated with the Intake Structure

2.1.1 Methodology

This assessment was conducted using a modified protocol adapted from AHERA. The protocol is as follows:

- Identify suspect asbestos-containing materials.
- Group materials into homogeneous sampling areas/materials.
- Quantify each homogeneous material and collect representative samples. The number of samples collected of miscellaneous materials was determined by the inspector.
- Samples of each material were taken to the substrate, ensuring that all components and layers of the material were included.
- Sample locations are referenced on the field data forms according to sample number.
- Sampling was performed by a CAC or CSST, and the use of proper protective equipment and procedures was followed.

2.1.2 Naturally Occurring Asbestos

For informational purposes, AECOM collected samples of concrete and submitted them to EMSL Laboratories to analyze for NOA. The sampling was conducted as a preliminary screen for NOA. Sampling was conducted discretely in areas where damage to concrete was already present.

2.2 Sampling Procedures

This sampling was conducted using the following procedures:

1. Spread the plastic drop cloth (if needed) and set up other equipment, e.g., ladder.
2. Don protective equipment (respirator and protective clothing if needed).
3. Label sample container with its identification number and record number. Record sample location and type of material sampled on a sampling data form.
4. Moisten area where sample is to be extracted (spray the immediate area with water).
5. Extract sample using a clean knife, drill capsule, or cork boring tool to cut out or scrape off approximately one tablespoon of the material. Penetrate all layers of material.
6. Place sample in a container and tightly seal it.
7. Wipe the exterior of the container with a wet wipe to remove any material that may have adhered to it during sampling.
8. Clean tools with wet wipes and wet mop; or vacuum area with HEPA vacuum to clean all debris.
9. Discard protective clothing, wet wipes and rags, cartridge filters, and drop cloth in a labeled plastic waste bag.

AECOM inspected the buildings and structures for suspect ACM including thermal systems insulation, surfacing materials, and miscellaneous materials (e.g., floor tiles, ceiling tiles). When materials suspected of containing asbestos were identified, AECOM's inspectors collected representative bulk samples from each Homogeneous Sampling Area using the protocol presented in the Table 2-1:

Table 2-1 Suspect ACM Sampling Protocol

Suspect ACM Sampling Protocol		
Homogeneous Sampling Area (HSA) Category	HSA Size	Minimum Number of Samples
Surfacing Materials	1,000 SF or Less	3
	1,001-5,000 SF	5
	>5,000 SF	7 or more
Thermal System Insulation (TSI)	No Stipulation	3 of each type of TSI. (Must also sample all repair patches)
Miscellaneous Materials	No Stipulation	1 or more samples of each miscellaneous material

A Homogeneous Sampling Area is defined to include surfacing materials, thermal systems insulations, and miscellaneous materials, which are uniform in color, texture, construction and application date, and general appearance.

Additional suspect ACMs may be present in inaccessible or concealed spaces. These spaces include, but are not limited to, areas not assessed, areas not accessible at the time of the assessment, fire doors, electrical systems, pipe chases, spaces between wall/ceiling/door/floor cavities, interior of mechanical components, beneath foundation pads, etc. If future maintenance, renovation, and/or demolition activities make these areas accessible, AECOM recommends that a thorough assessment of these spaces be conducted at that time to identify and confirm the presence or absence of additional suspect ACMs. Until then, all such unidentified materials must be treated as assumed ACMs in accordance with applicable federal, state, and local regulations.

AECOM did not sample suspect ACM in the following circumstances:

- The AECOM inspector could not safely access the material for sampling;
- The residence was still occupied;
- The AECOM inspector concluded that the materials were inaccessible for sampling; or
- The AECOM inspector determined that destructive sampling would compromise the integrity of the material and/or the structure.

2.3 Sampling and Analysis

The EPA National Emission Standard for Hazardous Air Pollutants (NESHAP) (40 CFR 61, Subparts A and M) also has requirements related to the assessment of suspect ACM in buildings. NESHAP defines a “friable” material to be a material that when dry, can be crumbled, pulverized, or reduced to powder with hand pressure or by the forces expected to act on the material in the course of demolition or renovation activities.

AECOM applied this NESHAP definition of friable for the purposes of determining which analytical method to be used to quantify the asbestos content of a specific material.

The collected samples of suspect ACM were analyzed by NVL Laboratories, Inc. for asbestos content using the PLM visual estimation method and the PLM Point Counting Method. NVL Laboratories, Inc. is accredited for these asbestos analytical methods by the NVLAP Accreditation Program. Appendix C contains NVL Laboratories, Inc.'s certificate of laboratory accreditation and licensure. The collected samples of suspect NOA in concrete were analyzed by EMSL Analytical, Inc. for asbestos content using PLM CARB Method 435. EMSL Analytical, Inc. is accredited for these asbestos analytical methods by the NLAP Accreditation Program. Appendix C contains EMSL Analytical, Inc.'s certificate of laboratory accreditation and licensure.

Polarized Light Microscopy (PLM)

The PLM method is a visual estimation of the asbestos content of a sample. The PLM analysis was performed by NVL Laboratories, Inc. following the United States Environmental Protection Agency's (USEPA) PLM method EPA-600R/M4-82-020 for determining asbestos content in bulk building materials.

Polarized Light Microscopy Point Count (PLM Point Count)

According to the NESHAP, when the asbestos content of a friable material is visually estimated by the PLM visual technique to be detectable but less than 10%, the inspector may either (1) assume that the amount is greater than 0.1% and treat the material as ACCM or (2) conduct a second analysis, the PLM Point Count Method EPA/600-R93/116, to verify the percentage of asbestos in the material.

Per NESHAP, AECOM used the results of the PLM visual method analyses for friable materials to determine whether additional laboratory analysis was warranted (i.e., PLM Point Count), or whether the material would be treated as ACCM. Based on PLM analytical results, four samples were further analyzed by PLM Point Count analysis (See Appendix C).

If the results obtained by PLM Point Count Method and the PLM visual estimation method are different, the PLM Point Count result is used. When no asbestos is detected by the first PLM visual method, the additional technique using PLM Point Count Method is not required. The analytical results are reported in percent asbestos as derived from a 1000 point counting technique, which yields a detection limit of 0.1%.

Naturally Occurring Asbestos (NOA)

Asbestos fibers may be released from serpentine rock formations. The CARB 435 method is used to determine the asbestos content of serpentine aggregate, or NOA, in concrete, storage piles, on conveyor belts, and on surfaces such as road beds, road shoulders, and parking lots. Samples are crushed using a mill to produce a material of which the majority is less than 200 Tyler mesh (0.75 microns). CARB defines NOA as having >0.25% asbestos by PLM point counting. The analytical results are reported in percent asbestos as derived from a 400 PLM point counting technique, which yields a detection limit of 0.25%.

2.4 Lead Assessment

2.4.1 Sampling Methodology

Homogeneous painted surfaces were defined by substrate, application, and color. The paint chip samples were collected to the substrate to ensure that all layers present on the substrate were included in the laboratory analysis. The samples were collected and stored in a heavy-duty, self-sealing plastic bag and delivered to NVL Laboratories in Seattle, Washington. The samples were analyzed via Atomic Absorption Spectrophotometry in accordance with Method EPA 7000B. NVL Laboratories in Seattle, Washington is accredited by American Industrial Hygiene Association (AIHA) for lead analysis.

2.5 Other Regulated Building Materials

2.5.1 Universal Waste Inventory Methodology

An inventory of fluorescent light tubes, HID lamps, mercury-containing sources, and potential PCB-containing ballasts was conducted in accessible Project Areas.

Where fluorescent light fixtures were accessible, the ballast covers were removed, and the ballast labels were visually examined. Where fluorescent light fixtures could not be visually examined, the number of potential PCB-containing ballasts in each fixture was estimated based on the following assumptions:

- Each single light tube fluorescent fixture contains one ballast;
- Each HID lamp contains one ballast and one mercury bulb;
- Each multiple light tube fluorescent fixture contains one ballast for every pair of light tubes; and
- All light ballasts are assumed to contain PCBs unless the ballasts are labeled as not containing PCBs or are determined to be electronic.

Fluorescent light tubes, HID lamps, fluorescent light fixtures and PCB-containing transformers were identified in the buildings in the quantities listed in Table 4-4.

2.5.2 PCB-Containing Caulking

Suspected PCB-containing caulking samples were collected in the same manner as suspected asbestos-containing bulk samples. Each sample was collected and stored in a glass jar and delivered to Fremont Analytical, Inc. in Seattle, Washington. Samples were analyzed via Gas Chromatography in accordance with EPA Method 8270, "Polychlorinated Biphenyls (PCBs) by Gas Chromatography/Mass Spectrometry". Fremont Analytical, Inc. in Seattle, Washington is accredited by the National Environmental Lab Accreditation

program as administered by the National Laboratory Accreditation Committee for analysis of PCBs by EPA Method 8270 (reporting in parts per million). Analytical results are presented in Table 4-5.

A decorative banner with a wavy, ribbon-like shape. It features a dark blue base color and a lighter blue upper section separated by a white wavy line. The banner curves upwards at both ends.

Chapter 3: Site Description

3. SITE DESCRIPTION

3.1 J.C. Boyle Development

AECOM Technical Services (AECOM) was retained by Klamath River Renewal Corporation (KRRC) to conduct a Hazardous Building Materials Survey (HBMS) of the J.C. Boyle Development. This report includes the findings of the HBMS conducted at the J.C. Boyle Development and associated support buildings and structures on August 20 to 23 and December 6, 2018. The J.C. Boyle Development is located near Keno, Oregon, and is a remote secured industrial facility owned and operated by PacifiCorp.

The J.C. Boyle Development and original supporting structures were completed in 1958 and are located between RM 233 and 224.9 in Klamath County, Oregon. The J.C. Boyle address is 26020 Highway 66, Keno, Oregon 97627. The J.C. Boyle Dam impounds a narrow reservoir of 350 acres (aka J.C. Boyle Reservoir, aka Topsy Reservoir). Main features at J.C. Boyle include the reservoir, a combination embankment and concrete dam, gated spillway, diversion culvert, water conveyance system, forebay and powerhouse.

Other supporting structures include a fish ladder, 14 foot diameter pipeline, canal headgate and associated structure, timber bridge, a combined office/warehouse building, a vehicle storage shed, a fire protection building, a communications building, a hazardous materials shed, two residences, a vehicle storage shed, a spillway control building and gate control communications building near the forebay, and a warehouse and switchyard near the powerhouse.

3.1.1 Description of J.C. Boyle Development Structures

The following J.C. Boyle Development support structures were assessed during the HBMS:

Canal Headgate (JCCH)

The Canal Headgate is connected to the Intake Structure by a 14' steel pipeline.

Communication Building (JCCB)

The Communication Building is located south of the dam. It is an approximately 360 square feet paneled building with a slab-on-grade concrete foundation. The exterior siding and roofing consists of pre-fabricated steel. The interior consists of pre-fabricated metal wall siding and unfinished concrete flooring. The building contains a work station, electrical panels and two 32 units battery bank in secondary containment systems.

Emergency Spill Equipment Shed (JCES)

The Emergency Spill Equipment Shed is adjacent to the Powerhouse, is approximately 100 square feet, and is a single-story concrete slab on grade shed with engineered wood siding and asphaltic shingle roofing. The

interior of the shed is unfinished wood. The structure is currently being used as storage for emergency spill purposes. The structure was inaccessible during the HBMS due to the presence of wasps.

Fire Protection Building (JCFP)

The Fire Protection Building is located east of the diversion dam along the west bank of the reservoir. It is an approximately 600 square foot cinder block building with a slab-on-grade concrete floor and wooden ceiling. The structure houses water piping, compressed air tanks and electrical cabinets. The interior finishes consist of concrete flooring, CMU siding, and exposed metal ceiling.

Fish Ladder (JCFL)

The Fish Ladder is north of the Intake Structure. It is constructed of concrete.

Gate Control Center Building (JCGC)

The Fire Protection Building is located east of the diversion dam along the west bank of the reservoir. It is an approximately 600 square foot cinder block building with a slab-on-grade concrete floor and wooden ceiling. The structure houses water piping, compressed air tanks and electrical cabinets. The interior finishes consist of concrete flooring, CMU siding, and exposed metal ceiling.

Groundwater Pumphouse (JCGWPH)

The Groundwater Pumphouse is a prefabricated shed located southeast of the outdoor storage area. It is approximately 100 square feet. The exterior consists of metal siding and roofing. The interior of the building consists of unfinished wood throughout.

HazMat Shed and Above Ground Storage Tanks (JCHM)

The HazMat Shed and Above Ground Storage Tanks are located about 50 feet east of the Office and Warehouse building. The HazMat Shed is approximately 240 square feet. The HazMat Shed exterior consists of pre-fabricated metal siding with a slab-on-grade concrete foundation. The interior of the storage shed consists of unfinished metal siding and ceiling and unfinished concrete flooring. One each 500 gallon diesel and 1,000 gallon gasoline above ground storage tanks are located adjacent to the Hazardous Material Storage Shed. Both are double walled ASTs and are underneath a permanent "cover" and on top of concrete pads.

Intake Structure (JCIS)

The Intake Structure is located on the western side of the JC Boyle Reservoir. The south end of the structure includes a Fish Screen Building accessed by a wooden bridge. The perimeter of the Fish Screen Building is encircled by a wooden walkway above the reservoir to access metal fish screens. The exterior of the Fish Screen Building consists of corrugated metal siding and roofing. The interior of the Fish Screen Building consists of concrete flooring, walls, and ceiling. The JC Boyle Dam extends north of the Fish Screen Building,

including stop log gates, metal grating walkways, electrical panels, and mules. The Fish Ladder extends west on the north end of the dam.

Office and Warehouse (JCOW)

The Office and Warehouse Building is approximately 1,800 square feet with a slab-on-grade concrete foundation. It resembles a “Red Barn” and is located approximately 300 feet west of the dam. The office portion contains a small kitchen with a sink and a restroom with water discharged to a septic tank. The maintenance warehouse portion is a large open area for typical repair and maintenance activities, the storage maintenance equipment, tools and miscellaneous supplies, and has a side fenced storage area.

Outdoor Storage Area (JCBY)

The Outdoor Storage Area (also referred to as the boneyard) is located south of the Vehicle Storage Shed. Various items are scattered throughout the Outdoor Storage Area, including scrap metal and a decommissioned storage tank.

Penstocks (JCPS)

The Penstocks extend downhill from the surge tank, on the north side of the Powerhouse, and feed the turbines inside the Powerhouse.

Powerhouse (JCPH)

The Powerhouse is approximately 7,000 square feet and is a reinforced concrete structure and contains three levels; above ground, first lower level, and second lower level.

The above ground level contains the upper portions of two vertical-shafts and Francis-type turbines contained in their own concrete vaults. A single 150-ton gantry crane was observed over the two turbines. The first lower level contained the lower portions of the turbines that were housed in concrete vaults, electrical panels, tanks, air compressors, oil, water and air piping, a small open office, and a restroom connected to an outdoor septic tank. The second lower level contained the piping, penstock intakes, and sump pumps.

Exterior and interior wall, floor, and ceiling finishes consist of concrete and CMU that are primarily painted throughout.

Residence 1 (JCR1)

Residence 1 is approximately 2020 square feet and is located east of the Vehicle Storage Shed. The building exterior consists of wood siding and asphaltic shingle roofing. The interior of the building contains bedrooms, bathrooms, a kitchen, a living room, and closets. The interior finishes include gypsum walls and ceilings, vinyl floor sheeting, and carpeting.

Residence 2 (JCR2)

Residence 2 is approximately 2020 square feet and is located east of the Vehicle Storage Shed. The interior of the building was inaccessible during the inspection. The building exterior consists of wood siding and asphaltic shingle roofing.

Spillway Control Center Building (JCSW)

The Spillway Control Center Building is approximately 420 square feet and is located adjacent to the Spillway. The exterior consists of metal siding and roofing. The interior of the building was not accessed during the inspection due to the observable presence of bats.

Substation (JCST)

The Substation is located inside the Switchyard and was not accessed during the inspection due to safety considerations.

Switchyard (JCSW)

The Switchyard is approximately 23,000 square feet, is located west of the Powerhouse, and was not accessed during the inspection due to safety considerations. The Switchyard contains electrical transformers, substations, transmission poles and lines within a fenced gravel area..

Timber Bridge (JCWB)

The Timber Bridge is approximately 1,600 square feet, and is located near the 14' diversion pipe, at the base of the Headgate.

Vehicle Storage Shed (JCVS)

The Vehicle Storage Shed is located east of the Office/Warehouse building and is approximately 4,400 square feet. The exterior of the building consists of metal siding and corrugated metal roofing. The interior finishes consist of unfinished metal framed walls and ceiling with batt insulation and unfinished concrete flooring.

Warehouse (JCWH)

The Warehouse is approximately 4,800 square feet. The exterior of the building consists of metal siding and corrugated metal roofing. The interior of the building consists of unfinished metal framed walls and ceiling with batt insulation and unfinished concrete flooring.

A decorative banner with a wavy, undulating shape, filled with a solid blue color. It spans across the middle of the page.

Chapter 4: Conclusions and Recommendations

4. CONCLUSIONS AND RECOMMENDATIONS

On August 20 to 23 and December 6, 2018, AECOM conducted a Hazardous Building Materials Survey of the J.C. Boyle Development located in Keno, Oregon. AECOM assessed the site buildings for a variety of regulated building materials that would require removal or special handling during decommissioning and demolition. Section 4.5: Tables includes the tabulated results of the survey. The following are AECOM's general recommendations related to the HBMS findings:

- Plans and specifications should be developed by an appropriately qualified professional (e.g., CAC) to outline the planned scope of work, phasing, training and certification requirements, policies and procedures for the proper handling, removal packaging, disposal/recycling, and transportation of the materials.
- The findings of this report should be communicated to contractors planning to work on or bid on work at the site,
- Additional material-specific recommendations as listed below.

4.1 Asbestos

Two-hundred and three bulk samples of suspect asbestos-containing materials were collected and analyzed using Polarized Light Microscopy (PLM) during this assessment. Seven materials (HSAs) were found to contain detectable asbestos above 0.1%, five materials were assumed to contain asbestos, and three materials were visually assessed and determined to be non-suspect. Per the EPA NESHAP requirements and the analytical results, four sample layers were further analyzed using PLM Point Count Method.

In addition, six concrete bulk samples were collected and analyzed using PLM CARB 435 method to determine the content of NOA. No concrete samples were found to contain detectable NOA above the PLM point count threshold of 0.25%.

The results of the analyses are presented in Section 4.5, Tables 4-1, 4-2, and 4-3. Appendix C contains the laboratory reports of analytical results for each discrete sample.

Additional suspect ACMs may be present in inaccessible or concealed spaces. These spaces include, but are not limited to; below grade exterior materials, electrical systems, pipe chases, spaces between wall/ceiling/door/floor cavities, interior of mechanical components, beneath foundation pads, etc. If future demolition activities make these areas accessible, AECOM recommends that a thorough assessment of these spaces be conducted at that time to identify and confirm the presence or absence of additional ACMs

and ACCMs. Until then, all such unidentified materials must be treated as assumed ACMs in accordance with applicable federal, state, and local regulations.

If the analytical results indicate that all the samples collected per HSA do not contain asbestos, then the HSA (material) is considered a non-ACM. If the analytical results of one or more of the samples collected per HSA indicate that asbestos is present in quantities of greater than 0.1% asbestos as defined by Cal/OSHA, all of the HSA (material) is considered to be an ACM or ACCM regardless of any other analytical results.

Any material that contains greater than 0.1% asbestos is considered an ACCM and must be handled according to Cal/OSHA regulations. Any material greater than one percent asbestos is considered an ACM and must be handled according to EPA regulations, and applicable state and local regulations. The EPA NESHAP regulations (40 CFR 61, Subparts A and M) have a requirement related to assessment of suspect ACM in buildings. When the asbestos content of a friable material is visually estimated by PLM to be detectable but less than ten percent, your firm may elect to (1) assume the amount is greater than one percent and treat the material as asbestos-containing or (2) require verification of the amount by the PLM point counting technique. If the results obtained by point counting and visual estimation are different, the point count result must be used. When no asbestos is detected by PLM, point counting is not required.

4.1.1 Asbestos Regulations

Asbestos-related work must be performed in compliance with local, federal, and state regulations including Cal/OSHA, the Siskiyou County Air Pollution Control District, EPA NESHAP, and relevant federal, state and local regulations pertaining to handling of asbestos.

The EPA NESHAP regulations (Renovation and Demolition NESHAP 40 CFR 61, Subparts A and M) for asbestos apply to certain demolition and renovation projects in facilities containing ACM and/or assumed ACM. The NESHAP rule usually requires that all friable ACM and some categories of non-friable ACM be removed before a building is demolished, and may require localized removal prior to demolition. The following NESHAP definitions of ACM are very important in interpreting which NESHAP requirements may apply to your building:

- Friable asbestos-containing material: any material containing more than 1 percent asbestos that when dry, can be crumbled, pulverized, or reduced to powder by hand pressure.
- Category I non-friable asbestos-containing material: asbestos-containing packings, gaskets, resilient floor covering, and asphalt roofing products containing more than 1 percent asbestos that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.
- Category II non-friable asbestos-containing material: any material excluding Category I non-friable ACM, containing more than 1 percent asbestos that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.
- Regulated asbestos-containing material (RACM): (1) friable ACM, (2) Category I non-friable ACM that has become friable (3) Category I non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading, or (4) Category II non-friable ACM that has a high probability of

becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the materials in the course of demolition or renovation operations regulated by NESHAP.

NESHAP also requires that the local air district be notified before certain renovations or demolition impacting RACM begin. When ACCM is removed or disturbed during demolition or renovation, the Cal/OSHA regulations also apply. The NESHAP regulations should be studied in detail for a thorough delineation of these and other requirements.

Cal/OSHA regulates employee exposure to asbestos (T8, CCR 1529). The Cal/OSHA asbestos standards mandate a permissible exposure limit (PEL) of 0.1 fibers (equal to or longer than 5 micrometers) per cubic centimeter of air (fibers/cc) determined as an 8-hour, time-weighted average (TWA) and an excursion limit of 1 fiber/cc as a 30-minute TWA.

Also, for asbestos removal or renovation involving ACM, the Cal/OSHA Asbestos Construction Standard (T8, CCR 1529) requires that specific procedures be followed, including enclosure of the work area to control asbestos exposure of building occupants, as well as, employees involved in abatement or renovation activities.

The following are selected Cal/OSHA definitions regarding asbestos work:

- **Class I asbestos work** means activities involving the removal of TSI and surfacing ACM and PACM.
- **Class II asbestos work** means activities involving the removal of ACM which is not thermal system insulation or surfacing material. This includes, but is not limited to, the removal of asbestos-containing wallboard, floor tile and sheeting, roofing and siding shingles, and construction mastics.
- **Class III asbestos work** means repair and maintenance operations, where "ACM", including TSI and surfacing ACM and PACM, is likely to be disturbed.
- **Class IV asbestos work** means maintenance and custodial activities during which employees contact but do not disturb ACM or PACM and activities to clean up dust, waste and debris resulting from Class I, II, and III activities.
- **Intact** means that the ACM has not crumbled, been pulverized, or otherwise deteriorated so that asbestos is no longer likely to be bound with its matrix.

AECOM identified materials that were assumed to contain asbestos, but were not assessed because the inspector determined them to be ACM, for the safety of the inspector and to preserve building system integrity.

During demolition activities, inaccessible materials may be uncovered which were not identified or sampled during this assessment. Personnel in charge of demolition should be alerted to note materials uncovered during these activities which were not identified in this report. The following are AECOM's recommendations:

- If the buildings are scheduled for abatement and demolition (AECOM's recommendation), an abatement project design manual should be prepared with technical specifications and abatement plans. The design must be prepared by a CAC.

- The results of this sampling should be communicated to any Contractors working in the Project Areas and a copy of the assessment report must be on-site during demolition activities.
- Abatement work must be performed by CA-licensed asbestos abatement contractor with trained asbestos workers and supervisors.
- Any concealed building materials discovered during demolition activities, which are suspected to contain asbestos, should be sampled by a CSST or CAC and analyzed by a NVLAP- and CA ELAP-accredited laboratory to confirm the presence of asbestos prior to disturbing such materials or be assumed to be ACM.
- If the facilities assessed during the HBMS are not scheduled for demolition, AECOM recommends the development of an O&M Plan by a CAC.

4.2 Lead

Sixteen paint chip samples were collected and analyzed for total lead content; fifteen of the paint chip samples were found to contain detectable levels of lead. The results of the analyses are presented in Section 4.5 Table 4-3. Appendix C contains the laboratory reports of analytical results for each discrete sample.

Cal/OSHA requires worker training, worker protection, and exposure assessments be conducted during operations that may disturb the lead-containing paint in such a way that the airborne exposure may reach or exceed the Action Level of 30 micrograms per cubic meter ($\mu\text{g}/\text{m}^3$) or the Permissible Exposure Limit of 50 $\mu\text{g}/\text{cm}^3$. The worker protection requirements of Cal/OSHA 1532.1 "Lead" apply.

4.3 Other Regulated Building Materials

Mercury-containing fluorescent light tubes and HID lamps were observed during the assessment. In the switchyard, the yellow glass portion of the high voltage transformer bushings may contain PCBs in the oil. One caulking sample was collected and analyzed for PCBs using EPA method 8270 by gas chromatography/mass spectrometry (GCMS). No PCBs were detected in the caulking sample.

Fluorescent light tubes, switches, and thermostats may contain mercury. Fluorescent light ballasts, transformer oil, and HID lamp ballasts may contain PCBs. PCB wastes are regulated by Department of Toxic Substance Control Act (DTSC) Title 22 CCR 66261.24, Resource Conservation Recovery Act (RCRA) Title 40 CFR 761, and Toxic Substance Control Act (TSCA) 15 USC 2695. DTSC has classified PCBs as a hazardous waste when the concentrations are equal to or greater than 5 mg/l in liquids or when the total concentrations are equal to or greater than 50 mg/kg in non-liquids (Title 22, CCR, 66261.24). If the PCB waste is greater than 50 mg/l, then it is also to be managed under the RCRA and TSCA requirements. Employers must inform their employees of mercury and PCB hazards in accordance with Cal/OSHA.

Light ballasts in representative locations were visually assessed where possible. All light ballasts observed during the course of the HBMS were electronic ballasts or magnetic ballasts labeled "No PCBs". During the

course of decommissioning or demolition activities, magnetic light ballasts may be discovered that are not labeled “No PCBs” and should be disposed of per DTSC requirements.

Fluorescent light tubes must be removed and recycled or disposed of as hazardous waste or universal waste prior to demolition as per 22 CFR 66261.50 and 66273.8.

The results of the Universal Waste Inventory are presented in Section 4.5 Table 4-5.

4.4 Treated Wood

Wood treated with creosote was observed in the following locations:

- Power poles throughout J.C. Boyle Development, including within the Switchyard
- Wooden bridge associated with the Intake Structure
- Timber Bridge

4.5 Tables

Table 4-1: Confirmed ACMs, ACCMs, and Assumed ACMs lists the HSAs (materials) that were tested and confirmed to contain greater than 0.1 percent asbestos as well as the HSAs that could not be tested and are assumed to contain asbestos. NESHAP categories and approximate quantities of each material are identified, when possible.

Table 4-2: Asbestos Sample Results by Layer lists the tabulated analytical results for each discrete asbestos sample, listed by building then by HSA. Confirmed ACMs, ACCMs and Non-ACMs are included.

Table 4-3: Visually Negative Materials lists the materials that were visually assessed and determined to be non-suspect.

Table 4-4: Lead Paint Sample Results lists the tabulated analytical results for each discrete lead paint sample.

Table 4-5: Universal Waste Inventory presents the tabulated approximate quantities of fluorescent light tubes, suspect PCB containing light ballasts, non-PCB containing magnetic light ballasts, HID Lamps, and PCB-containing transformers.

Table 4-6: PCB-Caulking Sample Results lists the tabulated analytical results for each PCB caulking sample.

Appendix A contains figures of structures, sampling locations, and asbestos-containing material locations.

Appendix B contains HSA Photologs, by building, then by HSA.

Appendix C contains the laboratory reports of analytical results for each discrete sample.

Appendix D contains personnel and laboratory certifications.

Table 4-1 Confirmed ACMs, ACCMs, and Assumed ACMs

Table 1: Confirmed ACMs and Assumed ACMs								
Building	HSA#	HSA Description	Material Location	AHERA Class	Friability	NESHAP Category	Summarized Results	Quantity
Communication Building	JCCB-04	Asbestos-containing tan caulking	At base of interior wall/concrete interface	Misc.	NF	Cat II	Positive	78 LF
HazMat Shed and Fuel Shed	JCHM-01	Asbestos-containing asphaltic concrete crack sealant	Asphalt pad associated with HazMat Shed and Above Ground Storage Tanks	Misc.	NF	Cat II	Positive	20 LF
HazMat Shed and Fuel Shed	JCHM-03	Asbestos-containing off-white caulking	On above ground storage tank concrete casing in Fuel Shed	Misc.	NF	Cat II	Positive	4 EA (penetrations)
HazMat Shed and Fuel Shed	JCHM-06	Asbestos-containing off-white sealant	Ceiling/roof seams of HazMat Shed	Misc.	NF	Cat II	Positive	~100 LF
Office Warehouse	JCOW-08	Assumed asbestos-containing silver woven electrical wire insulation	Throughout Office and Warehouse	Misc.	NF	Cat II	Assumed	Not quantified
Powerhouse	JCPH-05	Assumed asbestos-containing gaskets	Piping and mechanical equipment throughout Powerhouse	Misc.	—	—	Assumed	Not quantified*
Powerhouse	JCPH-08	Asbestos-containing gray door sealant	Entry into upper level of Powerhouse (interior and exterior of door)	Misc.	NF	Cat II	Positive	32 LF
Powerhouse	JCPH-14	Assumed asbestos-containing metal clad fire doors	Throughout Powerhouse	Misc.	NF	Cat II	Assumed	5 EA
Powerhouse	JCPH-15	Assumed asbestos-containing wicket gates	Associated with turbines	Misc.	NF	Cat II	Assumed	2 EA
Warehouse	JCWH-01	Asbestos-containing black asphaltic slip sheet with cementitious material	Exterior interface between metal siding and concrete foundation	Misc.	NF	Cat II	Positive	192 LF
Warehouse	JCWH-05	Asbestos-containing tan brittle caulking	At metal seams around interior roll-up door	Misc.	NF	Cat II	Positive	330 SF

NF: Non-Friable; HSA: material that is uniform in color, texture, general appearance, and construction and application date, Surf.: Surfacing material per AHERA, Misc.: Miscellaneous material per AHERA, SF: Square Feet, EA: Each; LF: Linear Feet; Cat II: Category II per NESHAPS; Materials that were unable to be sampled (typically because of inaccessibility or sampling would be too destructive while facilities were still operational) are assumed to be asbestos-containing. *Not quantified because of unknown extent of material not accessible at time of inspection; as-built drawings needed for approximate quantification.

Table 1: Confirmed ACMs and Assumed ACMs								
Building	HSA#	HSA Description	Material Location	AHERA Class	Friability	NESHAP Category	Summarized Results	Quantity
Throughout JC Boyle Development	-	Assumed asbestos-containing buried Transite piping	Based on piping found at Copco 2, it is reasonable to assume that buried Transite piping also exists throughout the JC Boyle Development	Misc.	NF	Cat II	Assumed	Not quantified*

NF: Non-Friable; HSA: material that is uniform in color, texture, general appearance, and construction and application date, Surf.: Surfacing material per AHERA, Misc.: Miscellaneous material per AHERA, SF: Square Feet, EA: Each; LF: Linear Feet; Cat II: Category II per NESHAPS; Materials that were unable to be sampled (typically because of inaccessibility or sampling would be too destructive while facilities were still operational) are assumed to be asbestos-containing.
 *Not quantified because of unknown extent of material not accessible at time of inspection; as-built drawings needed for approximate quantification.

Table 4-2 Asbestos Sample Results by Layer

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Canal Headgate and 14' Pipeline	JCCH-1-01	1	Black soft material with paint chips	Around 14' diversion pipeline	Misc.		None Detected
Canal Headgate and 14' Pipeline	JCCH-2-01	1	Silver paint	Around 14' diversion pipe down spout	Misc.		None Detected
Canal Headgate and 14' Pipeline		2	Red rubbery material	Around 14' diversion pipe down spout	Misc.		None Detected
Canal Headgate and 14' Pipeline	JCCH-3-01	1	Silver paint	14' diversion pipe	Misc.		None Detected
Canal Headgate and 14' Pipeline	JCCH-3-02	1	Silver paint	14' diversion pipe	Misc.		None Detected
Canal Headgate and 14' Pipeline	JCCH-3-03	1	Silver paint	14' diversion pipe	Misc.		None Detected
Communication Building	JCCB-1-01	1	Light gray soft foamy material with paint	Exterior metal siding seams	Misc.		None Detected
Communication Building	JCCB-1-02	1	Light gray soft foamy material with debris	Exterior metal siding seams	Misc.		None Detected
Communication Building	JCCB-2-01	1	Black asphaltic material	Exterior asphalt crack repairs	Misc.		None Detected
Communication Building	JCCB-2-02	1	Black soft asphaltic material	Exterior asphalt crack repairs	Misc.		None Detected
Communication Building	JCCB-3-01	1	Black asphaltic material	Exterior asphalt	Misc.		None Detected
Communication Building	JCCB-4-01	1	Light gray soft material	At base of interior wall/concrete interface	Misc.	2%	Chrysotile
Communication Building	JCCB-4-02	1	Light gray soft material	At base of interior wall/concrete interface	Misc.	2%	Chrysotile
Fire Protection Building	JCFP-1-01	1	Red brittle material with paint	Piping throughout Fire Protection Building	Misc.		None Detected
Fire Protection Building	JCFP-1-02	1	Red brittle material with paint	Piping throughout Fire Protection Building	Misc.		None Detected
Fire Protection Building	JCFP-1-03	1	Red soft material with paint	Piping throughout Fire Protection Building	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 2: Asbestos Sample Results by Layer							
Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Fire Protection Building	JCFP-2-01	1	Black rubbery soft material with red paint and inter fill-loose fibrous	Piping throughout Fire Protection Building	Misc.		None Detected
Fire Protection Building	JCFP-3-01	1	Brown fibrous material with rush	Interior of metal double doors (deterioration exposed insulation)	Misc.		None Detected
Fire Protection Building	JCFP-4-01	1	Light gray sandy/brittle material	Exterior walls	Misc.		None Detected
Fire Protection Building	JCFP-5-01	1	Off-white brittle/soft mastic	Around exterior vents	Misc.		None Detected
Gate Control and Communication Building	JCGCB-1-01	1	Gray brittle window putty	Interior window frames	Misc.		None Detected
Gate Control and Communication Building	JCGCB-1-02	1	Gray brittle window putty	Interior window frames	Misc.		None Detected
Gate Control and Communication Building	JCGCB-2-01	1	Red fire stop	Interior wall, at electrical conduit penetrations	Misc.		None Detected
Gate Control and Communication Building	JCGCB-2-02	1	Red fire stop	Interior wall, at electrical conduit penetrations	Misc.		None Detected
Gate Control and Communication Building	JCGCB-3-01	1	Gray sealant	Exterior metal siding seams	Misc.		None Detected
Gate Control and Communication Building	JCGCB-3-02	1	Gray sealant	Exterior metal siding seams	Misc.		None Detected
Groundwater Pumphouse	JCPH-1-01	1	Tan paper with asphalt	Batt insulation above wood ceiling	Misc.		None Detected
Groundwater Pumphouse		2	Pink fibrous material	Batt insulation above wood ceiling	TSI		None Detected
Groundwater Pumphouse	JCPH-1-02	1	Tan paper with asphalt	Batt insulation above wood ceiling	Misc.		None Detected
Groundwater Pumphouse		2	Pink fibrous material	Batt insulation above wood ceiling	TSI		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Groundwater Pumphouse	JCPH-1-03	1	Tan paper with asphalt	Batt insulation above wood ceiling	Misc.		None Detected
Groundwater Pumphouse		2	Pink fibrous material	Batt insulation above wood ceiling	TSI		None Detected
Groundwater Pumphouse	JCPH-2-01	1	Black asphaltic fibrous material	Underneath corrugated metal siding, throughout exterior	Misc.		None Detected
Groundwater Pumphouse	JCPH-2-02	1	Black asphaltic fibrous material	Underneath corrugated metal siding, throughout exterior	Misc.		None Detected
Groundwater Pumphouse	JCPH-2-03	1	Black asphaltic fibrous material with brown paint	Underneath corrugated metal siding, throughout exterior	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-1-01	1	Black soft asphaltic material	Asphalt pad associated with HazMat Shed and Above Ground Storage Tanks	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-1-02	1	Black soft asphaltic material	Asphalt pad associated with HazMat Shed and Above Ground Storage Tanks	Misc.		None Detected
HazMat Shed and Fuel Shed		2	Black asphaltic material	Asphalt pad associated with HazMat Shed and Above Ground Storage Tanks	Misc.	2%	Chrysotile
HazMat Shed and Fuel Shed	JCHM-2-01	1	Beige brittle/sandy material with off-white paint	On above ground storage tank concrete casing in Fuel Shed	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-2-02	1	Beige brittle/sandy material with off-white paint	On above ground storage tank concrete casing in Fuel Shed	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-2-03	1	Light gray brittle/sandy material with off-white paint	On above ground storage tank concrete casing in Fuel Shed	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-3-01	1	White soft material	On above ground storage tank concrete casing in Fuel Shed piping	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-3-02	1	Beige soft/brittle material with gray paint	On above ground storage tank concrete casing in Fuel Shed	Misc.	<0.1%*	Chrysotile
HazMat Shed and Fuel Shed	JCHM-4-01	1	Gray/silver paint	Roof of small storage shed adjacent to HazMat Shed	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-4-02	1	Orange/silver paint	Roof of small storage shed adjacent to HazMat Shed	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
HazMat Shed and Fuel Shed	JCHM-4-03	1	Orange/silver paint	Roof of small storage shed adjacent to HazMat Shed	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-5-01	1	White soft material	On roll-up door to HazMat Shed	Misc.		None Detected
HazMat Shed and Fuel Shed	JCHM-6-01	1	Light gray compressed fibrous material	Ceiling/roof seams of HazMat Shed	Misc.	45%	Chrysotile
Intake Structure	JCIS-10-01	1	Gray brittle material	Structure around stop logs	Misc.		None Detected
Intake Structure	JCIS-1-01	1	Gray brittle material with debris	Driveway area of intake structure	Misc.		None Detected
Intake Structure	JCIS-11-01	1	Gray rubbery material with sand	At walkway expansion joints	Misc.		None Detected
Intake Structure	JCIS-12-01	1	Off-white brittle material	Fish screen flooring area around fish screen building	Misc.		None Detected
Intake Structure	JCIS-12-02	1	Gray brittle material with paint	Fish screen flooring area around fish screen building	Misc.		None Detected
Intake Structure		2	Off-white brittle material	Fish screen flooring area around fish screen building	Misc.		None Detected
Intake Structure	JCIS-13-01	1	Silver paint	Stop log structural cage frame	Misc.		None Detected
Intake Structure		2	Metal oxide with paint	Stop log structural cage frame	Misc.		None Detected
Intake Structure	JCIS-13-02	1	Silver paint	Stop log structural cage frame	Misc.		None Detected
Intake Structure		2	Metal oxide	Stop log structural cage frame	Misc.		None Detected
Intake Structure	JCIS-13-03	1	Silver paint	Stop log structural cage frame	Misc.		None Detected
Intake Structure	JCIS-14-01	1	Gray brittle material	At beginning of wood bridge	Misc.		None Detected
Intake Structure	JCIS-15-01	1	Silver paint	Exterior of intake structure, below fish screen house lower section	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 2: Asbestos Sample Results by Layer							
Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Intake Structure		2	Metal oxide with paint	Exterior of intake structure, below fish screen house lower section	Misc.		None Detected
Intake Structure	JCIS-15-02	1	Silver paint	Exterior of intake structure, below fish screen house lower section	Misc.		None Detected
Intake Structure		2	Metal oxide with paint	Exterior of intake structure, below fish screen house lower section	Misc.		None Detected
Intake Structure	JCIS-15-03	1	Soft flaky material with metallic paint	Exterior of intake structure, below fish screen house lower section	Misc.		None Detected
Intake Structure	JCIS-16-01	1	Black asphaltic fibrous material with paint	Underneath wood walls of Intake Structure Reservoir Level Building	Misc.		None Detected
Intake Structure	JCIS-16-02	1	Black asphaltic fibrous material with paint	Underneath wood walls of Intake Structure Reservoir Level Building	Misc.		None Detected
Intake Structure	JCIS-2-01	1	Black sticky material with mineral grains	Driveway area of intake structure	Misc.		None Detected
Intake Structure	JCIS-3-01	1	Gray sandy rubbery material	Intake structure walkway	Surf.		None Detected
Intake Structure		2	Gray brittle material	Intake structure walkway	Misc.		None Detected
Intake Structure	JCIS-3-02	1	Gray sandy rubbery material	Intake structure walkway	Misc.		None Detected
Intake Structure		2	Gray brittle material	Intake structure walkway	Misc.		None Detected
Intake Structure	JCIS-3-03	1	Gray sandy rubbery material	Intake structure walkway	Misc.		None Detected
Intake Structure	JCIS-3-04	1	Gray brittle material	Intake structure walkway	Misc.		None Detected
Intake Structure	JCIS-4-01	1	Black asphaltic mastic	On wood bridge to intake structure	Misc.		None Detected
Intake Structure	JCIS-4-02	1	Black asphaltic mastic	On wood bridge to intake structure	Misc.		None Detected
Intake Structure	JCIS-5-01	1	Silver paint	Flex pipe connection associated with pump inside Fish Screen Building	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Intake Structure		2	Brown woven fibrous material with brittle brown mastic	Flex pipe connection associated with pump inside Fish Screen Building	Misc.		None Detected
Intake Structure	JCIS-6-01	1	Silver paint	Piping connecting traveling water screens inside Fish Screen Building	Misc.		None Detected
Intake Structure		2	Green and brown paint	Piping connecting traveling water screens inside Fish Screen Building	Misc.		None Detected
Intake Structure	JCIS-6-02	1	Silver paint	Piping connecting traveling water screens inside Fish Screen Building	Misc.		None Detected
Intake Structure		2	Green orange and brown paint	Piping connecting traveling water screens inside Fish Screen Building	Misc.		None Detected
Intake Structure	JCIS-6-03	1	Silver paint	Piping connecting traveling water screens inside Fish Screen Building	Misc.		None Detected
Intake Structure		2	Green orange and brown paint	Piping connecting traveling water screens inside Fish Screen Building	Misc.		None Detected
Intake Structure	JCIS-7-01	1	White rubbery material with paint	At concrete wall/wood ceiling interface inside Fish Screen Building	Misc.		None Detected
Intake Structure		2	Brown rubbery material with paint and wood flakes	At concrete wall/wood ceiling interface inside Fish Screen Building	Misc.		None Detected
Intake Structure	JCIS-7-02	1	White rubbery material with paint	At concrete wall/wood ceiling interface inside Fish Screen Building	Misc.		None Detected
Intake Structure		2	Brown rubbery material with paint and wood flakes	At concrete wall/wood ceiling interface inside Fish Screen Building	Misc.		None Detected
Intake Structure	JCIS-8-01	1	Brown paper with black asphaltic mastic	Above ceiling in Fish Screen Building	Misc.		None Detected
Intake Structure		2	Pink fibrous material	Above ceiling in Fish Screen Building	TSI		None Detected
Intake Structure	JCIS-8-02	1	Brown paper with black asphaltic mastic	Above ceiling in Fish Screen Building	Misc.		None Detected
Intake Structure		2	Pink fibrous material	Above ceiling in Fish Screen Building	TSI		None Detected
Intake Structure		3	Off-white paint	Above ceiling in Fish Screen Building	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Intake Structure	JCIS-8-03	1	Brown paper with black asphaltic mastic	Above ceiling in Fish Screen Building	TSI		None Detected
Intake Structure		2	Pink fibrous material	Above ceiling in Fish Screen Building	Misc.		None Detected
Intake Structure	JCIS-9-01	1	Silver paint	On traveling water screen machinery	Misc.		None Detected
Intake Structure		2	Gray and brown paint	On traveling water screen machinery	Misc.		None Detected
Intake Structure	JCIS-9-02	1	Silver paint	On traveling water screen machinery	Misc.		None Detected
Intake Structure		2	Gray and brown paint	On traveling water screen machinery	Misc.		None Detected
Intake Structure	JCIS-9-03	1	Silver paint	On traveling water screen machinery	Misc.		None Detected
Intake Structure		2	Gray and brown paint	On traveling water screen machinery	Misc.		None Detected
Office Warehouse	JCOW-10-01	1	Tan fibrous material with mastic and metal foil	Insulation inside two roll-up doors in Warehouse	Misc.		None Detected
Office Warehouse		2	Off-white foamy material	Insulation inside two roll-up doors in Warehouse	Misc.		None Detected
Office Warehouse	JCOW-10-02	1	Tan fibrous material with mastic and metal foil	Insulation inside two roll-up doors in Warehouse	Misc.		None Detected
Office Warehouse		2	Off-white foamy material	Insulation inside two roll-up doors in Warehouse	Misc.		None Detected
Office Warehouse	JCOW-10-03	1	Tan fibrous material with mastic and metal foil	Insulation inside two roll-up doors in Warehouse	Misc.		None Detected
Office Warehouse		2	Off-white foamy material	Insulation inside two roll-up doors in Warehouse	Misc.		None Detected
Office Warehouse	JCOW-1-01	1	Gray sheet vinyl	Flooring in break room, shower room, office, hallway, and restroom	Misc.		None Detected
Office Warehouse		2	Gray fibrous backing with mastic (on wood)	Flooring in break room, shower room, office, hallway, and restroom	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Office Warehouse	JCOW-11-02	1	Gray sheet vinyl	Flooring in break room, shower room, office, hallway, and restroom	Misc.		None Detected
Office Warehouse		2	Tan fibrous backing with mastic (on wood)	Flooring in break room, shower room, office, hallway, and restroom	Misc.		None Detected
Office Warehouse		3	Black asphaltic fibrous material	Flooring in break room, shower room, office, hallway, and restroom	Misc.		None Detected
Office Warehouse	JCOW-11-03	1	Gray sheet vinyl	Flooring in break room, shower room, office, hallway, and restroom	Misc.		None Detected
Office Warehouse		2	Gray fibrous backing with mastic (on wood)	Flooring in break room, shower room, office, hallway, and restroom	Misc.		None Detected
Office Warehouse	JCOW-11-01	1	Black asphaltic mastic with paper	Above ceiling in attic of Warehouse	Misc.		None Detected
Office Warehouse		2	Pink fibrous material	Above ceiling in attic of Warehouse	TSI		None Detected
Office Warehouse	JCOW-11-02	1	Black asphaltic mastic with paper	Above ceiling in attic of Warehouse	Misc.		None Detected
Office Warehouse		2	Pink fibrous material	Above ceiling in attic of Warehouse	TSI		None Detected
Office Warehouse	JCOW-11-03	1	Black asphaltic mastic with paper	Above ceiling in attic of Warehouse	Misc.		None Detected
Office Warehouse		2	Pink fibrous material	Above ceiling in attic of Warehouse	TSI		None Detected
Office Warehouse	JCOW-11-04	1	Black asphaltic mastic with paper and paint	Above ceiling in attic of Warehouse	Misc.		None Detected
Office Warehouse		2	Pink fibrous material	Above ceiling in attic of Warehouse	TSI		None Detected
Office Warehouse	JCOW-12-01	1	Black asphaltic mastic with paper and paint	Behind wood wall, loft area of Warehouse	Misc.		None Detected
Office Warehouse		2	Yellow fibrous material	Behind wood wall, loft area of Warehouse	TSI		None Detected
Office Warehouse	JCOW-12-02	1	Black asphaltic mastic with paper and paint	Behind wood wall, loft area of Warehouse	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 2: Asbestos Sample Results by Layer							
Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Office Warehouse		2	Yellow fibrous material	Behind wood wall, loft area of Warehouse	TSI		None Detected
Office Warehouse	JCOW-12-03	1	Black asphaltic mastic with paper and paint	Behind wood wall, loft area of Warehouse	Misc.		None Detected
Office Warehouse		2	Yellow fibrous material	Behind wood wall, loft area of Warehouse	TSI		None Detected
Office Warehouse	JCOW-13-01	1	Black asphaltic soft material	At base of exterior metal walls, at wall/concrete interface	Misc.		None Detected
Office Warehouse	JCOW-13-02	1	Black asphaltic soft material	At base of exterior metal walls, at wall/concrete interface	Misc.		None Detected
Office Warehouse	JCOW-14-01	1	Off-white putty material with paint	Exterior window panes	Misc.		None Detected
Office Warehouse	JCOW-14-02	1	Off-white putty material with paint	Exterior window panes	Misc.		None Detected
Office Warehouse	JCOW-15-01	1	Black asphaltic fibrous felt	Underneath corrugated metal roof, throughout	Misc.		None Detected
Office Warehouse	JCOW-15-02	1	Black asphaltic fibrous felt with paint	Underneath corrugated metal roof, throughout	Misc.		None Detected
Office Warehouse	JCOW-16-01	1	Black asphaltic fibrous felt	Underneath corrugated metal siding of Office Warehouse shed	Misc.		None Detected
Office Warehouse	JCOW-16-02	1	Black asphaltic fibrous felt	Underneath corrugated metal siding of Office Warehouse shed	Misc.		None Detected
Office Warehouse	JCOW-17-01	1	Black asphaltic fibrous material	Underneath corrugated metal siding throughout Office Warehouse	Misc.		None Detected
Office Warehouse	JCOW-17-02	1	Black asphaltic fibrous material	Underneath corrugated metal siding throughout Office Warehouse	Misc.		None Detected
Office Warehouse	JCOW-2-01	1	Gray fibrous material with paint	Ceiling in entry way	Misc.		None Detected
Office Warehouse	JCOW-2-02	1	Gray fibrous material with paint	Ceiling in entry way	Misc.		None Detected
Office Warehouse	JCOW-2-03	1	Gray fibrous material with paint	Ceiling in entry way	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 2: Asbestos Sample Results by Layer							
Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Office Warehouse	JCOW-3-01	1	Gray rubbery material	Walls throughout office main floor	Misc.		None Detected
Office Warehouse		2	White soft mastic	Walls throughout office main floor	Misc.		None Detected
Office Warehouse		3	White compacted powdery material with paint	Walls throughout office main floor	Misc.		None Detected
Office Warehouse	JCOW-3-02	1	Gray rubbery material	Walls throughout office main floor	Misc.		None Detected
Office Warehouse		2	White soft mastic	Walls throughout office main floor	Misc.		None Detected
Office Warehouse		3	White compacted powdery material with paint	Walls throughout office main floor	Misc.		None Detected
Office Warehouse	JCOW-4-01	1	White compacted powdery material with paint	Walls throughout office main floor	Surf.		None Detected
Office Warehouse		2	White chalky material with paper	Walls throughout office main floor	Misc.		None Detected
Office Warehouse	JCOW-4-02	1	White textured powdery material with paint	Walls throughout office main floor	Surf.		None Detected
Office Warehouse		2	White chalky material with paper	Walls throughout office main floor	Misc.		None Detected
Office Warehouse	JCOW-4-03	1	White compacted powdery material with paint	Walls throughout office main floor	Surf.		None Detected
Office Warehouse		2	White chalky material with paper	Walls throughout office main floor	Misc.		None Detected
Office Warehouse	JCOW-4-04	1	White compacted powdery material with paint	Walls throughout office main floor	Surf.		None Detected
Office Warehouse		2	White chalky material with paper	Walls throughout office main floor	Misc.		None Detected
Office Warehouse	JCOW-4-05	1	White compacted powdery material with paint	Walls throughout office main floor	Surf.		None Detected
Office Warehouse		2	White chalky material with paper	Walls throughout office main floor	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 2: Asbestos Sample Results by Layer							
Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Office Warehouse	JCOW-4-06	1	White compacted powdery material with paint	Walls throughout office main floor	Surf.		None Detected
Office Warehouse		2	White chalky material with paper	Walls throughout office main floor	Misc.		None Detected
Office Warehouse	JCOW-6-01	1	White soft elastic material	Restroom counter	Misc.		None Detected
Office Warehouse		2	White compacted powdery material with paint and paper	Restroom counter	Misc.		None Detected
Office Warehouse	JCOW-7-01	1	Black plastic	Underneath restroom counter	Misc.		None Detected
Office Warehouse		2	Yellow soft adhesive	Underneath restroom counter	Misc.		None Detected
Outdoor Storage Area	JCBY-1-01	1	Red soft rubbery material	Out of service storage tank in Outdoor Storage Area	Misc.		None Detected
Outdoor Storage Area		2	Yellow soft mastic	Out of service storage tank in Outdoor Storage Area	Misc.		None Detected
Outdoor Storage Area	JCBY-2-01	1	Black brittle asphaltic material with granules	Out of service storage tank in Outdoor Storage Area	Misc.		None Detected
Outdoor Storage Area	JCBY-2-02	1	Black brittle asphaltic material with granules	Out of service storage tank in Outdoor Storage Area	Misc.		None Detected
Outdoor Storage Area	JCBY-3-01	1	Silver paint	Out of service storage tank in Outdoor Storage Area	Misc.		None Detected
Outdoor Storage Area		2	Yellow brittle material	Out of service storage tank in Outdoor Storage Area	Misc.		None Detected
Penstock	JCPS-01-01	1	Gray brittle cementitious material	Penstock piping support blocks	Misc.		None Detected
Powerhouse	JCPH-10-01	1	Gray sticky material	Walls throughout Powerhouse	Misc.		None Detected
Powerhouse	JCPH-1-01	1	Gray brittle material	Walls throughout Powerhouse	Misc.		None Detected
Powerhouse	JCPH-1-02	1	Gray brittle material with paint	Walls throughout Powerhouse	Misc.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing

Table 2: Asbestos Sample Results by Layer							
Building	Sample ID	Layer	Sample Description	Material Location	AHERA Classification	Percent (%) Asbestos	Asbestos Type
Powerhouse	JCPH-11-01	1	Gray rubbery material	Concrete pad/roof top side of Powerhouse	Misc.		None Detected
Powerhouse	JCPH-12-01	1	Gray brittle material	Concrete pad/roof top side of Powerhouse	Misc.		None Detected
Powerhouse		2	Tan brittle material	Concrete pad/roof top side of Powerhouse	Misc.		None Detected
Powerhouse	JCPH-12-02	1	Gray brittle material	Concrete pad/roof top side of Powerhouse	Misc.		None Detected
Powerhouse	JCPH-12-03	1	Gray brittle material	Concrete pad/roof top side of Powerhouse	Misc.		None Detected
Powerhouse		2	Tan brittle material	Concrete pad/roof top side of Powerhouse	Misc.		None Detected
Powerhouse	JCPH-13-01	1	Silver paint	Crane train tracks top side of Powerhouse	Misc.		None Detected
Powerhouse	JCPH-13-02	1	Silver paint	Crane train tracks top side of Powerhouse	Misc.		None Detected
Powerhouse	JCPH-13-03	1	Silver paint	Crane train tracks top side of Powerhouse	Misc.		None Detected
Powerhouse	JCPH-2-01	1	Off-white crumbly material with debris	Interior window panes	Misc.		None Detected
Powerhouse	JCPH-2-02	1	Tan crumbly material with paint	Interior window panes	Misc.		None Detected
Powerhouse	JCPH-3-01	1	Black rubbery material	Restroom walls	Misc.		None Detected
Powerhouse		2	Yellow soft mastic	Walls in upper level restroom	Misc.		None Detected
Powerhouse	JCPH-4-01	1	Red rubbery material with paint	Associated with generator piping, pumphouse lower level	Misc.		None Detected
Powerhouse		2	Black sticky mastic	Associated with generator piping, pumphouse lower level	Misc.		None Detected
Powerhouse	JCPH-6-01	1	White compacted powdery material with paint	Walls in upper level entry way	Surf.		None Detected

*Confirmed by layer via PLM Point Count at 1000 points; HSA: Material that is uniform in color, texture, general appearance, and construction and application date; Surf.: Surfacing material per AHERA; TSI: Thermal system insulation per AHERA; Misc.: Miscellaneous material per AHERA; Layers in bolded text are asbestos-containing